


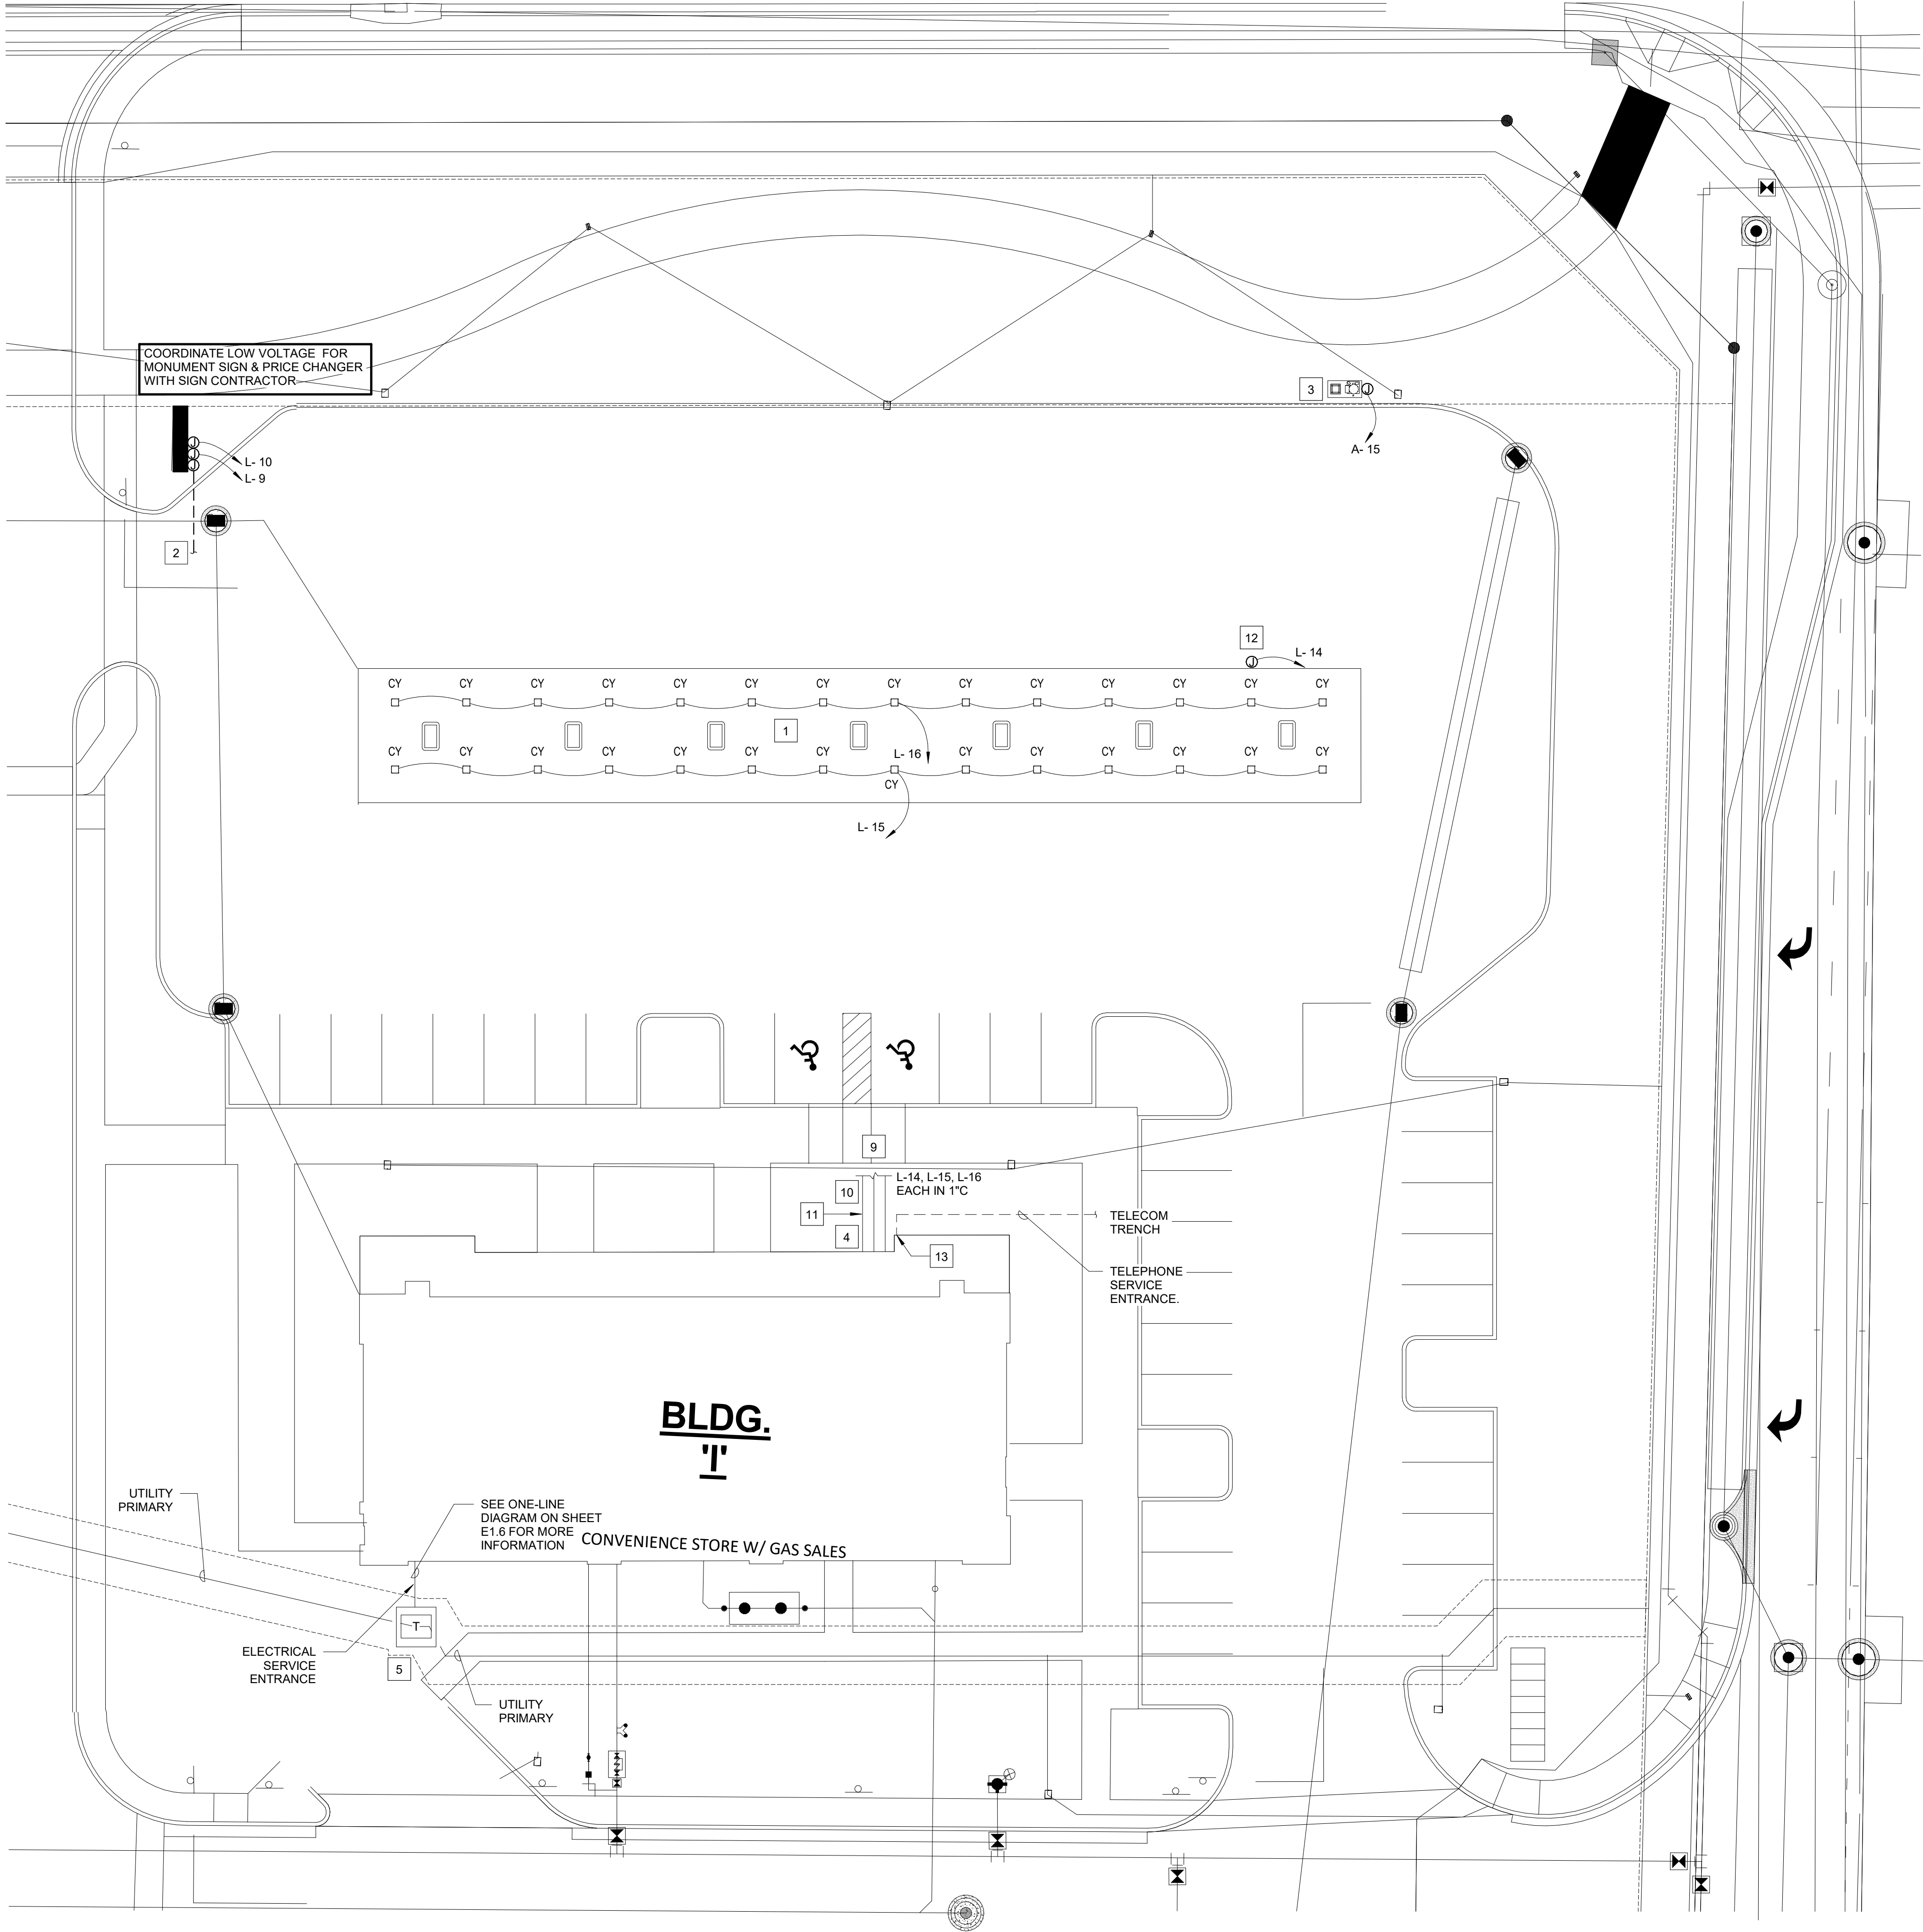

1

ELECTRICAL SITE PLAN
1/16" = 1'-0"

FUELING CANOPY LIGHT FIXTURE SCHEDULE										
LIGHT FIXTURE NAME	MANUFACTURER	CATALOG NUMBER	VOLTAGE	VA PER FIXTURE	LAMP TYPE	MOUNTING	LISTING	FIXTURE DESCRIPTION	COUNT	Comments
CY	LITHONIA	PCNY LED ALO2 SWW2 50K FPLC MVOLT	120 V	100 VA	LED	RECESSED	DLC	FUEL CANOPY LIGHT (WHITE TRIM)	28	SITE

KEYNOTES - POWER

- FUEL CANOPY. REFER TO FUEL DRAWINGS FOR ADDITIONAL WORK IN THIS AREA UNDER SEPARATE CONTRACT.
- (1) 3/4" C WITH FULL WIRE FOR DATA. COORDINATE FINAL LOCATION AND ROUTING WITH SIGN CONTRACTOR AND OWNER REPRESENTATIVE PRIOR TO TRENCHING.
- COORDINATE WITH FUEL AND CIVIL PLANS FOR EXACT LOCATION OF AIR VAC PRIOR TO TRENCHING.
- G.C. TO EXTEND INDIVIDUAL PVC COATED GALVANIZED STEEL CONDUITS WITH PULL STRINGS FROM ELECTRICAL ROOM TO 10' PAST THE BUILDING SLAB. FUEL CONTRACTOR TO CONTINUE CONDUITS AND PULL WIRE TO FINAL TERMINATION AT FUEL CANOPY. REF. FUEL DRAWINGS FOR NUMBER AND SIZE OF CONDUITS.
- UTILITY TRANSFORMER. COORDINATE TRANSFORMER PAD AND PRIMARY CONDUIT REQUIREMENTS WITH UTILITY COMPANY.
- NOT USED.
- NOT USED.
- NOT USED.
- G.C. TO COORDINATE BOLLARD INSTALLATION WITH ELECTRICAL CONDUIT RUNS TO FUEL CANOPY. PROVIDE TEMPORARY SLEEVE BOLLARDS AS NECESSARY TO MARK BOLLARD PLACEMENT DURING CONDUIT INSTALLATION.
- APPROXIMATE LOCATION OF TRENCH FOR FUEL CANOPY CONDUITS. COORDINATE WIDTH AND DEPTH OF TRENCH, SIZES OF CONDUITS, AND QUANTITY OF CONDUITS WITH FUEL VENDOR PRIOR TO ROUGH-IN.
- TERMINATE TRENCHING IN STORAGE ROOM BELOW MEZZANINE STAIRS.
- FUEL CANOPY SIGNAGE. COORDINATE POWER REQUIREMENTS WITH FUEL DRAWINGS.
- TELECOM ENTRANCE IN MEZZANINE ELECTRICAL ROOM. (2) 4" CONDUITS TO BE STUBBED FROM 5' OUTSIDE BUILDING UP TO TELECOM DEMARC LOCATION. ONE MAIN, ONE SPARE. CONFIRM REQUIREMENTS WITH UTILITY PRIOR TO ROUGH-IN.

COORDINATE EXACT LOCATION AND QUANTITY OF BUILDING EXTERIOR, CANOPY, AND SITE SIGNAGE WITH SIGN PACKAGE.

REFER TO SHEET E2.0 FOR BUILDING EXTERIOR LIGHTING SCHEDULE.

COORDINATE EXACT QUANTITY, TYPE, AND SIZE OF FUELING CONDUITS WITH FUELING PLANS.

REFER TO SHEET E2.1 FOR BUILDING EXTERIOR, CANOPY, AND SITE LIGHTING CONTROLS AND REQUIREMENTS

SITE AREA LIGHTING IS PROVIDED BY AND POWERED BY THE UTILITY COMPANY.