
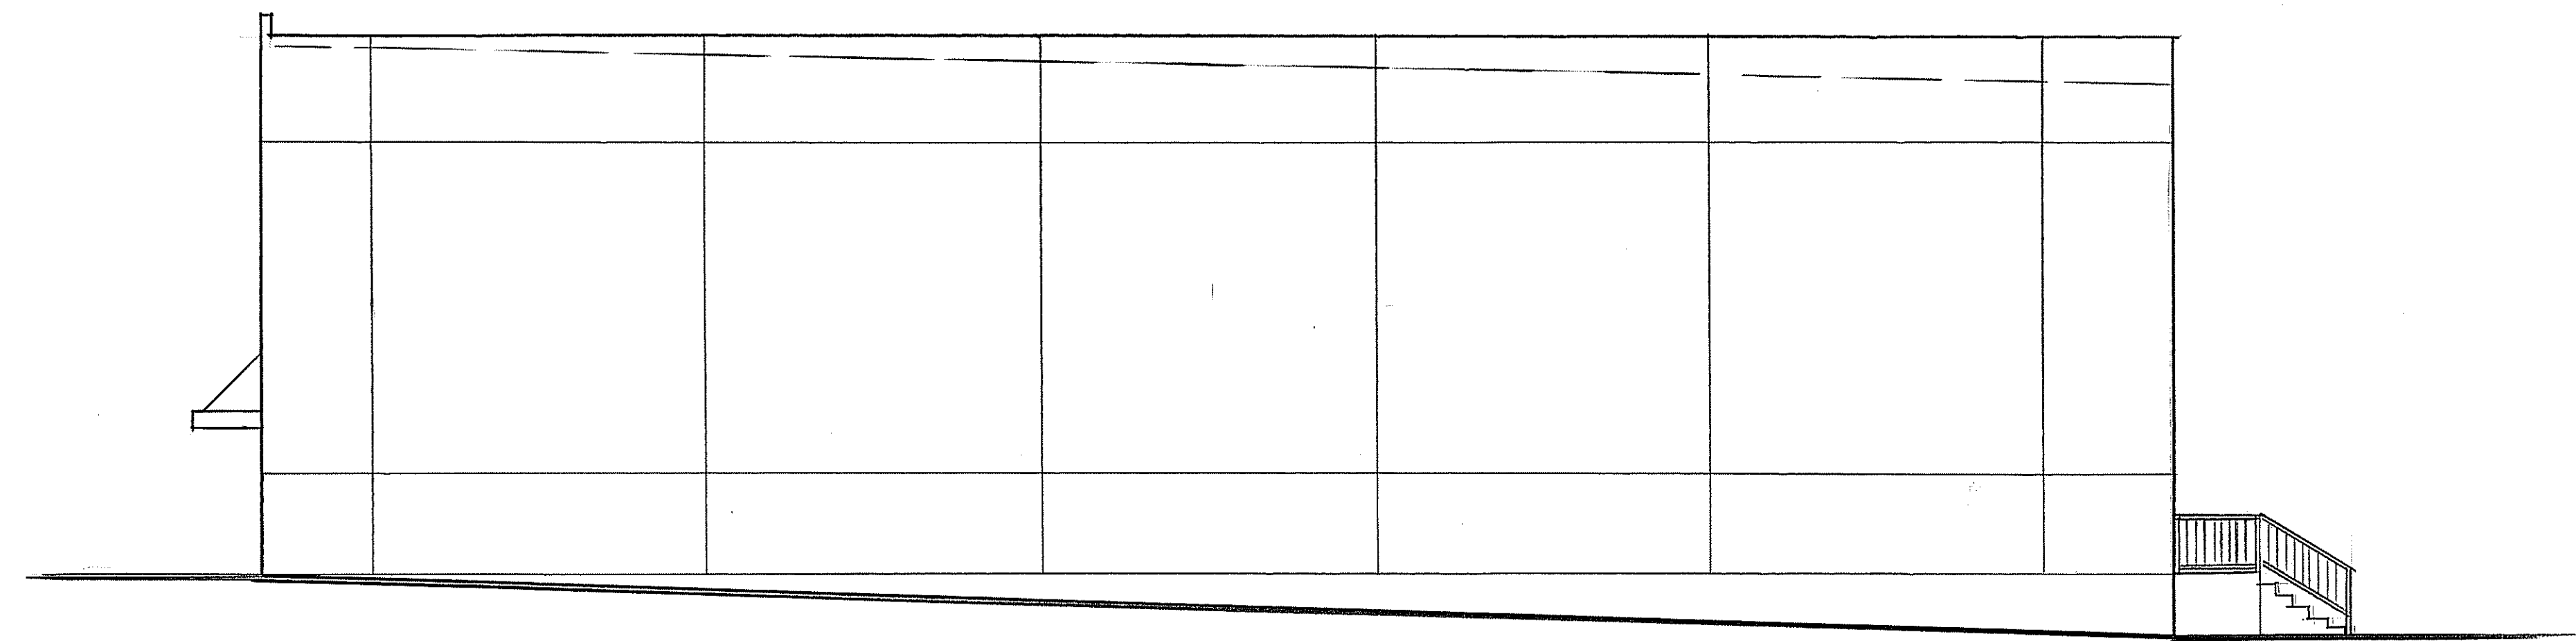



MATCH
LINE

[illegible]

RIGHT SIDE ELEVATION

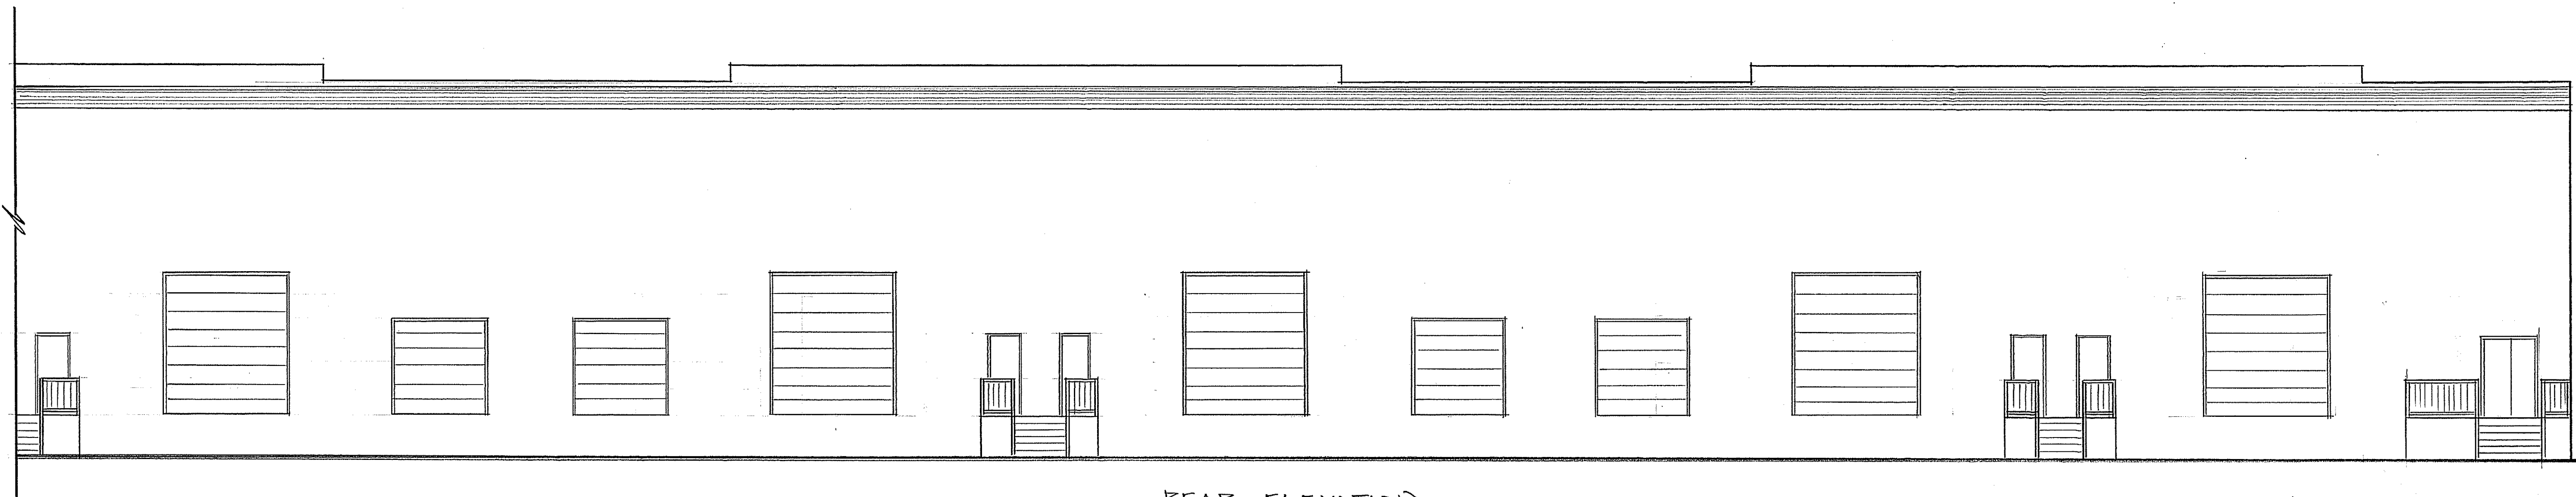

REAR ELEVATION

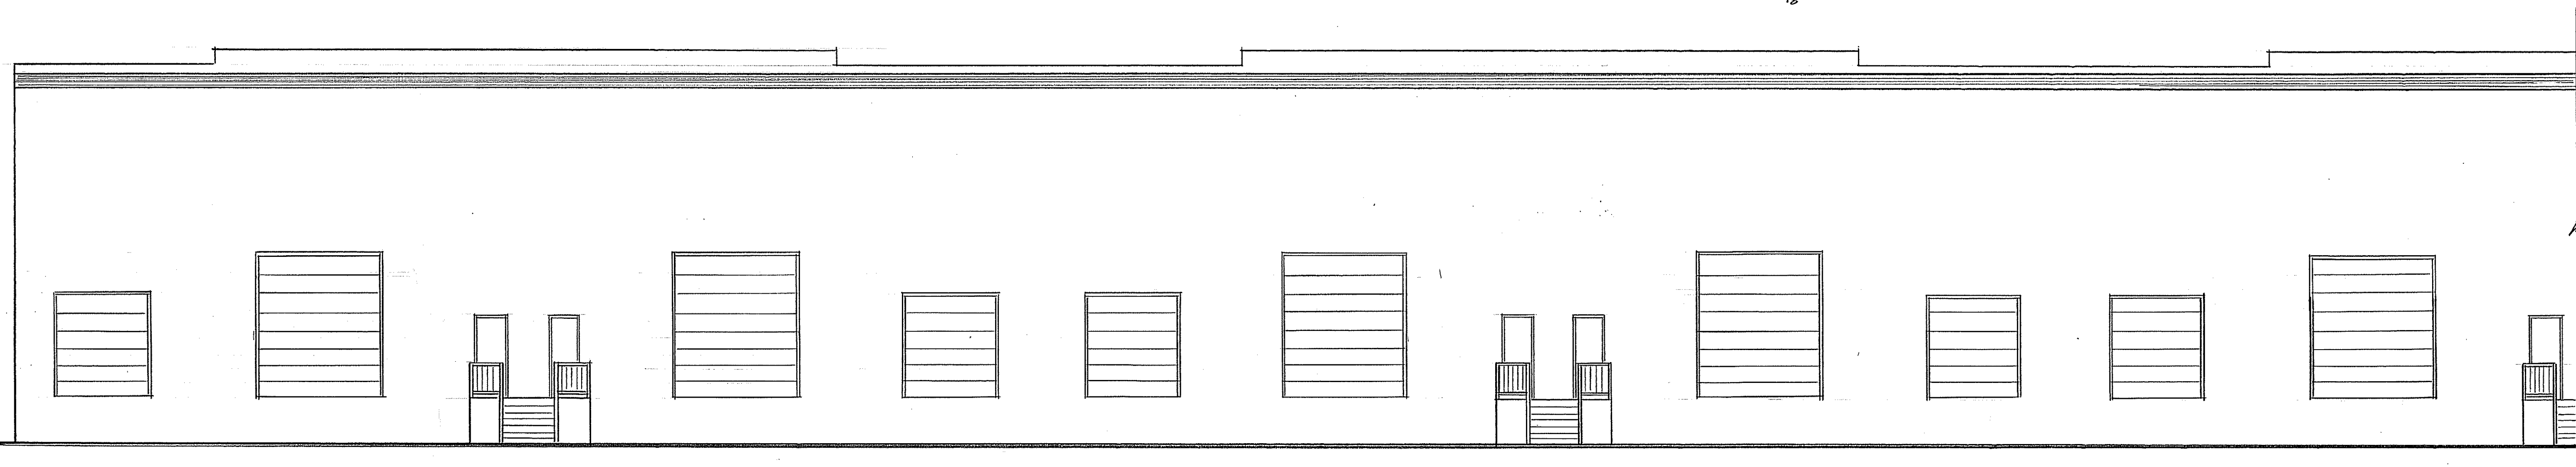

REAR ELEVATION

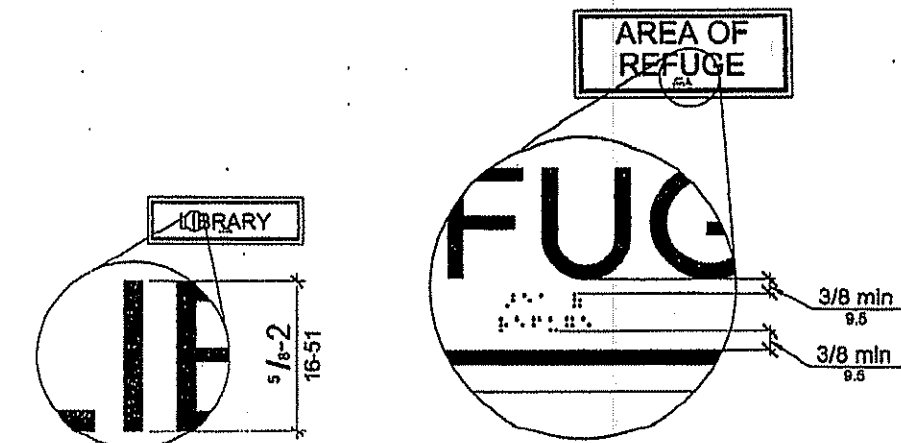


FIGURE 703.2.5
HEIGHT OF RAISED CHARACTERS

FIGURE 703.3.2
POSITION OF BRAILLE

TABLE 703.3.1 BRAILLE DIMENSIONS		
MEASUREMENT RANGE	MINIMUM IN INCHES	MAXIMUM IN INCHES
Dot base diameter	0.059 (1.5 mm)	0.063 (1.6 mm)
Distance between two dots in the same cell ¹	0.090 (2.3 mm)	0.100 (2.5 mm)
Distance between corresponding dots in adjacent cells ¹	0.241 (6.1 mm)	0.300 (7.6 mm)
Dot height	0.025 (0.6 mm)	0.037 (0.9 mm)
Distance between corresponding dots from one cell directly below ¹	0.395 (10 mm)	0.400 (10.2 mm)

1. Measured center to center.

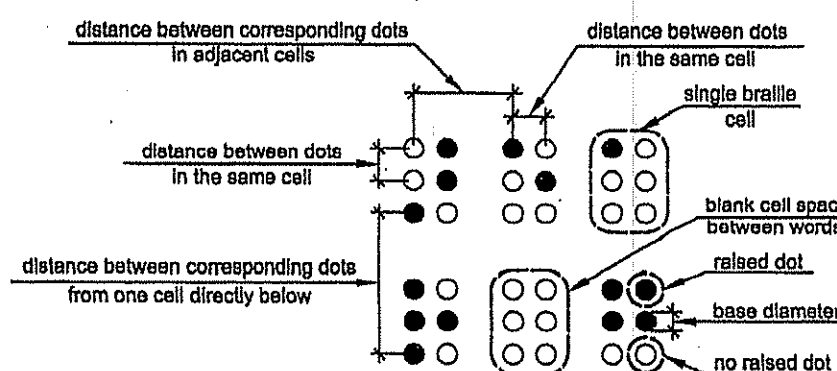


FIGURE 703.3.1
BRAILLE MEASUREMENT


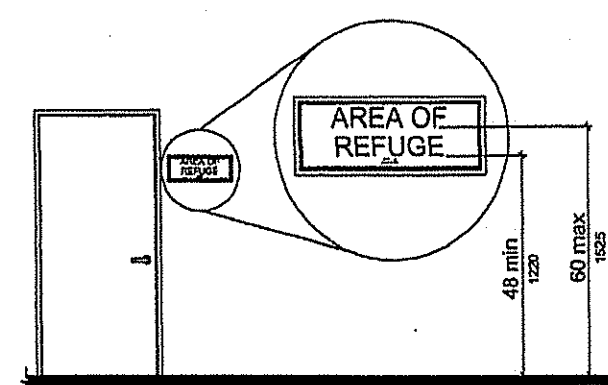


FIGURE 703.4.1
HEIGHT OF TACTILE CHARACTERS ABOVE FINISH FLOOR OR GROUND

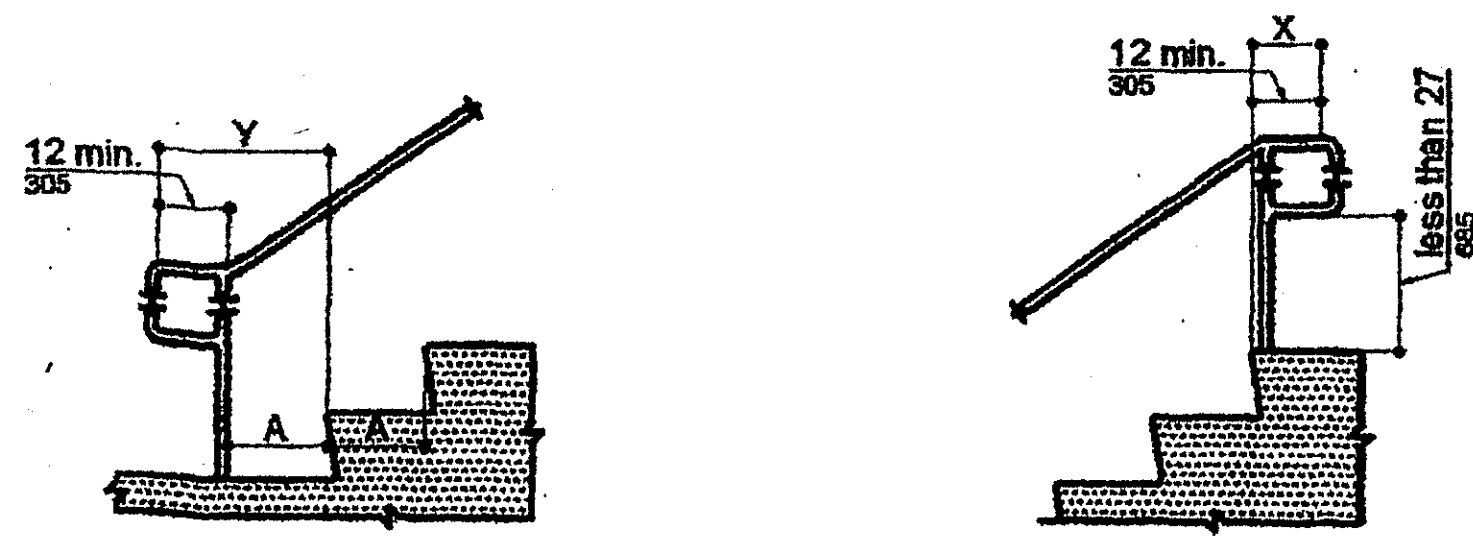


(c)
Extension at
Bottom of Run

(d)
Extension at
Top of Run

NOTE: X IS THE 12 IN. MINIMUM HANDRAIL EXTENSION
REQUIRED AT EACH TOP RISER.


Y IS THE MINIMUM HANDRAIL EXTENSION OF 12 IN.
PLUS THE WIDTH OF ONE TREAD THAT IS
REQUIRED AT EACH BOTTOM RISER.

FIGURE 19
STAIR HANDRAILS

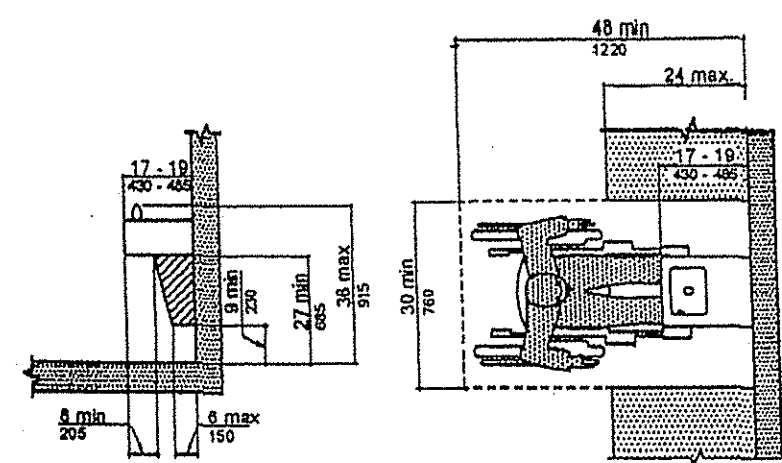

(a)
Spout Height
and Knee Clearance

(b)
Clear Floor Space

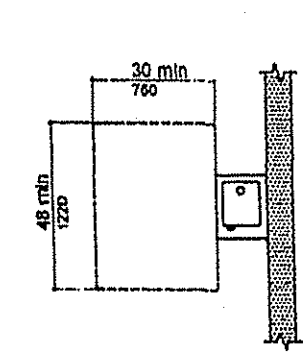


(c)
Free-Standing
Fountain or Cooler

(d)
Built-in
Fountain or Cooler

DRINKING FOUNTAINS SHALL BE HI-LOW WITH SPOUT OUTLET
@ 36" MAX. AND 38"-43" MAX. FOR PERSON STANDING.
SPOUT SHALL BE LOCATED 15" MIN. FROM
SUPPORT WALL & 5" FROM FRONT EDGE OF UNIT.
SPOUT SHALL PROVIDE A WATER FLOW OF 4" HIGH MIN.

ACCESSIBLE DRINKING FOUNTAIN
NTS

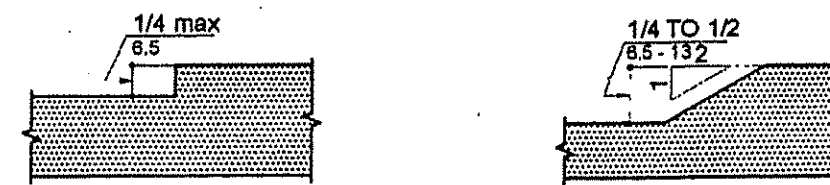


(c)
Changes in Level

(d)
Changes in Level

THRESHOLD ON ACCESSIBLE ROUTE
NO SCALE

FLORIDA ACCESSIBILITY CODE REQUIREMENTS

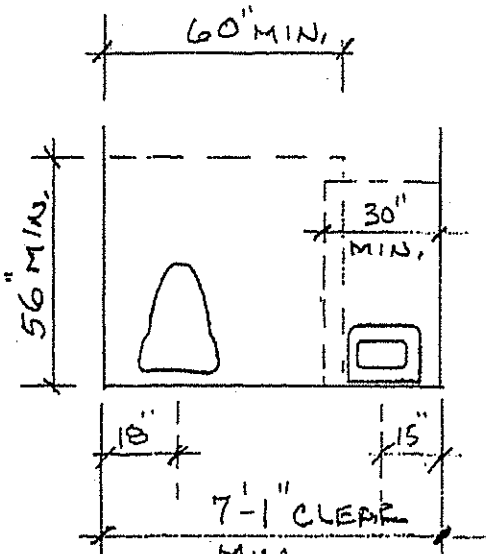

RESTROOM FIXTURE
CLEARANCE DETAIL
1/4"

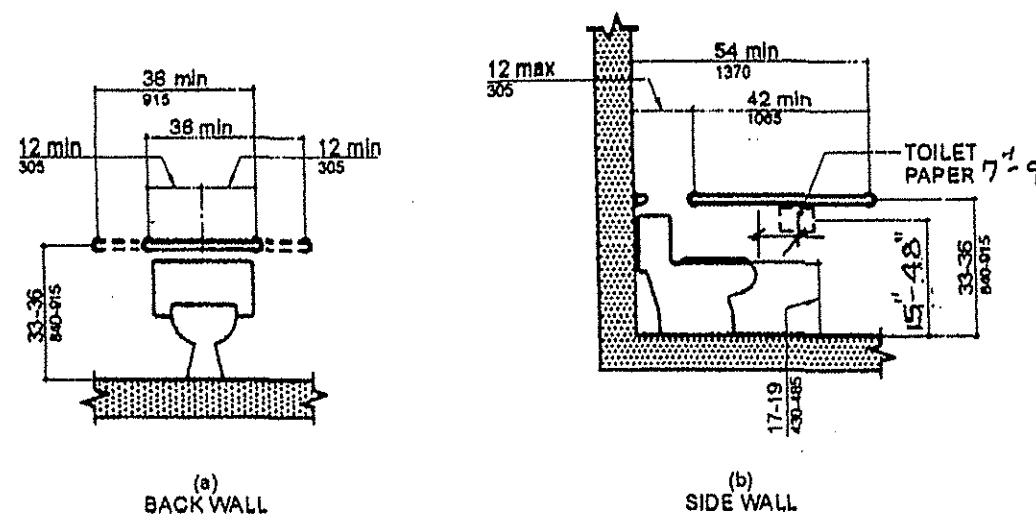



FIGURE 703.5.1
INTERNATIONAL SYMBOL OF ACCESSIBILITY

FIGURE 703.5.2
PICTOGRAM FIELD

TABLE 703.5.5 VISUAL CHARACTER HEIGHT		
HEIGHT TO FINISH FLOOR OR GROUND FROM BASELINE OF CHARACTER	HORIZONTAL VIEWING DISTANCE	MINIMUM CHARACTER HEIGHT
40 inches (1015 mm) or less than or equal to 70 inches (1780 mm)	less than 72 inches (1830 mm)	5/8 inch (16 mm)
Greater than 70 inches (1780 mm) to less than or equal to 120 inches (3050 mm)	72 inches (1830 mm) and greater	5/8 inch (16 mm), plus 1/8 inch (3.2 mm) per foot (305 mm) of viewing distance above 72 inches (1830 mm)
Greater than 120 inches (3050 mm)	less than 180 inches (4570 mm)	2 inches (51 mm)
	180 inches (4570 mm) and greater	2 inches (51 mm), plus 1/8 inch (3.2 mm) per foot (305 mm) of viewing distance above 180 inches (4570 mm)
	less than 21 feet (6400 mm)	3 inches (75 mm)
	21 feet (6400 mm) and greater	3 inches (75 mm), plus 1/8 inch (3.2 mm) per foot (305 mm) of viewing distance above 21 feet (6400 mm)


GRAB BARS AT WATER CLOSETS

- RESTROOM DOORS TO BE EQUIPPED WITH LEVER HANDLE AND PRIVACY LOCK.
- LAVATORY AND SINK CONTROLS TO BE LEVER TYPE.
- SIGNS INDICATING ADA ACCESSIBLE RESTROOM SHALL BE LOCATED ON LATCH SIDE OF DOOR (GO TO CENTER).
- PLUMBING TO BE WRAPPED WITH INSULATION.

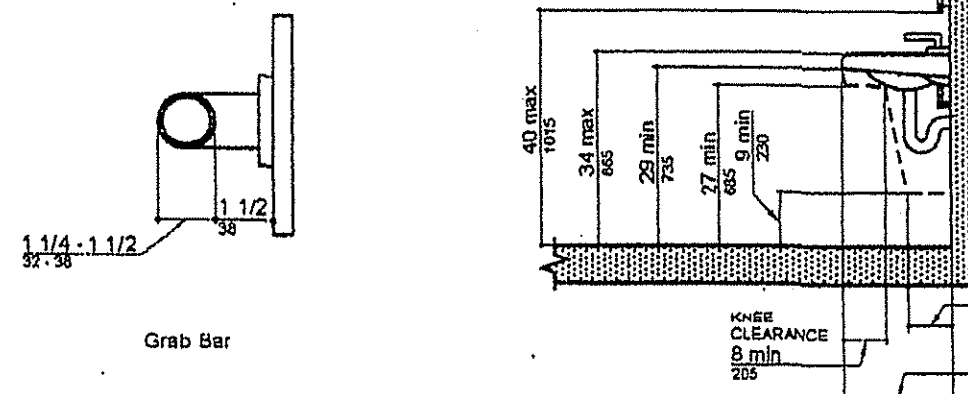


LAVATORY CLEARANCES
NTS


ACCESSIBLE RESTROOM DETAILS

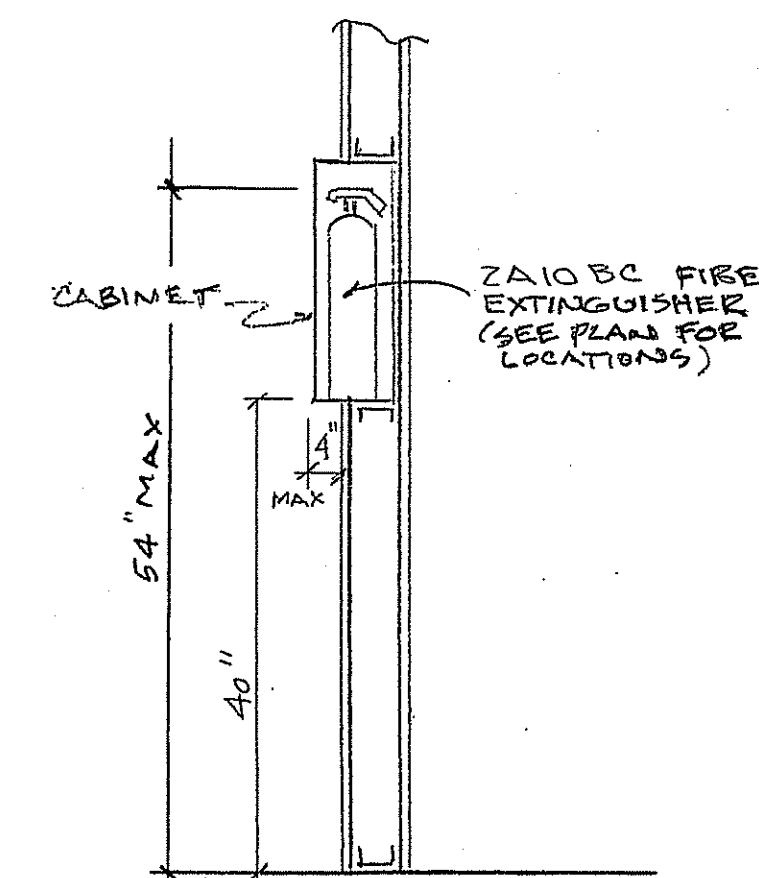

FIRE EXTINGUISHER (FE)
CABINET DETAIL
3/4"

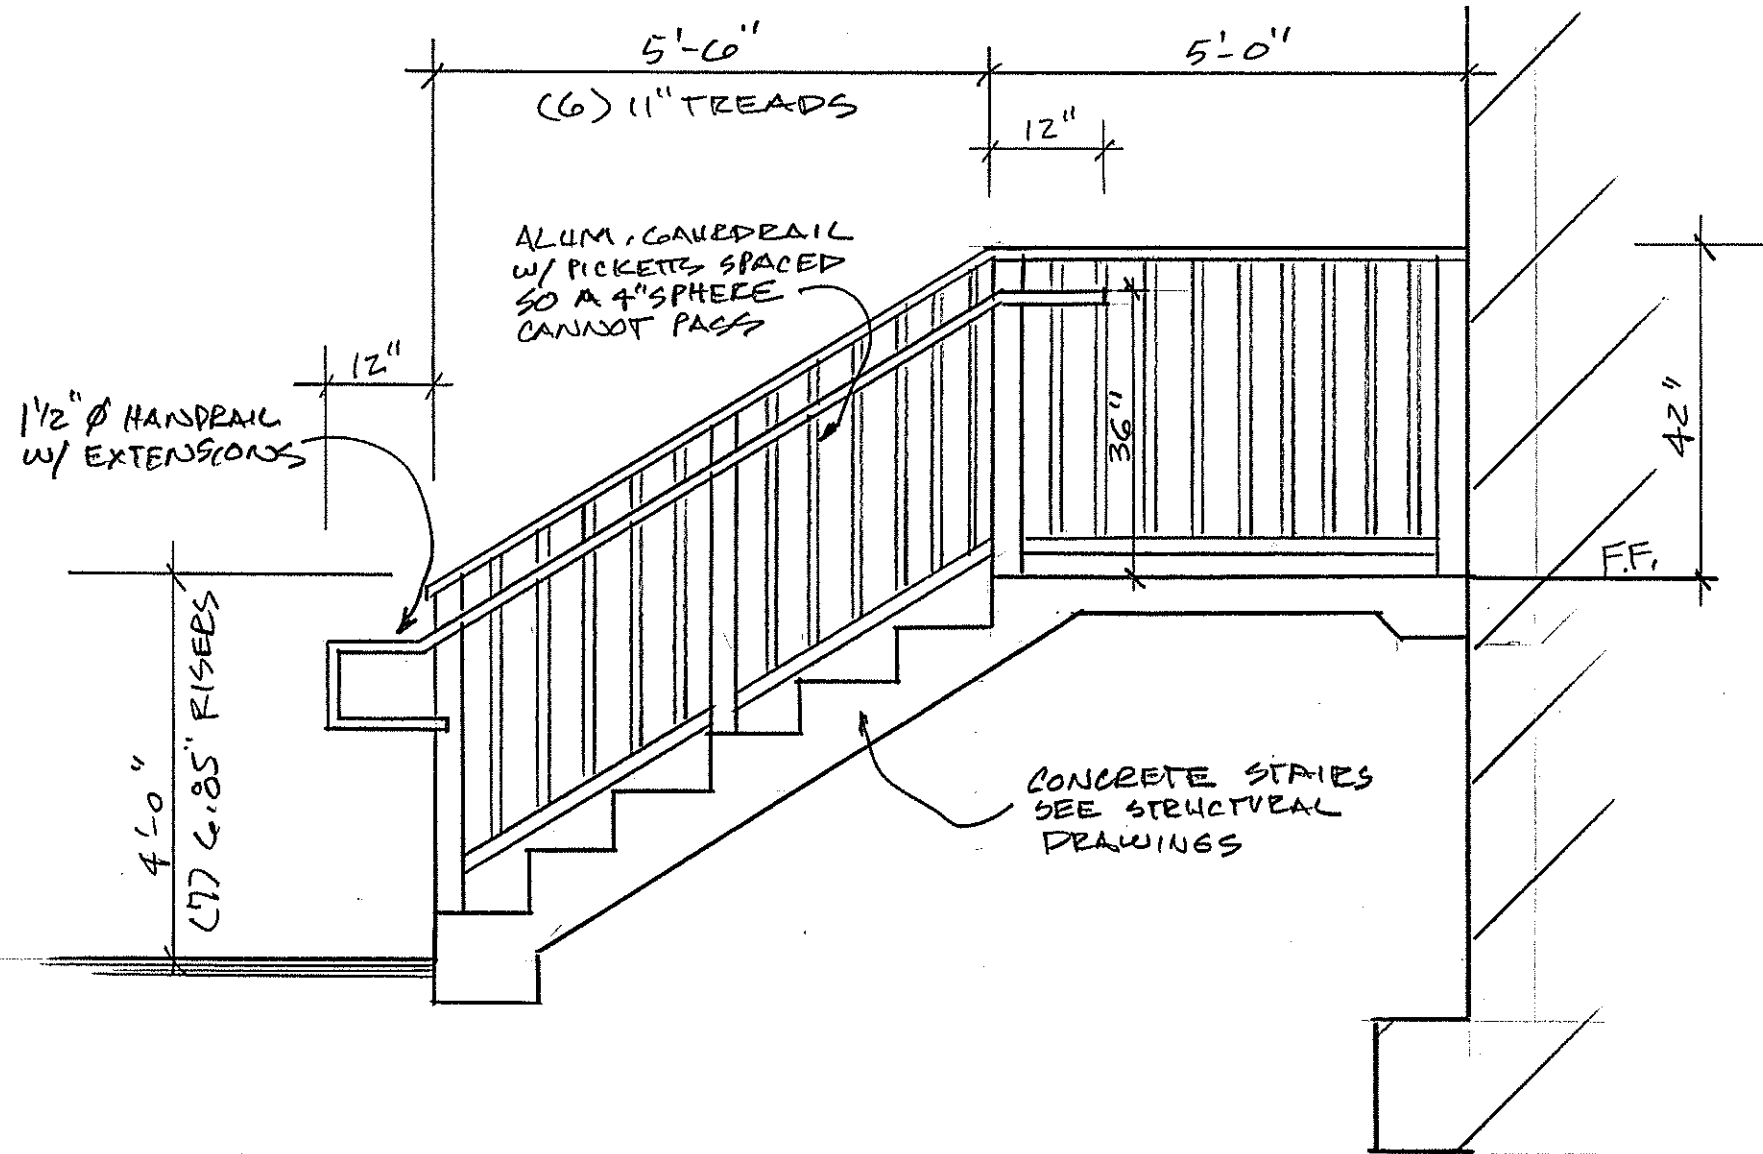

STAIR SECTION
1/2"

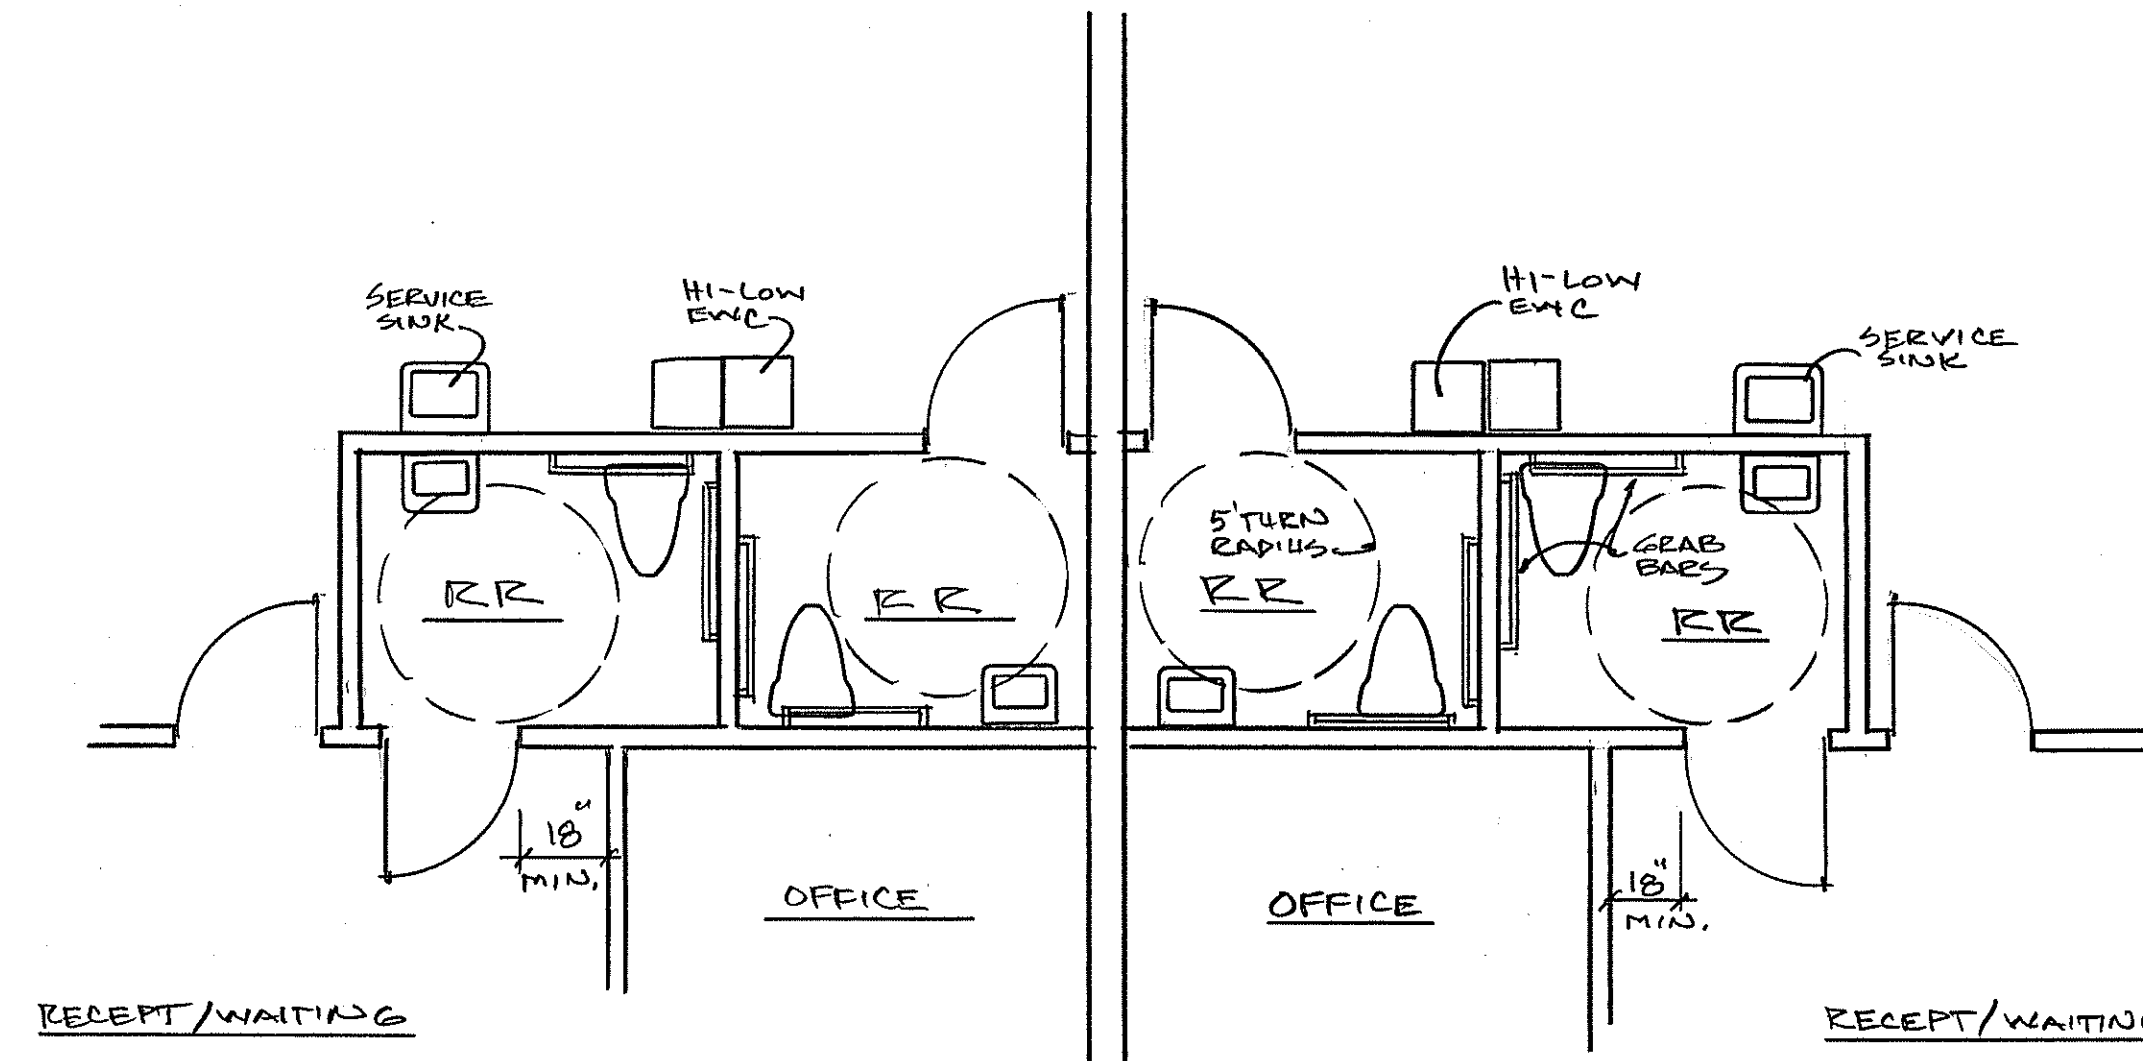

ENLARGED RESTROOM PLAN
1/4"