

1. GENERAL:

- A. APPLICABLE STRUCTURAL CODE: FLORIDA BUILDING CODE - 2023 EDITION, IN CONJUNCTION WITH ASCE 7-22 AND LOCAL AMENDMENTS.
- B. THE STRUCTURAL CONSTRUCTION DOCUMENTS REPRESENT THE FINISHED STRUCTURE. EXCEPT WHERE NOTED, THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE BUT NOT BE LIMITED TO, BRACING, SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT, ETC. THE STRUCTURAL ENGINEER OF RECORD SHALL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S MEANS, METHODS, TECHNIQUES, SEQUENCES FOR PROCEDURE OF CONSTRUCTION, OR THE SAFETY PRECAUTIONS AND PROGRAMS INCIDENT THERETO (NOR SHALL OBSERVATION VISITS TO THE SITE INCLUDE INSPECTION OF THESE ITEMS).
- C. WHERE REFERENCE IS MADE TO VARIOUS TEST STANDARDS FOR MATERIALS, SUCH STANDARDS SHALL BE THE REFERENCED EDITION AND/OR ADDENDA. ANY ENGINEERING DESIGN PROVIDED BY OTHERS AND SUBMITTED FOR REVIEW, SHALL BEAR THE SEAL OF A REGISTERED ENGINEER RECOGNIZED BY THE BUILDING CODE JURISDICTION OF THE PROJECT.
- D. NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL STRUCTURAL NOTES AND TYPICAL DETAILS. WHERE NO DETAILS ARE SHOWN, CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ON THE PROJECT, AND/OR AS PROVIDED FOR IN THE CONTRACT DOCUMENTS. WHERE DISCREPANCIES OCCUR BETWEEN PLANS, DETAILS, GENERAL STRUCTURAL NOTES AND SPECIFICATIONS, THE GREATER REQUIREMENTS SHALL GOVERN.
- E. THE STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH CIVIL, ARCHITECTURAL, MECHANICAL, PLUMBING, FIRE SPRINKLER, AND ELECTRICAL DRAWINGS. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF ALL REQUIREMENTS INTO THE SHOP DRAWINGS AND CONSTRUCTION.
- F. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO FOLLOW ALL APPLICABLE SAFETY CODES AND REGULATIONS DURING ALL PHASES OF CONSTRUCTION.
- G. CONNECTIONS OF ALL ITEMS SUPPORTED BY THE STRUCTURE ARE THE RESPONSIBILITY OF THE DISCIPLINES WHO ARE MAKING THESE ATTACHMENTS. THESE ATTACHMENTS SHALL BE DESIGNED TO RESIST ALL GRAVITY, WIND, WIND UPLIFT, THERMAL LOADS, ETC.
- H. WHERE A DETAIL, TYPICAL DETAIL, SECTION, TYPICAL SECTION OR A NOTE IS SHOWN FOR A CONNECTION, IT SHALL APPLY FOR ALL LIKE OR SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- I. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS & FIELD CONDITIONS. BUILDING DIMENSIONS AND ELEVATIONS, WHERE SHOWN, WERE PROVIDED BY THE ARCHITECT AND IT IS THE CONTRACTOR'S RESPONSIBILITY TO ESTABLISH AND COORDINATE ALL DIMENSIONS PRIOR TO PROCEEDING WITH THE WORK. ANY DISCREPANCIES SHALL BE RESOLVED THROUGH THE ARCHITECT. TOLERANCE AND VERIFY ALL OPENINGS AND INSERTS FOR ARCHITECTURAL, CIVIL, MECHANICAL, PLUMBING AND ELECTRICAL ITEMS WITH THE APPROPRIATE TRADE DRAWINGS AND SUBCONTRACTORS PRIOR TO CONSTRUCTION.
- J. ENGINEER'S REVIEW OF SHOP DRAWINGS, PRODUCT DATA, ETC. DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO OBTAIN APPROVAL FROM THE CONTRACTOR SHALL INFORM THE ENGINEER IN WRITING OF ANY SPECIFIC DEVIATIONS AND OBTAIN ENGINEER'S WRITTEN APPROVAL FOR THE SPECIFIC DEVIATION.
- K. UNLESS NOTED, SUBMIT SHOP DRAWINGS OF ALL FABRICATED MATERIALS FOR REVIEW. DESIGN DRAWINGS SHALL NOT BE REPRODUCED FOR USE AS SHOP DRAWINGS. SHOP DRAWINGS SHALL NOT BE REVIEWED UNLESS THEY WERE CHECKED, BEARING INITIAL OF THE CHECKER AND ARE STAMPED "APPROVED" BY THE GENERAL CONTRACTOR.
- L. ALL REQUIRED TESTING REPORTS SHALL BE AVAILABLE AT THE JOB SITE.
- M. NO SUPPORT PROVISIONS HAVE BEEN MADE FOR EQUIPMENT OVER 300 POUNDS OR PIPES OVER 4" DIAMETER EXCEPT AS SHOWN. UNLESS NOTED, EQUIPMENT SHALL BE SUPPORTED BY TWO (2) BEAMS OR TRUSSES WHERE EACH SUPPORTS HALF OF THE EQUIPMENT WEIGHT. EQUIPMENT SUPPORTS SHALL BE APPROVED BY THE ENGINEER. EQUIPMENT AND PIPES SHALL BE BRACED Laterally BY THE INSTALLER TO RESIST SEISMIC FORCES.
- N. EQUIPMENT WEIGHTS SHOWN ON THE STRUCTURAL DRAWINGS ARE MAXIMUM OPERATING WEIGHTS INCLUDING CURBS AND MISCELLANEOUS ITEMS. THE CONTRACTOR SHALL VERIFY AND BRING TO THE ATTENTION OF THE ENGINEER ANY DEVIATIONS.
- O. WHERE ROOF DRAINS ARE USED FOR ROOF DRAINAGE, AN EMERGENCY DRAINAGE SYSTEM SHALL BE PROVIDED TO MINIMIZE WATER ACCUMULATION (REF ARCHITECTURAL DRAWINGS).
- P. JOHNSTON BURKHOLDER ASSOCIATES, ITS EMPLOYEES, AND REPRESENTATIVES SHALL NOT BE RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION METHODS AND MEANS OF CONSTRUCTION. THE CONTRACTOR SHALL, FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH CONSTRUCTION, NOR WILL THEY BE RESPONSIBLE FOR ANY FAILURE BY THE CONTRACTOR TO PERFORM OR COMPLETE CONSTRUCTION IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. JOBSITE VISITS BY JOHNSTON BURKHOLDER ASSOCIATES SHALL NOT CONSTITUTE APPROVAL, AWARENESS, OR LIABILITY FOR ANY HAZARDOUS CONDITIONS.

- A. DEAD LOADS
 - REF FRAMING PLAN
- B. LIVE LOADS
 - ROOF = 20 PSF
- C. RISK CATEGORY = II
- D. SNOW LOADS
 - 1. GROUND SNOW LOAD = 3 PSF
 - 2. FLAT-ROOF SNOW LOAD = 3 PSF
 - 3. SNOW EXPOSURE FACTOR, $C_e = 1.0$
 - 4. THERMAL FACTOR, $C_t = 1.0$ (MAIN BUILDING)
 - 5. SNOW LOAD IMPORTANCE FACTOR, $I_s = 1.0$
 - 6. ALL APPLICABLE EFFECTS DUE TO SNOW DRIFTING
- E. WIND LOADS
 - 1. CODE MINIMUM ULTIMATE WIND SPEED = 132 MPH
 - 2. WIND LOAD IMPORTANCE FACTOR = 1.0
 - 3. WIND EXPOSURE CATEGORY = C FOR MAIN WIND FORCE-RESISTING SYSTEM
 - 4. WIND EXPOSURE CATEGORY = C FOR COMPONENTS AND CLADDING
- F. SEISMIC LOADS
 - 1. SEISMIC IMPORTANCE FACTOR, $I_s = 1.0$
 - 2. MAPPED SPECTRAL RESPONSE ACCELERATIONS
 - $S_s = 0.090$
 - $S_1 = 0.038$
 - 3. SITE CLASS = E
 - 4. DESIGN SPECTRAL RESPONSE PARAMETERS
 - $S_{ds} = 0.079$
 - $S_{d1} = 0.053$
 - 5. SEISMIC DESIGN CATEGORY = A
 - 6. BASIC SEISMIC-FORCE-RESISTING SYSTEM = LIGHT FRAME WOOD WALLS WITH STRUCTURAL WOOD SHEAR PANELS
 - 7. DESIGN BASE SHEAR, $V = C_s^*W$
 - 8. SEISMIC RESPONSE COEFFICIENT, $C_s = 0.012$
 - 9. RESPONSE MODIFICATION FACTOR, $R = 6.5$
 - 10. ANALYSIS PROCEDURE USED: EQUIVALENT LATERAL FORCE ANALYSIS
- G. RAIN LOADS
 - 1. RAIN INTENSITY, $i = 7.58$ IN./HR
- H. DESIGN LOAD COMBINATIONS (ASD)
 - 1. D
 - 2. $D + (L \text{ OR } 0.75 \text{ OR } R)$
 - 3. $D + (0.6W \text{ OR } 0.7E)$
 - 4. $D + 0.75(L \text{ OR } 0.75 \text{ OR } R) + 0.75(0.6W \text{ OR } 0.7E)$
 - 5. $0.6D + 0.6W$
 - 6. $0.6D + 0.7E$

STRESS INCREASES: INCREASES IN ALLOWABLE STRESSES SPECIFIED IN THE APPROPRIATE MATERIAL CHAPTER OR THE REFERENCED STANDARDS SHALL NOT BE USED WITH THE LOAD COMBINATIONS, EXCEPT THAT A DURATION OF LOAD INCREASE SHALL BE PERMITTED IN ACCORDANCE WITH CHAPTER 23.

- A. THE FOUNDATION HAS BEEN DESIGNED IN ACCORDANCE WITH THE RECOMMENDATIONS MADE IN THE GEOTECHNICAL REPORT PREPARED BY UES PROFESSIONAL SOLUTIONS, LLC. DATED MARCH 13, 2025.
- B. CONTINUOUS FOOTINGS AND SPREAD FOOTINGS SHALL BEAR ON SOIL CAPABLE OF SUSTAINING A NET ALLOWABLE BEARING PRESSURE OF 2500 PSF AT A DEPTH OF 12 INCHES.
- C. MAXIMUM TOTAL FOUNDATION AND SLAB SETTLEMENT 1" AND DIFFERENTIAL SETTLEMENT 1/2" OVER A DISTANCE OF 50 FEET. MINIMUM SUBGRADE MODULUS 100 PCI. PARAMETERS SHALL BE VERIFIED BY A QUALIFIED GEOTECHNICAL ENGINEER. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REPORT ADVERSE CONDITIONS.
- D. CONTRACTOR TO PREPARE SUBGRADE FOR BUILDING PAD AND PAVING AREAS PER GEOTECHNICAL ENGINEER'S RECOMMENDATIONS. THE SITE SHALL BE PREPARED ACCORDING TO AN AGREEMENT WITH THE CITY OF CHICAGO.
- E. WHERE FILL IS REQUIRED IT SHALL BE PLACED IN ACCORDANCE WITH RECOMMENDATIONS AND UNDER THE OBSERVATION OF A QUALIFIED GEOTECHNICAL ENGINEER.
- F. ALL EXCAVATIONS AND BUILDING PADS SHALL BE OBSERVED BY A QUALIFIED GEOTECHNICAL ENGINEER TO VERIFY THE DESIGN CRITERIA AND REPORT ADVERSE CONDITIONS. (GEOTECHNICAL ENGINEER TO BE HIRED AND PAID BY THE OWNER)
- G. EXCAVATION OF EXISTING FOUNDATIONS SHALL BE PROVIDED TO BUILDING OFFICIAL. IN CASE OF CONFLICT BETWEEN THE GEOTECHNICAL REPORT, SPECIFICATIONS AND DRAWINGS, THE MORE STRINGENT REQUIREMENT SHALL APPLY.
- H. FOOTING ELEVATIONS GIVEN ARE FOR PURPOSE OF CONTRACT AND SHALL BE ADJUSTED (LOWERED) AT TIME OF EXCAVATION TO MEET SOIL CONDITIONS. ENGINEER SHOULD BE CONSULTED. REFER TO DETAIL 8-S2.0 FOR FOOTING STEP.
- I. GRANULAR BASE BELOW SLAB-ON-GRADE AND SPREAD FOOTINGS SHALL BE PLACED AND COMPACTED IN ACCORDANCE WITH THE RECOMMENDATIONS AND UNDER THE OBSERVATION OF A QUALIFIED GEOTECHNICAL ENGINEER.
- J. BACKFILL AGAINST WALLS SHALL BE DEPOSITED EVENLY AGAINST BOTH SIDES OF THE WALLS UNTIL THE LOWER GRADE IS REACHED.
- K. THE CONTRACTOR SHALL BRING TO THE ATTENTION OF THE ARCHITECT THE LOCATION OF EXISTING UTILITIES AND PROCEED WITH THE WORK ONLY AFTER WRITTEN APPROVAL FROM THE ARCHITECT.
- L. EXCAVATIONS FOR CONTINUOUS FOOTINGS SHALL BE MADE TRUE TO LINE AND GRADE. THE SIDES OF THE FOOTINGS SHALL BE FORMED, EXCEPT WHERE SOIL CONDITIONS ARE SUCH THAT THE SIDES OF THE EXCAVATION ARE TRUE TO FIRM AND SQUARE. EXCAVATIONS ARE TO BE MADE TO FIRM, CLEAN BEARING SOIL.
- M. EXCAVATIONS FOR FOOTINGS AND FOUNDATIONS, WHICH ARE TO BE SERVED AS FORMS, SHALL BE THOROUGHLY WET PRIOR TO PLACING CONCRETE.

A. CONCRETE SHALL CONFORM WITH ACI BUILDING CODE (ACI-318) AND SHALL HAVE A 28-DAY COMPRESSIVE STRENGTH, AND DENSITY, AND WATER/CEMENT IN ACCORDANCE WITH THE FOLLOWING:

LOCATION	STRENGTH, PSI	DENSITY, PCF	MAX W/C RATIO
INTERIOR SLABS	4000	145	0.52
FOUNDATIONS	3000	145	0.55
ALL OTHER CONCRETE (UNO)	3000	145	0.55

NOTE: DESIGN STRENGTH BASED ON 2,500 PSI CONCRETE

D. UNLESS NOTED, CEMENT SHALL CONFORM TO ASTM C150, TYPE I, II, OR IL. AGGREGATES SHALL BE NORMAL WEIGHT CONFORMING TO ASTM C33. ADMIXTURES CONTAINING CHLORIDES SHALL NOT BE USED.

C. CONCRETE EXPOSED TO WEATHER (I.E., EXPOSED EXTERIOR SLABS, CONCRETE WALLS, RETAINING WALLS, ETC.) SHALL BE AIR-ENTRAINED IN ACCORDANCE WITH ACI 318.

D. UNLESS NOTED, MAXIMUM SLUMP FOR CONCRETE SHALL BE 4 INCHES (PLUS OR MINUS ONE INCH) AT POINT OF PLACEMENT, WHEN APPROVED BY THE ENGINEER OF RECORD, LARGER SLUMP IS PERMITTED WITH THE ADDITION OF HIGH RANGE WATER REDUCING ADMIXTURE.

E. CONCRETE CURING SHALL COMPLY WITH ACI 308. CURING PROCESS SHALL START IMMEDIATELY FOLLOWING INITIAL SET. CONCRETE SHALL BE MAINTAINED IN MOIST CONDITION FOR AT LEAST 7 DAYS AFTER PLACEMENT UNLESS PROVISIONS OF ACI-318 ARE FOLLOWED.

F. HOT WEATHER CONCRETING: SPECIAL PRECAUTIONS RECOMMENDED BY ACI 305 SHALL BE TAKEN WHEN THE AMBIENT TEMPERATURE IS ABOVE 80 DEGREES FAHRENHEIT OR WHEN THE MAXIMUM RATE OF EVAPORATION IN THE CONCRETE EXCEEDS 0.2 LB/SQ-FH. THIS RATE IS AFFECTED BY AIR TEMPERATURE, RELATIVE HUMIDITY, CONCRETE TEMPERATURE AND WIND VELOCITY. AFTER FINISHING CONCRETE, USE LIGHT FOG SPRAY UNTIL CURING COMPOUND IS USED, OR WET CURING METHOD IS IMPLEMENTED.

G. COLD WEATHER CONCRETING: WHEN, FOR MORE THAN THREE (3) CONSECUTIVE DAYS, THE DAILY TEMPERATURE DOES NOT REMAIN ABOVE 40 DEGREES FAHRENHEIT, SPECIAL MATERIALS AND PROCEDURES SHALL BE PROVIDED DURING PLACING AND CURING OF CONCRETE PER ACI 306.

A. REINFORCING STEEL SHALL CONFORM TO ASTM A-615, GRADE 60 (U.N.) AND GRADE 40 FOR #3 AND SMALLER BARS. GRADE 60 REINFORCING MAY NOT BE RE-BENT OR GRADE 40 BENT WITHOUT APPROVAL OF THE STRUCTURAL ENGINEER.

B. REINFORCING THAT IS WELDED SHALL BE WELDABLE TYPE. ASTM A-706.

C. NO TACK WELDING OF REINFORCING IN THE FIELD WILL BE PERMITTED.

D. ALL DETAILING, FABRICATION AND PLACING OR REINFORCING BARS, UNLESS OTHERWISE NOTED, SHALL CONFORM TO ACI 318, "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" AND THE LATEST ACI "MANUAL OF STANDARD PRACTICE FOR DETAIL REINFORCED CONCRETE STRUCTURES".

E. MINIMUM LAP SPlice AND TENSION DEVELOPMENT DIMENSION TABLE BASED ON 3000 PSI NORMAL WEIGHT CONCRETE, $F_y = 60$ KSI, NON-COATED BARS, LAP CLASS B, WITH 3" MIN. CLR.

BAR	TOP BAR SPlice	DEVELOPMENT	BAR	OTHER BAR SPlice	DEVELOPMENT
#3	21"	16"	#3	16"	12"
#4	23"	18"	#4	18"	14"
#5	28"	22"	#5	22"	17"
#6	34"	26"	#6	26"	20"

WHEN LAPPING TWO DIFFERENT SIZE BARS, USE THE LAP DIMENSION OF THE SMALLER BAR OR THE ANCHORAGE DIMENSION OF THE LARGER BAR. USE WHICHEVER DIMENSION IS LARGER.

F. MINIMUM CONCRETE COVER FOR REINFORCING CONCRETE REINFORCING SHALL BE PLACED PER THE TOLERANCES OF ACI 117 AND ACI 308.

LOCATION	MINIMUM COVER
FOOTINGS, GRADE BEAMS AND SLABS	
CAST AGAINST & PERMANENTLY EXPOSED TO EARTH	3"
SLABS ON GRADE	MID-DEPTH
INTERIOR SLABS AND STAIRS	1"
EXTERIOR SLABS AND STAIRS #5 AND SMALLER	1 1/2"
EXTERIOR SLABS AND STAIRS #6 AND LARGER	2"
WALLS INTERIOR FACE	1"
WALLS INTERIOR FACE #5 AND SMALLER	1 1/2"
WALLS INTERIOR FACE #6 AND LARGER	2"

*VERIFY W/ ENVIRONMENTAL CONDITIONS PER ACI 318, CHAPTER 19.

- A. MAXIMUM SLUMP WITHOUT A PLASTICIZER AT POINT OF PLACEMENT SHALL BE 5 INCHES. MIX DESIGNS SHALL TAKE CARE TO PROVIDE THE LARGEST POSSIBLE SIZE OF COARSE AGGREGATE WHILE MAINTAINING CONCRETE WORKABILITY. NOMINAL MAXIMUM AGGREGATE SIZE SHALL NOT BE LESS THAN 3/4 INCH NOR MORE THAN 1/3 THE MINIMUM THICKNESS OF THE SLAB.
- B. FOR INTERIOR SLABS ON GRADE, PROVIDE CONCRETE WITH AN ULTIMATE SHRINKAGE LESS THAN 0.05% AT 28 DAYS. LABORATORY TEST RESULTS SHALL BE SUBMITTED INDICATING THAT THE CONCRETE SLAB ON GRADE MIX DESIGN (OR COMPARABLE) MEETS THE ULTIMATE SHRINKAGE REQUIREMENTS. SHRINKAGE VALUES FOR CONCRETE SPECIES SHALL BE TAKEN FROM ACI 208.1 AND THE PROCEDURES IN ACI 208R TO PREDICT THE ULTIMATE DRYING SHRINKAGE.
- C. CONCRETE SHALL BE MIXED, PLACED, FINISHED AND CURED PER REFERENCED EDITION OF ACI 302.1 FOR THE APPROPRIATE FLOOR CLASS TYPE. CURING COMPOUND SHALL BE COMPATIBLE WITH ARCHITECTURAL FLOOR FINISH. SLABS SHALL BE PLACED ON A FLAT, SMOOTH, FIRM, COMPACTED SUBGRADE.
- D. FOR SUBGRADE AND SUBBASE PREPARATION, SEE GEOTECHNICAL REPORT AND SPECIFICATIONS.
- E. IMMEDIATELY PRIOR TO POURING EACH SLAB, A QUALIFIED GEOTECHNICAL ENGINEER (TO BE PAID BY OWNER) SHALL INSPECT THE PAD AND PROVIDE A CERTIFICATE STATING THAT THE PAD MEETS THE PROJECT DESIGN REQUIREMENTS. IF WEATHER CONDITIONS CHANGE, RE-CERTIFICATION WILL BE REQUIRED.
- F. SLAB-ON-GRADE REINFORCING SHALL BE SUPPORTED ON CHAIRS AT MID-DEPTH OF SLAB WITH SAND PLATES OR PRECAST CONCRETE SUPPORTS (PRECAST CONCRETE SUPPORTS SHALL BE 4" X 4" X 4" MINIMUM STRENGTH AND MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI) OF SUFFICIENT HEIGHT TO INSURE THAT REINFORCING IS AT THE PROPER HEIGHT WITH MAXIMUM SPACING OF 3'-0" EACH WAY. FOR WELDED WIRE FABRIC, PLACEMENT OF REINFORCING USING THE PULL-UP METHOD IS NOT PERMITTED.
- G. VAPOR BARRIER, IF NOT SPECIFIED BY ARCHITECTURAL, SPECIFICATION OR SOILS REPORT, SHALL CONSIST OF A MINIMUM 15 MILS ASTM D-745 CLASS A MATERIAL LAPPED A MINIMUM OF 6" AND TAPED PER MANUFACTURER RECOMMENDATIONS. THE BARRIER SHALL BE PLACED ON TOP OF COMPACTED AGGREGATE BASE COURSE. THE FLOOR SLAB SHALL BE PLACED ON TOP OF THE VAPOR BARRIER. ANY DAMAGE TO VAPOR BARRIER SHALL BE REPAIRED PRIOR TO SLAB PLACEMENT. CARE SHALL BE TAKEN TO KEEP MOISTURE AWAY FROM THE COMPACTED SUBGRADE. SUBGRADE MUST BE ALLOWED TO DRY AFTER RAINS PRIOR TO SLAB PLACEMENT. FLOOD CURING IS NOT ALLOWED. SAND IS NOT AN ALTERNATIVE FOR THE SUB-BASE COURSE.
- H. UNLESS NOTED, FLOOR CONTRACTION JOINTS FOR SLAB-ON-GRADE SHALL BE SPACED EQUAL TO CONTRACTION JOINTS SPACING SHALL BE REDUCED AT HOT AND/OR DRY CLIMATE. SAW CUT SLABS 18" WIDE X 18" THICKNESS (MIN.) AS SHOWN ON THE SUBGRADE. IF FLOOR JOINT IS FIRM ENOUGH THAT IT WILL NOT BE DAMAGED BY THE BLADE, JOINT FILLER SHALL BE PLACED IN CLEAN JOINTS, OVERFILLED AND SHAVED FLUSH. THE OPTIMUM TIME TO CUT THE SLAB WILL BE THE CONTRACTOR'S RESPONSIBILITY. SLABS WITH CRACKS AND/OR SLAB WHICH EXHIBIT "SLAB CURLING" WILL NOT BE ACCEPTED. SLAB PLACEMENT SHALL BE AT OPTION OF THE OWNER AT CONTRACTOR'S EXPENSE.
- I. REF ARCHITECTURAL AND CIVIL DRAWINGS FOR SIDEWALKS, EXTERIOR SLABS, INTERIOR SLABS, SLAB DEPRESSIONS, AND ELEVATIONS. REF 5-S2.0 FOR TYPICAL REINFORCEMENT AT SLAB OPENING.
- J. SLAB-ON-GRADE AT CORNERS OF OPENINGS, CUT OUTS AND PENETRATIONS SHALL BE REINFORCED WITH 2-#4 (3'-0" LONG).
- K. AT SLAB-ON-GRADE, SEAL COLUMN BOX-OUTS, CONSTRUCTION JOINTS AND CONTRACTION JOINTS TO PREVENT WATER PENETRATION UNDER SLAB DURING & AFTER CONSTRUCTION TO PREVENT SOILS FROM EXPANDING.
- L. PIPES, DUCTS, CONDUTS, ETC. SHALL NOT BE PLACED IN SLABS UNLESS APPROVED BY THE STRUCTURAL ENGINEER. (PLACE A MINIMUM 4" BELOW SLAB).
- M. THE GENERAL CONTRACTOR, INCLUDING SUB CONTRACTORS AND SUPPLIERS SHALL NOT DRIVE OR PARK HEAVY EQUIPMENT ON THE CONCRETE SLAB. ANY DAMAGE TO SLAB DUE TO HEAVY EQUIPMENT SHALL BE REPLACED AT CONTRACTOR'S EXPENSE.
- N. COMBUSTION HEATERS SHALL NOT BE USED DURING CONCRETE PLACEMENT UNLESS PRECAUTIONS ARE TAKEN TO PREVENT EXPOSURE OF THE CONCRETE TO EXHAUST GASES.
- O. REF ARCH SPECIFICATIONS FOR ALL FLOOR SLAB FINISHES.
- P. PROVIDE NEW TROWEL BLADES FOR CONCRETE FINISHING OF FLOOR SLABS.

- A. UNLESS NOTED, ALL ANCHORS IN CONCRETE SHALL BE CARBON STEEL HILTI KWIK HUS-EZ SCREW ANCHORS PER ICC ESR-3027 OR APPROVED ICC EQUIVALENT.
- B. WHERE NOTED ON THE DRAWINGS OR OTHERWISE, ANCHORS SHALL BE HILTI HIT HY-100 TITANIUM ROD OR EQUIVALENT ANCHORING SYSTEM (ICC ESR-3574) OR APPROVED ICC EQUIVALENT. UNLESS NOTED, ANCHOR EMBEDMENT SHALL BE AS FOLLOWS: 3/8" DIA. - 3'-3 3/8", 1/2" DIA. - 4'-1/2", 5/8" DIA. - 5'-5/8", 3/4" DIA. - 6'-3/4".
- C. UNLESS NOTED, ANCHOR SPACING (AS) AND ANCHOR EDGE DISTANCE (ED) SHALL BE AS PUBLISHED BY THE MOST CURRENT APPROVED HILTI REPORT IN ORDER TO DEVELOP MAXIMUM WORKING LOAD.
- D. ALL ANCHORS SHALL BE INSTALLED AS PER MANUFACTURER'S INSTRUCTIONS AND UNDER MANUFACTURER'S SUPERVISION IN ORDER TO DEVELOP THE PUBLISHED WORKING LOADS.
- E. MINIMUM CONCRETE COMPRESSIVE STRENGTH REQUIRED AT TIME OF INSTALLATION OF ANY ANCHORS SHALL BE 2500 PSI.

8. WOOD FRAMING:

- A. ALL NAILING NOT NOTED SHALL BE PER TYPICAL DETAIL AND COMMON NAIL DIAMETER TABLE BELOW. ALL BOLTING SHALL BE PER STRUCTURAL STEEL SECTION ABOVE.
- B. CONNECTORS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY, INC. OR OTHER MANUFACTURER WITH CURRENT AND EQUIVALENT ICC APPROVAL WHERE "TYPE" OF CONNECTOR IS INDICATED ON THE DRAWINGS. THE CONNECTOR TYPE SHALL BE PER THE MAXIMUM MODEL NUMBER BASED ON THE SIZE OF THE MEMBERS CONNECTED.
- B. WOOD FRAMING MEMBERS SHALL NOT BE NOTCHED OR DRILLED WITHOUT PRIOR APPROVAL OF THE STRUCTURAL ENGINEER THROUGH THE ARCHITECT.

8d	0.131	10 1/4	2 1/2	16d	0.162	8	3 1/2
10d	0.148"	9	3"	20d	0.192"	6	4"

D. PRESERVATIVE-TREATED WOOD:

1. ALL SILL PLATES IN CONTACT WITH CONCRETE SHALL BE PRESERVATIVE-TREATED

PRESERVATIVE-TREATED WOOD.

2. ALL WOOD FRAMING MEMBERS, INCLUDING WOOD SHEATHING THAT ARE IN CONTACT WITH EXTERIOR WALLS AND ARE LESS THAN 8 INCHES FROM FINISHED GRADE SHALL BE PRESERVATIVE-TREATED WOOD.

3. ALL FASTENERS INCLUDING NUTS AND WASHERS IN CONTACT WITH PRESERVATIVE-TREATED WOOD SHALL BE HOT-DIPPED ZINC-COATED GALVANIZED STEEL OR STAINLESS STEEL. THE COATING WEIGHTS FOR ZINC-COATED FASTENERS SHALL BE PER ASTM A153. FASTENERS OTHER THAN NAILS, WOOD SCREWS AND LAG SCREWS ARE PERMITTED TO BE OF MECHANICALLY DEPOSITED ZINC-COATED STEEL WITH COATING WEIGHTS PER ASTM B695, CLASS 55 MINIMUM.

4. ALL FASTENERS INCLUDING NUTS AND WASHERS IN CONTACT WITH PRESERVATIVE-TREATED WOOD SHALL BE HOT-DIPPED ZINC-COATED GALVANIZED STEEL OR STAINLESS STEEL. THE COATING WEIGHTS FOR ZINC-COATED FASTENERS SHALL BE PER ASTM A153. FASTENERS OTHER THAN NAILS, WOOD SCREWS AND LAG SCREWS ARE PERMITTED TO BE OF MECHANICALLY DEPOSITED ZINC-COATED STEEL WITH COATING WEIGHTS PER ASTM B695, CLASS 55 MINIMUM.

1. EXTERIOR WALL STUDS: DOUGLAS FIR-LARCH (DF-L) No. 2 OR BETTER, OR SOUTHERN PINE No. 2 OR BETTER.
2. HEADERS: DOUGLAS FIR-LARCH (DF-L) No. 2 OR BETTER, OR SOUTHERN PINE No. 2 OR BETTER.
3. BEARING PLATES AND TOP PLATES: DOUGLAS FIR-LARCH (DF-L) No. 2 OR BETTER, OR SOUTHERN PINE No. 2 OR BETTER.

A. FRAMING MEMBERS SHALL BE DESIGNED TO SUPPORT SELF WEIGHT PLUS LIVE LOAD AND SUPERIMPOSED DEAD LOADS STATED IN THE GENERAL STRUCTURAL NOTES OR AS LOCATED ON PLANS. BRIDGING SIZE AND SPACING BY FABRICATOR UNLESS NOTED OTHERWISE. ALL COLUMNS SHALL HAVE CURRENT ICC APPROVAL. FRAMING MEMBERS SHALL BE AGENCY STAMPED AND CONFORM TO THE REFERENCED BUILDING CODE AND ANSHP/1 "NATIONAL DESIGN STANDARD FOR METAL CONNECTED WOOD TRUSS CONSTRUCTION." CONTRACTOR SHALL SUBMIT SHOP DRAWINGS, ERECTION DETAILS AND CONNECTIONS TO THE STATE DEPARTMENT OF CONSTRUCTION FOR THE PROJECT LOCATION STATE FOR REVIEW AND APPROVAL PRIOR TO FABRICATION. SAID SUBMITTAL, IN ADDITION TO LOADS SPECIFIED IN THE G.S.N. AND PLANS, SHALL INCLUDE, BUT NOT BE LIMITED TO, THE FOLLOWING:

- 1. DEFLECTION/CAMBER: ROOFS WITHOUT PLASTER OR GYPSBOARD CEILINGS TOTAL LOAD MAXIMUM = $U/180$. LIVE LOAD MAXIMUM = $U/240$. ROOFS WITH PLASTER OR GYPSBOARD CEILINGS TOTAL LOAD MAXIMUM = $U/240$. LIVE LOAD MAXIMUM = $U/360$. FABRICATOR SHALL DESIGN ROOF MEMBERS FOR PONDING WHERE ROOF SLOPES ARE LESS THAN $1/4"$ PER FOOT. FRAMING MEMBERS SHALL BE CAMBERED FOR 1.0 TIMES THE DEAD LOAD DEFLECTION. MAXIMUM TOTAL LOAD DEFLECTION OF MEMBERS SHALL BE $1/16"$. FABRICATOR SHALL DESIGN ADJACENT MEMBERS FOR MAXIMUM OF $1/4"$ DIFFERENTIAL DEFLECTION.
- 2. TOP CHORD MEMBER WOOD SPECIES SHALL HAVE A SPECIFIC GRAVITY OF 0.42 OR GREATER.

B. VERIFY SIZE, WEIGHT AND LOCATION OF SUPPORTED EQUIPMENT WITH ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, SPRINKLER AND THEIR SHOP DRAWINGS. ADDITIONAL FRAMING MEMBERS SHALL BE SUPPLIED AS REQUIRED TO SUPPORT EQUIPMENT.

C. FABRICATOR SHALL HAVE ICC APPROVAL OR BE APPROVED ACCORDING TO THE BUILDING JURISDICTION.

A. SPECIAL INSPECTOR (SI) SHALL BE RETAINED AND PAID BY THE OWNER AND PROVIDE INSPECTIONS DURING CONSTRUCTION ON THE TYPES OF WORK LISTED AS PER TABLE ONE.

B. THE SPECIAL INSPECTOR SHALL BE A QUALIFIED PERSON WHO SHALL DEMONSTRATE COMPETENCE, TO THE SATISFACTION OF THE BUILDING OFFICIAL, FOR INSPECTION OF THE PARTICULAR TYPE OF CONSTRUCTION OR OPERATION REQUIRING SPECIAL INSPECTION.

C. THE DUTIES OF THE SPECIAL INSPECTOR SHALL INCLUDE, BUT ARE NOT LIMITED TO, VERIFICATION OF CONSTRUCTION QUALITY CONTROL, TESTING, COMPLIANCE WITH THE CONSTRUCTION DOCUMENTS, BUILDING CODE REQUIREMENTS, AND LOCAL BUILDING DEPARTMENT REQUIREMENTS.

D. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE PROPER NOTIFICATION TO THE SPECIAL INSPECTOR AND PROCEED WITH THE CONSTRUCTION ONLY AFTER THE SPECIAL INSPECTOR'S APPROVAL.

E. DUTIES AND RESPONSIBILITIES OF THE SPECIAL INSPECTOR:

1. THE SPECIAL INSPECTOR SHALL OBSERVE THE WORK ASSIGNED FOR CONFORMANCE WITH THE APPROVED DESIGN DRAWINGS AND SPECIFICATIONS. THE INSPECTOR MAY NOT ALTER, MODIFY, ENLARGE OR WAIVE ANY OF THE REQUIREMENTS OF THE DOCUMENTS.
2. SPECIAL INSPECTORS SHALL KEEP RECORDS OF INSPECTIONS. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE CONSTRUCTION OFFICIAL, AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE, THE CONTRACTOR AND THE OWNER. REPORTS SHALL INDICATE THAT WORK INSPECTED WAS DONE IN CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL, CONTRACTOR AND THE OWNER FOR CORRECTION, IF THE DISCREPANCIES ARE NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE AND THE OWNER PRIOR TO THE COMPLETION OF THAT PHASE OF THE WORK.
3. A FINAL REPORT OF INSPECTIONS DOCUMENTING REQUIRED SPECIAL INSPECTIONS AND ANY CORRECTION OF ANY DISCREPANCIES NOTED IN THE INSPECTIONS SHALL BE SUBMITTED PERIODICALLY TO THE BUILDING OFFICIAL AND TO THE REGISTERED DESIGN PROFESSIONAL AND THE BUILDING OFFICIAL PRIOR TO THE START OF WORK, WHERE SPECIAL INSPECTION REQUIREMENTS DUPLICATE THE REQUIREMENTS OF SPECIFIED QUALITY ASSURANCE TESTING, DUPLICATE INSPECTIONS SHALL NOT BE REQUIRED.

A. CONTRACTOR SHALL NOTIFY ARCHITECT FIVE (5) WORKING DAYS PRIOR TO THE FOLLOWING CONSTRUCTION MILESTONES:

1. SPREAD FOOTING FOUNDATIONS: AFTER FOUNDATION REINFORCING IS PLACED AND BEFORE PLACING CONCRETE AT THE FOUNDATIONS.
2. WOOD WALL CONSTRUCTION: AFTER WALL STUDS ARE ERECTED AND BEFORE INTERIOR SHEATHING IS PLACED.
3. ROOF STRUCTURE: AFTER STRUCTURE IS ERECTED AND BEFORE INSULATION AND CEILING INSULATION IS INSTALLED. CONTRACTOR SHALL ARRANGE A PRE-ROOFING MEETING BEFORE ANY ROOFING WORK IS STARTED.
4. PUNCH LIST: AFTER ALL STRUCTURAL ITEMS ARE COMPLETE.

B. FAILURE TO NOTIFY ARCHITECT OF ANY CONSTRUCTION MILESTONE MAY RESULT IN CONTRACTOR HAVING TO REMOVE WORK FOR THE PURPOSE OF REVIEW AT CONTRACTOR'S EXPENSE.

C. PREMATURE NOTIFICATION FOR SITE VISIT WILL RESULT IN AN ADDITIONAL SITE VISIT WITH ALL EXPENSES AND FEES PAID BY THE CONTRACTOR.

- A. THE STRUCTURAL INSULATED PANEL (SIPS) SUPPLIER SHALL BE CERTIFIED BY THE STRUCTURAL INSULATED PANEL ASSOCIATION (SIPA) PRIOR TO THE START OF PRODUCTION OF PANELS AND SHALL HAVE A MINIMUM OF TWO YEARS OF EXPERIENCE PRODUCING PANELS.
- B. SIPS PANELS SHALL COMPLY WITH THE PERFORMANCE AND DESIGN CRITERIA IN THE CONTRACT DOCUMENTS. SIPS SUPPLIER SHALL ENGAGE A QUALIFIED PROFESSIONAL ENGINEER LICENSED IN THE STATE IN WHICH THE PROJECT IS LOCATED TO DESIGN ALL STRUCTURAL AND NON-STRUCTURAL SIPS PANELS SHALL WITHSTAND THE EFFECTS OF ALL DESIGN LOADS WITHOUT EXCEEDING THE ALLOWABLE WORKING STRESSES. SIP PANEL DEFLECTIONS SHALL BE LIMITED TO A MAXIMUM DEFLECTION OF L/240 OF THE SPAN.
- C. THE SIPS SUPPLIER SHALL PRODUCE A COMPLETE SET OF SEALED SHOP DRAWINGS AND A CALCULATION REPORT REVIEW BY THE EOR. THE SHOP DRAWINGS SHALL INCLUDE ALL INFORMATION REQUIRED TO PROPERLY INSTALL THE PANELS, AND ANY DETAILS AND ALL DESIGN LOADINGS REQUIRED FOR INTERFACING WITH THE BUILDING FOUNDATION AND SLAB SYSTEM.
- D. THE PANELS SHALL BE BRACED DURING INSTALLATION. BRACING TO BE DESIGNED BY THE SIPS SUPPLIER AND SHALL REVIEW THE INSTALLATION PROCEDURES WITH THE GENERAL CONTRACTOR TO ENSURE PROPER INSTALLATION.
- E. SIP PANEL MANUFACTURER SHALL BE APPROVED TO PERFORM WORK WITHOUT SPECIAL INSPECTION. AT COMPLETION OF FABRICATION, THE APPROVED FABRICATOR SHALL SUBMIT A CERTIFICATE OF COMPLIANCE TO THE OWNER OR THE OWNER'S AUTHORIZED AGENT FOR SUBMITTAL TO THE BUILDING OFFICIAL, STATING THAT THE WORK WAS PERFORMED IN ACCORDANCE WITH THE APPROVED CONSTRUCTION DOCUMENTS.

20365 Exchange Street, Suite 220
Ashburn, VA 20147
703.668.0086
rdcollaborative.com

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional

A circular professional engineer seal for Benjamin Bryan Bailey. The outer ring contains the text "BENJAMIN BRYAN BAILEY" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. Inside the ring, the word "LICENSE" is at the top, "No. 83408" is in the center, and "STATE OF FLORIDA" is at the bottom, also separated by two stars.

[illegible]

930 CENTRAL • KANSAS CITY, MO 64105
816.421.4200 • WWW.JBAENGR.COM
JBA NO. 26007

ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

BBB
PROJECT MANAGER
KSH
QUALITY CONTROL
BWM
DRAWN BY
JBA

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROJECT NUMBER: 25172

PROJECT NUMBER: 25172

GENERAL NOTES

GENERAL NOTES

S0.1

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY BENJAMIN BRYAN BAILEY, P.E. ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

ABBREVIATIONS

- AB

ACI

AFF

AISC

AISI

ARCH

ASTM

AWS

BFF

BL

BM

BO

BOS

BRG

CJ

CL

CLR

CMU

COL

CONC

CONC

COND

CONST

CONT

DBA

DIA

DIA

EF

EFS

EJ

EL

ELEC

EQ

EW

FDN

FF

FS

FTG

FV

GA

GC

GYP

H

HORIZ

HSA

HSS

INFO

ISO

JBE

JST

JT

KSI

L

LB

LLH

LLV

LONG

MAX

MECH

MFR

MIN

MISC

MO

MTL

NIC

NO

NS

NTS

OC

OD

OFOP

OH

OSL

PAF

PC

PCF

PL

PLUMB

PMEJ

PSF

QTY

RCU

REF

REINF

REQD

REV

RLL

RO

ROT

RTU

SCHED

SDI

SIM

SIP

SJI

SPCS

SPECS

STRUC

T&B

THK

TL

TO

TOC

TOF

TOGB

TOS

TOW

TRANS

TYP

UNO

VERT

W

WP

WWR
- ANCHOR BOLT

AMERICAN CONCRETE INSTITUTE

ABOVE FINISHED FLOOR

AMERICAN INSTITUTE OF STEEL CONSTRUCTION

AMERICAN IRON AND STEEL INSTITUTE

ARCHITECTURAL

AMERICAN SOCIETY FOR TESTING AND MATERIALS

AMERICAN WELDING SOCIETY

BELOW FINISHED FLOOR

BLOCK LINTEL

BEAM

BOTTOM OF

BOTTOM OF STEEL

BEARING

CONTRACTION JOINT

CENTER LINE

CLEAR

CONCRETE MASONRY UNIT

COLUMN

CONCRETE

CONDENSER UNIT

CONSTRUCTION

CONTINUOUS

DEFORMED BAR ANCHOR

DIAMETER

DIAMETER

EXHAUST FAN

EXTERIOR INSULATION AND FINISH SYSTEM

EXPANSION JOINT

ELEVATION

ELECTRICAL

EQUAL

EACH WAY

FOUNDATION

FINISHED FLOOR

FAR SIDE

FOOTING

FIELD VERIFY

GAUGE

GENERAL CONTRACTOR

GYPSUM BOARD

HEIGHT

HORIZONTAL

HEADED STUD ANCHOR

HOLLOW STRUCTURAL SHAPE

INFORMATION

ISOLATION

JOIST BEARING ELEVATION

JOIST

JOINT

KIPS PER SQUARE INCH

LENGTH

POUNDS

LONG LEG HORIZONTAL

LONG LEG VERTICAL

LONGITUDINAL

MAXIMUM

MECHANICAL

MANUFACTURER

MINIMUM

MISCELLANEOUS

MASONRY OPENING

METAL

NOT IN CONTRACT

NUMBER

NEAR SIDE

NOT TO SCALE

ON CENTER

OUTSIDE DIAMETER

OUTSIDE FACE OF PANEL

OPPOSITE HAND

OUTSTANDING LEG

POWER ACTUATED FASTENER

PRECAST

POUNDS PER CUBIC FOOT

PLATE

POUNDS PER LINEAR FOOT

PLUMBING

PREMOLDED EXPANSION JOINT

POUNDS PER SQUARE FOOT

POUNDS PER SQUARE INCH

QUANTITY

REFRIGERATION CONDENSING UNIT

REFER TO

REINFORCING

REQUIRED

REVERSE

ROOF LIVE LOAD

ROUGH OPENING

ROTATE

ROOF TOP UNIT

SCHEDULE

STEEL DECK INSTITUTE

SIMILAR

STRUCTURAL INSULATED PANEL

STEEL JOIST INSTITUTE

SPACES

SPECIFICATIONS

STRUCTURAL

TOP AND BOTTOM

THICKNESS

TOTAL LOAD

TOP OF

TOP OF CONCRETE

TOP OF FOOTING

TOP OF GRADE BEAM

TOP OF STEEL

TOP OF WALL

TRANSVERSE

TYPICAL

UNLESS NOTED OTHERWISE

VERTICAL

WIDTH

WORK POINT

WELDED WIRE REINFORCEMENT


RDC-S111 INC.

20365 Exchange Street, Suite 220
Ashburn, VA 20147
703.668.0086
rdcollaborative.com

COPYRIGHT NOTICE

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional

PROFESSIONAL SEAL

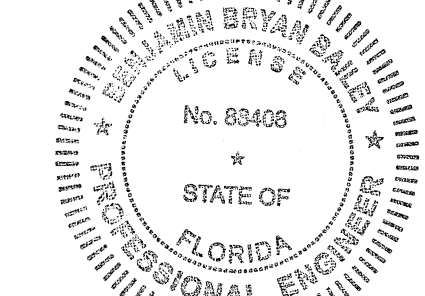

REVISIONS

Δ	ISSUE	DATE
1	OTB	01/16/26
3	OTB	04/16/26
4	IFC	06/12/26

JBA JOHNSTON BURKHOLDER ASSOCIATES
consulting structural engineers
930 CENTRAL, KANSAS CITY, MO 64105
816.421.4200 - WWW.JBAJBA.COM
JBA NO. 26007

ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

PROFESSIONAL IN CHARGE

BBB

PROJECT MANAGER

KSH

QUALITY CONTROL

BWM

DRAWN BY

JBA

PROJECT NAME

CIRCLE K
STORES, INC.

LEESBURG, FL

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROTOCOL # R0 03/07/25




CIRCLE K STORES, INC.


PROJECT NUMBER: 25172

DIAGRAMS AND SCHEDULES


S0.2

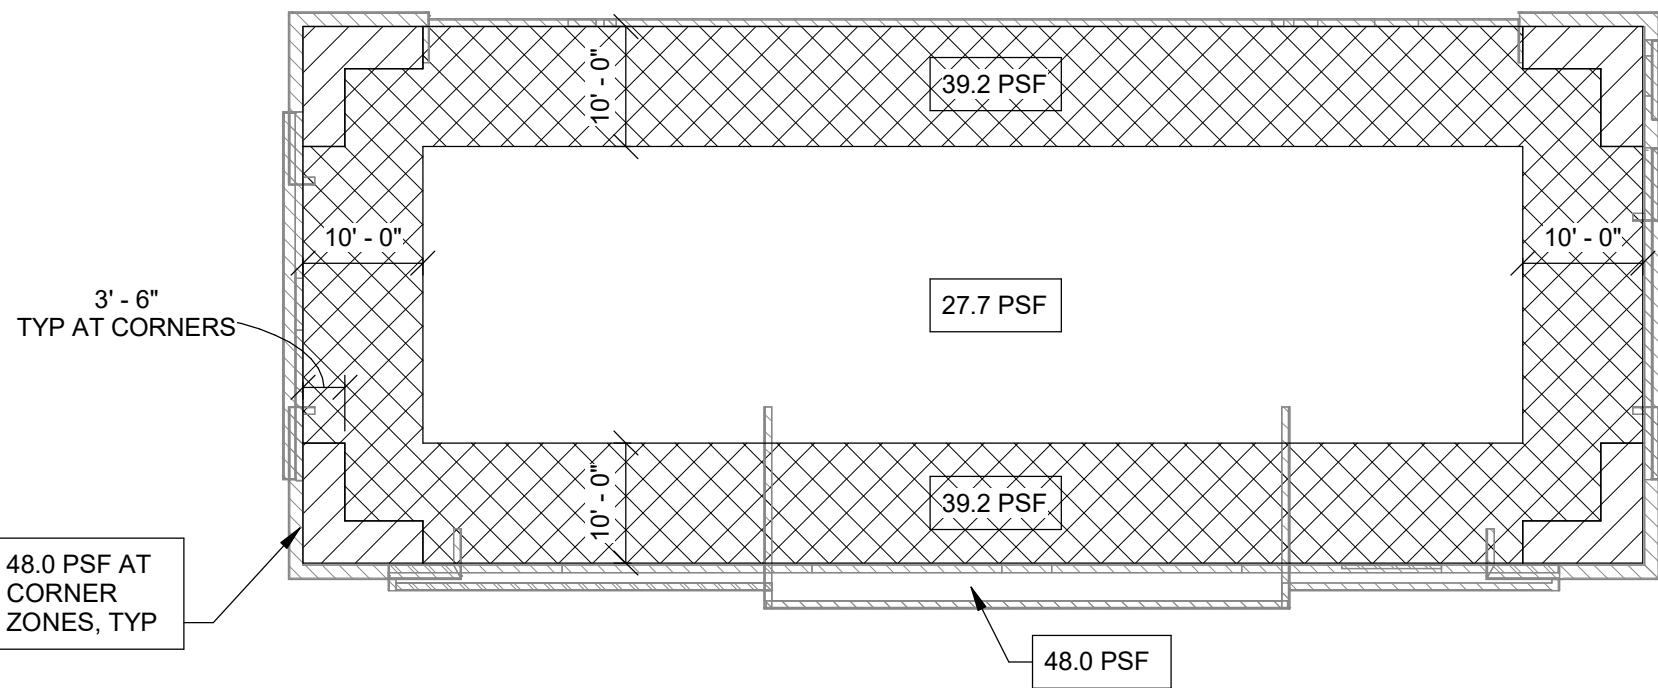

TRUSS NET WIND UPLIFT PRESSURE DIAGRAM

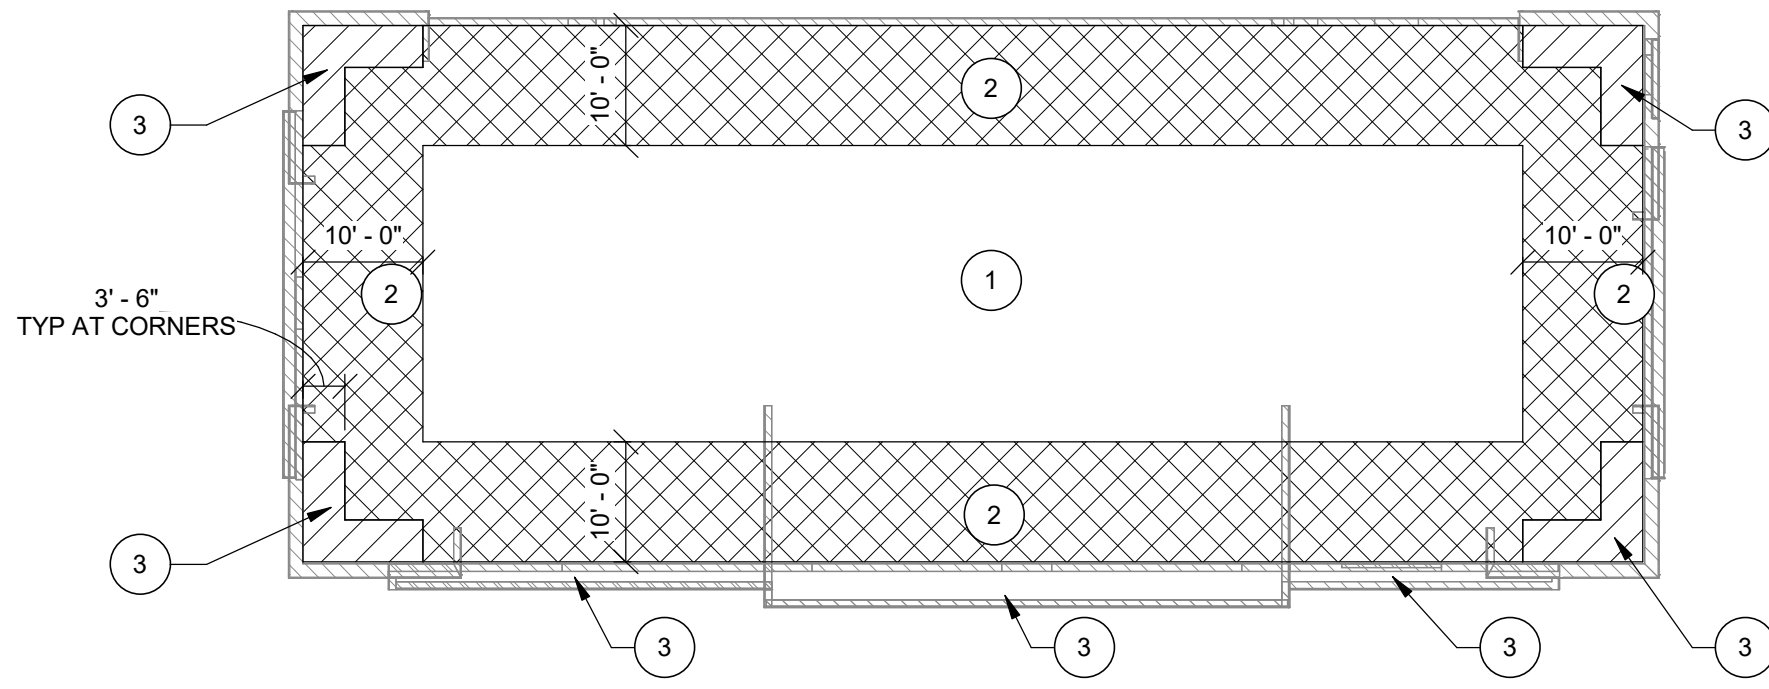

COMPONENT AND CLADDING WIND PRESSURE DIAGRAM - ROOF

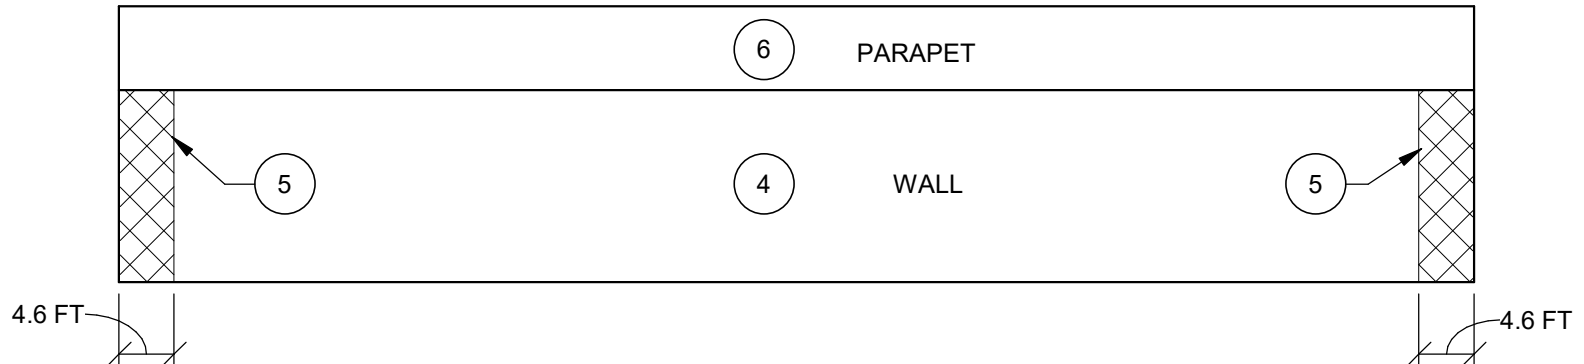


COMPONENT AND CLADDING WIND PRESSURE DIAGRAM - WALLS

	C&C ZONE	EFFECTIVE WIND AREA (SF)	POSITIVE PRESSURE (PSF)	NEGATIVE PRESSURE (PSF)		C&C ZONE	EFFECTIVE WIND AREA (SF)	POSITIVE PRESSURE (PSF)	NEGATIVE PRESSURE (PSF)
ROOF	1	10	+11.4	-44.7	WALLS	4	10	+25.7	-27.8
		20	+10.7	-41.7			20	+24.5	-26.7
		50	+10.0	-37.8			50	+23.0	-25.2
		100	+10.0	-34.9			100	+21.9	-24.0
	2	10	+11.4	-59.0			10	+25.7	-34.2
		20	+10.7	-55.2			20	+24.5	-32.0
		50	+10.0	-50.2			50	+23.0	-29.0
		100	+10.0	-46.4			100	+21.9	-26.7
	3	10	+11.4	-80.4			10	+103.1	-54.3
		20	+10.7	-72.8			20	+93.8	-50.7
		50	+10.0	-62.8			50	+81.7	-45.9
		100	+10.0	-55.2			100	+72.4	-42.3

NOTES:
1. THE VALUES PROVIDED HEREIN ARE ALLOWABLE STRESS DESIGN LOADS (ALREADY INCLUDE 0.6 FACTOR) AND ARE INTENDED FOR SERVICEABILITY LIMITS. THESE VALUES DO NOT REFLECT THE ULTIMATE LOADING THAT MAY BE EXPERIENCED BY THE BUILDING.
2. THE ROOFING SYSTEM SHALL BE BASED ON AN EFFECTIVE WIND AREA OF 10 SF.

COMPONENT AND CLADDING WIND PRESSURE SCHEDULE

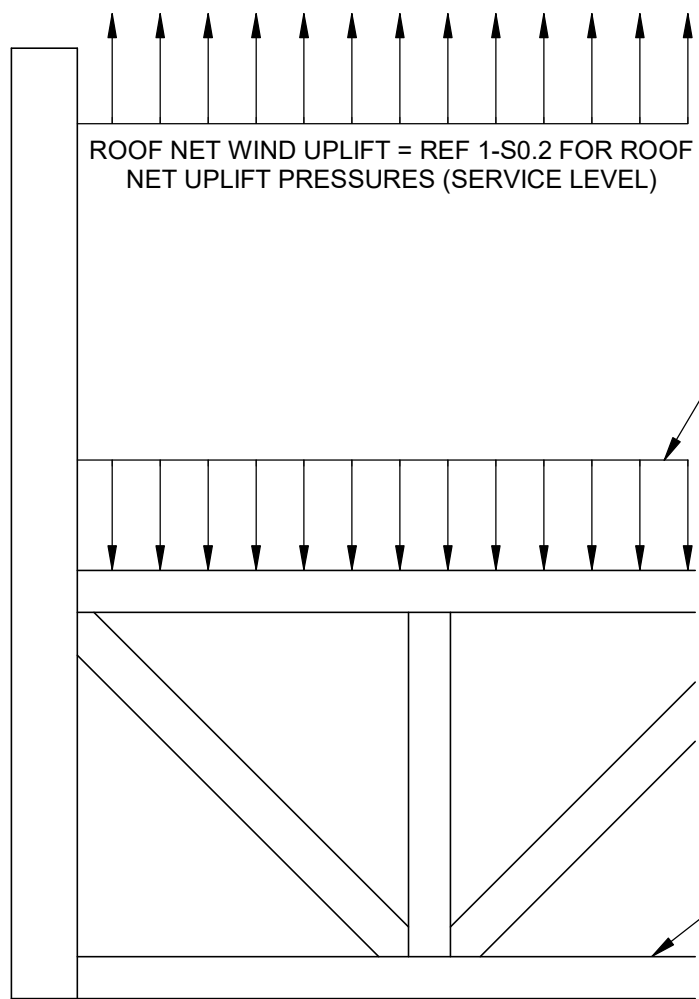

TYPICAL WOOD TRUSS LOADING DIAGRAM

3/4" = 1'-0"

COMPONENTS & CLADDING WIND PRESSURES

NTS

STRUCTURAL SPECIAL INSPECTIONS

SOILS		
VERIFICATION AND INSPECTION	FREQUENCY	REFERENCED STANDARD
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY	PERIODIC	-
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL	PERIODIC	-
3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS	PERIODIC	-
4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESS DURING PLACEMENT AND COMPACTION OF COMPACTED FILL.	CONTINUOUS	-
5. PRIOR TO PLACEMENT OF COMPACTED FILL, OBSERVE SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY.	PERIODIC	-

CONCRETE CONSTRUCTION (ACI 318-19)		
VERIFICATION AND INSPECTION	FREQUENCY	REFERENCED STANDARD
1. INSPECTION OF REINFORCING STEEL AND PLACEMENT	PERIODIC	ACI 318: Ch 20, 25.2, 25.3, 26.6.1-26.6.3
2. NOT USED.	-	-
3. INSPECTION OF ANCHORS CAST IN CONCRETE INCLUDING, SIZE, LENGTH, PROJECTION, AND LOCATION.	PERIODIC	ACI 318: 17.8.2
4A. INSPECTION OF ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS - ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS. INSPECTIONS SHALL INCLUDE HOLE SIZE AND DEPTH, CLEANING PROCEDURE, MATERIALS, AND LOCATION.	CONTINUOUS	ACI 318: 17.8.2.4
4B. INSPECTION OF ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS - MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4A.INSPECTIONS SHALL INCLUDE HOLE SIZE AND DEPTH, CLEANING PROCEDURE, MATERIALS, AND LOCATION.	PERIODIC	ACI 318: 17.8.2
5. INSPECTION TO VERIFY USE OF REQUIRED DESIGN MIX.	PERIODIC	ACI 318: CH. 19, 26.4.3, 26.4.4
6. INSPECTION PRIOR TO CONCRETE PLACEMENT, AND AT THE TIME FRESH CONCRETE IS SAMPLED TO FABRICATE SPECIMENS, FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTENT TESTS, AND DETERMINE THE TEMPERATURE OF THE CONCRETE. REF TO GENERAL NOTES, CAST-IN-PLACE CONCRETE EXECUTION FOR TESTING REQUIREMENTS.	CONTINUOUS	ASTM C172, ASTM C31; ACI 318: 26.5, 26.12
7. INSPECTION OF CONCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES.	CONTINUOUS	ACI 318: 26.5
8. INSPECTION FOR MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.	PERIODIC	ACI 318: 26.5.3-26.5.5
9. NOT USED.	-	-
10. INSPECT ERECTION OF PRECAST (OR SITE CAST) CONCRETE MEMBERS.	PERIODIC	ACI 318: CH. 26.9
11. NOT USED.	-	-
12. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.	PERIODIC	ACI 318: 26.11.1.2(b)
EXCEPTIONS TO CONCRETE SPECIAL INSPECTION: 1. INSPECTION IS NOT REQUIRED FOR PLACEMENT OF SLAB-ON-GRADE CONCRETE. INSPECTION OF SLAB-ON-GRADE REINFORCEMENT IS REQUIRED PRIOR TO PLACEMENT OF CONCRETE. 2. INSPECTION IS NOT REQUIRED FOR FOR PLACEMENT OF FOUNDATION CONCRETE (DESIGN f _c OF 2,500 PSI). INSPECTION OF FOUNDATION REINFORCEMENT IS REQUIRED PRIOR TO PLACEMENT OF CONCRETE.		

WOOD CONSTRUCTION:		
VERIFICATION AND INSPECTION	FREQUENCY	REFERENCED STANDARD
1. HIGH-LOAD DIAPHRAGMS:		
A. VERIFY GRADE AND THICKNESS OF PANEL SHEATHING, NOMINAL SIZE OF FRAMING MEMBERS AT ADJOINING PANEL EDGES, THE NAIL DIAMETER AND LENGTH, THE MEMBER OF FASTENER LINES AND THAT THE SPACING BETWEEN FASTENERS IN EACH LINE AND AT EDGE MARGINS.	CONTINUOUS	-

WOOD LATERAL FORCE RESISTING SYSTEM:		
VERIFICATION AND INSPECTION	FREQUENCY	REFERENCED STANDARD
1. WIND-RESISTING SYSTEM AND SEISMIC RESISTING SYSTEM		
A. VERIFY NAILING, BOLTING, ANCHORING AND OTHER FASTENING OF COMPONENTS WITH IN THE MAIN LATERAL FORCE RESISTING SYSTEM, INCLUDING WOOD SHEAR WALLS, WOOD DIAPHRAGMS, DRAG STRUTS, BRACES AND HOLD-DOWN WHERE NAIL SPACING OF WOOD DIAPHRAGMS AND WOOD SHEAR WALLS IS 4" OR LESS.	PERIODIC	-
B. INSPECTION OF FIELD-GLUING OPERATION OF ELEMENTS OF THE MAIN WIND FORCE-RESISTING SYSTEM WHERE NAIL SPACING OF WOOD DIAPHRAGMS AND WOOD SHEAR WALLS IS 4" OR LESS.	CONTINUOUS	-
2. WIND-RESISTING COMPONENTS		
A. INSPECTION IS REQUIRED FOR THE FASTENING OF THE FOLLOWING SYSTEMS AND COMPONENTS:		
i. ROOF COVERING, ROOF DECK AND ROOF FRAMING CONNECTIONS.	PERIODIC	-
ii. EXTERIOR WALL COVERING AND WALL CONNECTIONS TO ROOF AND FLOOR DIAPHRAGMS AND FRAMING.	PERIODIC	-

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY BENJAMIN BRYAN BAILEY, P.E. ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.




20365 Exchange Street, Suite 220
Ashburn, VA 20147
703.668.0086
rdcollaborative.com

COPYRIGHT NOTICE

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional

PROFESSIONAL SEAL

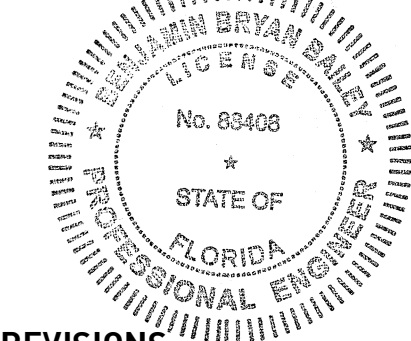

REVISIONS	
△ ISSUE	DATE
1 OTP	01/16/26
3 OTB	04/16/26
4 IFC	06/12/26

JBA JOHNSTON BURKHOLDER ASSOCIATES
consulting structural engineers
930 CENTRAL, KANSAS CITY, MO 64105
816.421.4200 • WWW.JBAENGINEER.COM
JBA NO. 26007

ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

PROFESSIONAL IN CHARGE

BBB

PROJECT MANAGER

KSH

QUALITY CONTROL

BWM

DRAWN BY

JBA

PROJECT NAME

CIRCLE K
STORES, INC.

LEESBURG, FL

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROTOCOL # R0 03/07/25




CIRCLE K STORES, INC.

PROJECT NUMBER: 25172

TABLE OF SPECIAL INSPECTIONS

S0.3

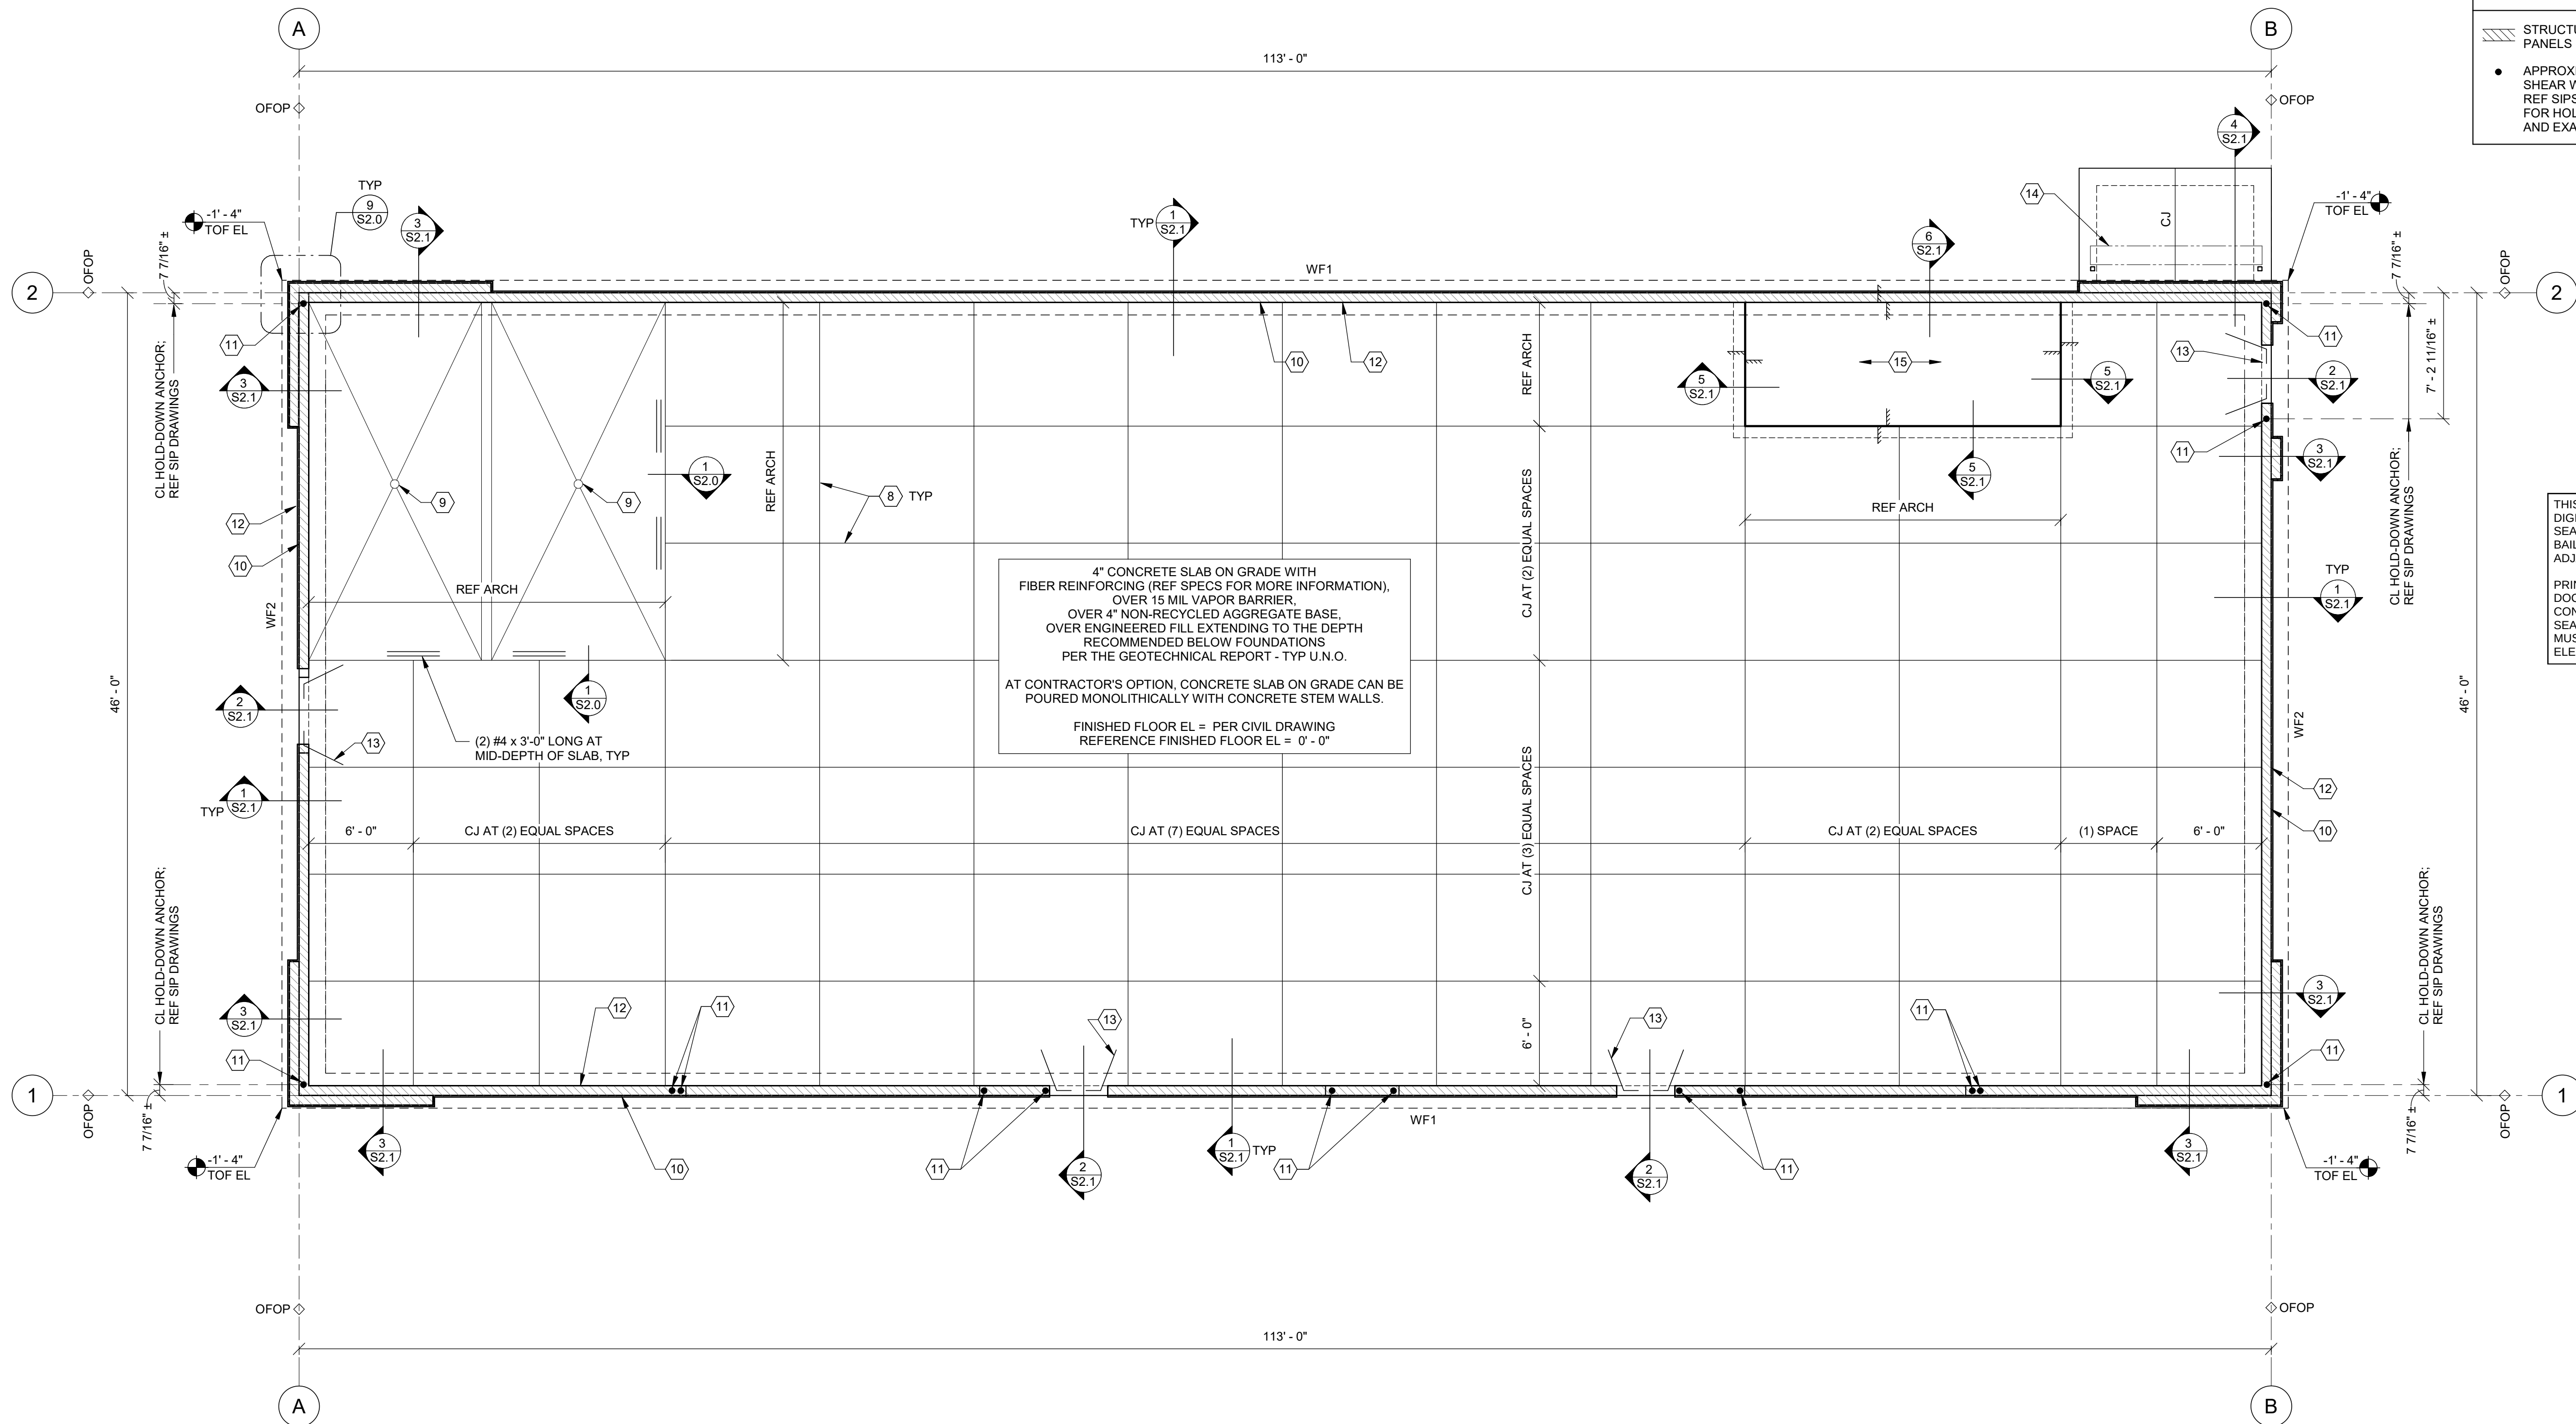

WALL LEGEND

STRUCTURAL INSULATED PANELS (SIPS)

- APPROXIMATE LOCATION OF SHEAR WALL HOLD DOWN. REF SIPS PANEL DRAWINGS FOR HOLD DOWN DETAILS AND EXACT LOCATIONS

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY BENJAMIN BRYAN BAILEY, P.E. ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.


RDC-S111 INC.

20365 Exchange Street, Suite 220
Ashburn, VA 20147
703.668.0086
rdcollaborative.com

COPYRIGHT NOTICE

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional

PROFESSIONAL SEAL

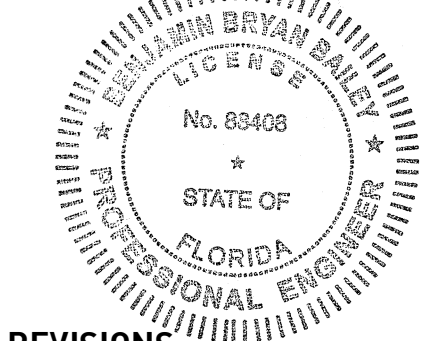

REVISIONS

ISSUE	DATE
1 OTP	01/16/26
3 OTB	04/16/26
4 IFC	06/12/26

JBA JOHNSTON BURKHOLDER ASSOCIATES
consulting structural engineers
930 CENTRAL KANSAS CITY, MO 64105
816.421.4200 - WWW.JBAJBA.COM
JBA NO. 26007

ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

PROFESSIONAL IN CHARGE

BBB

PROJECT MANAGER

KSH

QUALITY CONTROL

BWM

DRAWN BY

JBA


PROJECT NAME

CIRCLE K
STORES, INC.

LEESBURG, FL

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROTOCOL # R0 03/07/25

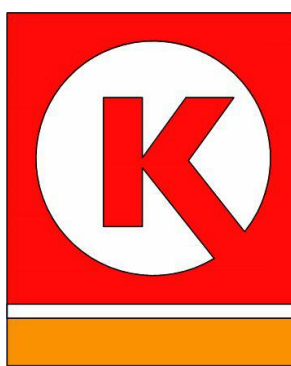

CIRCLE K STORES, INC.

PROJECT NUMBER: 25172

FOUNDATION
PLAN

S1.0

FOUNDATION PLAN NOTES	
NUMBER	PLAN NOTE
GENERAL PLAN NOTES	
1	REF SHEET S0.1, S0.2 AND S0.3 FOR GENERAL NOTES, LEGEND AND SPECIAL INSPECTIONS REQUIREMENTS.
2	ALL ELEVATIONS REFERENCED FROM FINISH FLOOR ELEVATION OF 0'-0" (AT BLDG SLAB) FOR REFERENCE ONLY.
3	TOP OF FOOTING ELEVATION SHALL BE ASSUMED TO BE CONSTANT BETWEEN ELEVATIONS SHOWN ON PLAN U.N.O. (FOUNDATION REQUIREMENTS ENSCRIBED ON S0.1 PER GEOTECHNICAL ENGINEER RECOMMENDATIONS SHALL BE FOLLOWED AS GRADING CONDITIONS VARY, REF CIVIL).
4	FOR TYPICAL REINFORCING BAR BEND DETAILS, REF 4-S2.0.
5	FOR PIPING RUNNING PARALLEL AND PERPENDICULAR TO THE FOUNDATION REF 6-S2.0 & 7-S2.0.
6	THE GENERAL CONTRACTOR, INCLUDING SUBCONTRACTORS AND SUPPLIERS, SHALL NOT ALLOW ANY VEHICULAR TRAFFIC ON THE BUILDING PAD AFTER THE PAD CERTIFICATION OR THE CONCRETE SLAB ONCE PLACED. ANY DAMAGE TO THE PAD DUE TO THE VEHICULAR TRAFFIC SHALL BE REPAIRED/REPLACED AT THE EXPENSE OF THE CONTRACTOR.
7	FOOTER CONTRACTOR NEEDS TO CONTACT THE ELECTRICAL CONTRACTOR SO THEY CAN INSTALL THE UFER BEFORE THE FOOTER IS INSPECTED
REFERENCED PLAN NOTES	
8	FOR TYPICAL FLOOR CONSTRUCTION JOINT, REF 1-S2.0; FOR TYPICAL FLOOR CONTRACTION JOINT, REF 2-S2.0.
9	COORDINATE SLAB SLOPES AT DRAIN LOCATIONS WITH THE ARCH DRAWINGS.
10	CONCRETE STEM WALL BELOW, REF DETAIL 1-S2.1 FOR DETAILS AND FACE OF WALL LOCATION. REF DETAILS 2-S2.2 THRU 4-S2.2 FOR CONCRETE STEM WALL DETAILS.
11	INDICATES SHEAR WALL HOLDDOWN; REF SIPS PANEL DRAWINGS FOR DETAILS AND EXACT LOCATIONS. ALL HOLDDOWN ANCHORS REQUIRING ANCHOR BOLTS SHALL BE EMBEDDED INTO THE CONTINUOUS FOOTING THE SPECIFIED AMOUNT SHOWN IN DETAIL 1-S2.2.
12	SIPS WALL PANELS DESIGNED TO SUPPORT ALL BUILDING CODE REQUIRED LOADS AND DESIGNED AS SHEAR WALLS TO RESIST ALL SEISMIC/WIND LOADS.
13	REF ARCH FOR ALL WALL OPENING SIZES AND LOCATIONS WITH THE ARCH DRAWINGS. REF 11-S2.0 FOR RE-ENTRANT BARS AT OPENINGS.
14	EXTERIOR ELECTRICAL EQUIPMENT, COORDINATE LOCATION WITH ELEC DRAWINGS; REF 4-S2.1 FOR LATERAL SUPPORT POST (2 PLACES).
15	RECESSED SLAB AT FREEZER; REF ARCH FOR EXACT SIZE OF FREEZER.


WALL FOOTING SCHEDULE					
MARK	WIDTH	THICKNESS	REINF (TRANS)	REINF (LONG)	REINF LOCATION
WF1	2'-0"	1'-0"	#5 AT 24"	(3) #5	BOT
WF2	2'-6"	1'-6"	#5 AT 24"	(4) #5	BOT

REF 10-S2.0 FOR LIGHT POLE
BASE DETAIL. REF CIVIL FOR
LIGHT POLE BASE LOCATIONS.

REF 5-S2.2 FOR TRASH ENCLOSURE
FOUNDATION DETAILS.

FOUNDATION PLAN | 1

3/16" = 1'-0"

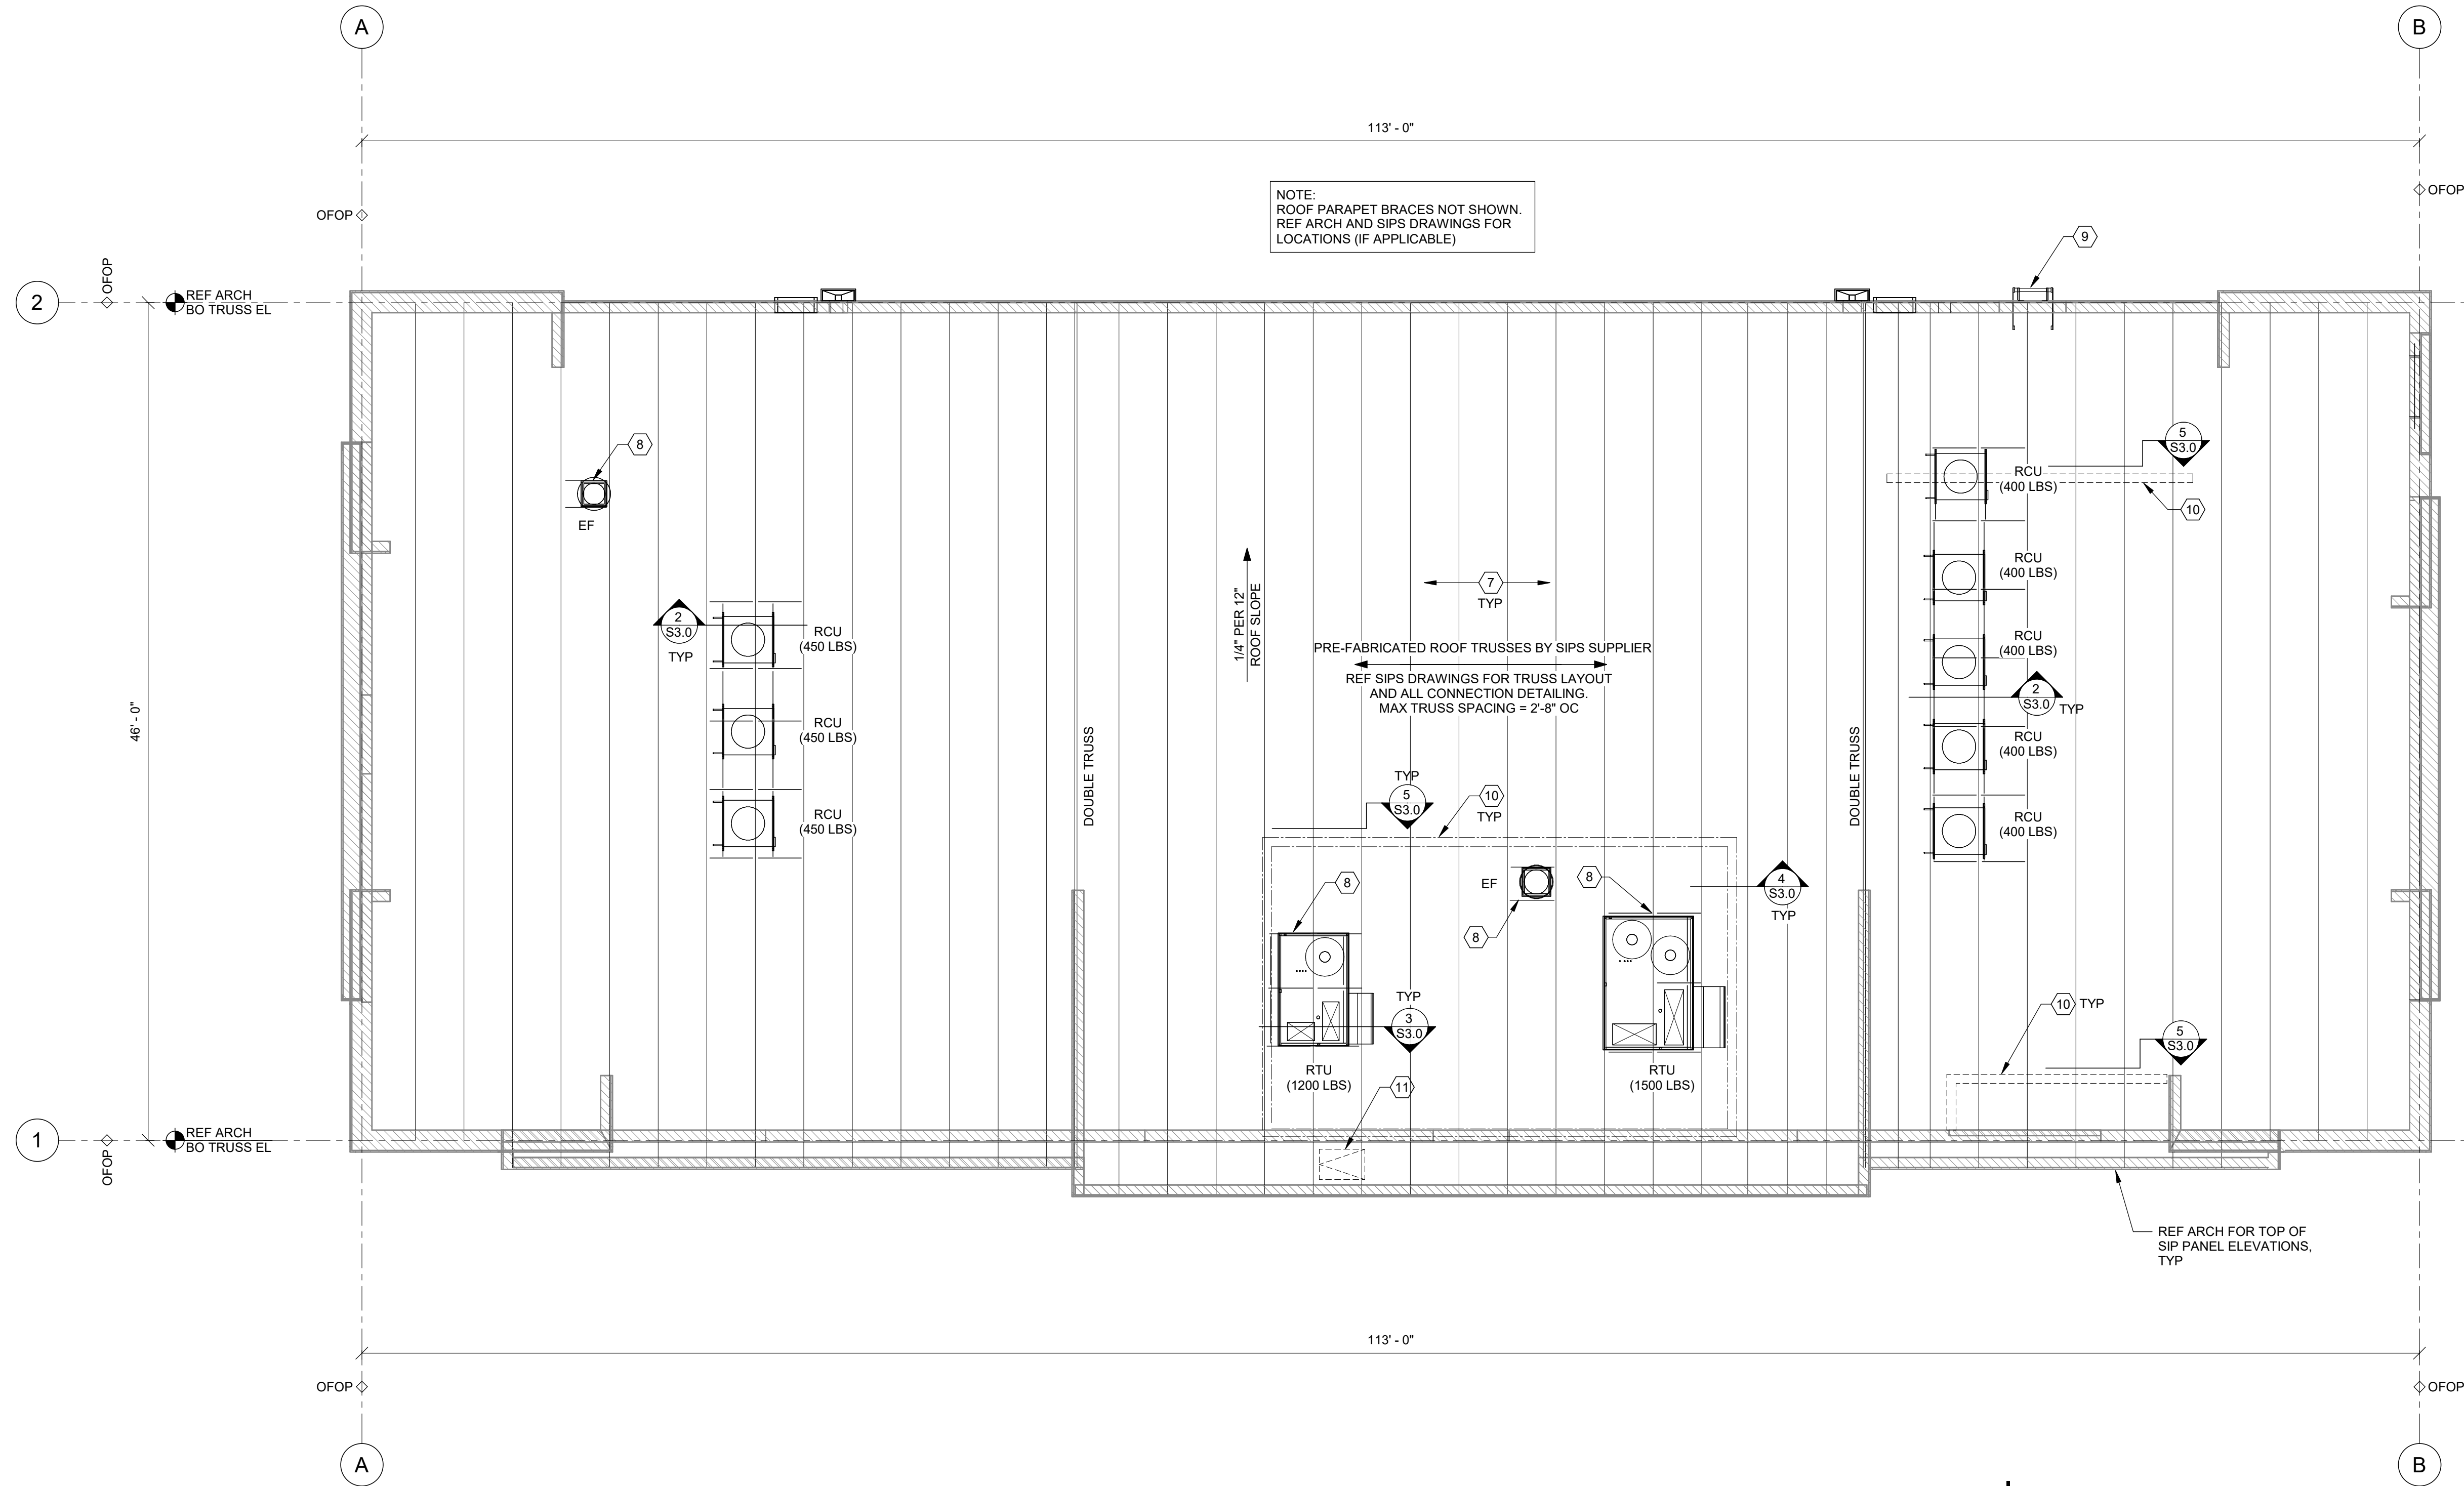

ROOF FRAMING PLAN | 1
3/16" = 1'-0"

ROOF FRAMING PLAN NOTES	
NUMBER	PLAN NOTE
GENERAL PLAN NOTES	
1	REF SHEET S0.1, S0.2 AND S0.3 FOR GENERAL NOTES AND SPECIAL INSPECTIONS REQUIREMENTS.
2	REF ARCH DRAWINGS FOR ADDITIONAL INFORMATION AND DIMENSIONS.
3	ALL ITEMS SUCH AS MECHANICAL EQUIPMENT, DUCT WORK, PIPES, CEILINGS, FIXTURES, ETC. THAT ARE TO BE SUPPORTED OR HUNG FROM THE WOOD TRUSSES SHALL BE FRAMED WITH AUXILIARY FRAMING TO THE PANEL POINTS OF THE TRUSS. METHODS OF FRAMING THAT INDUCE BENDING TO THE TRUSS CHORD OR WEB MEMBERS WILL NOT BE PERMITTED. COORDINATE BRIDGING LOCATIONS SO AS NOT TO INTERFERE WITH ANY MECHANICAL EQUIPMENT.
4	APPROXIMATE WEIGHTS OF ROOF TOP EQUIPMENT ARE SHOWN ON PLAN. VERIFY ALL LOADS, LOCATIONS, CURB SIZES AND OPENING SIZES WITH MECHANICAL CONTRACTOR PRIOR TO FABRICATION. ADJUST SPACING OF WOOD TRUSSES AS REQUIRED FOR MECHANICAL OPENINGS. REF TYPICAL RTU SUPPORT DETAIL 2-S3.0 FOR FRAMING.
5	RTUS AND RCUS MUST BE PLACED ON OR BETWEEN TRUSSES DESIGNED FOR THE ADDITIONAL LOAD AS SHOWN. REF MECHANICAL FOR EXACT LOCATIONS.
6	PLACEMENT OF SPRINKLER CONTRACTOR'S PIPING AND TRUSS BRIDGING SHALL BE COORDINATED BY THE GENERAL CONTRACTOR. THE CONTRACTOR SHALL MAKE PROVISIONS FOR THE TRUSS SUPPLIER TO ADJUST/RELOCATE BRIDGING OR SPRINKLER CONTRACTOR TO ADJUST PIPING VERTICALLY WHERE CONFLICTS OCCUR. ALL CHANGES REQUIRED OF THE TRUSS BRIDGING SHALL BE DESIGNED BY TRUSS MANUFACTURER.

ROOF FRAMING PLAN NOTES	
NUMBER	PLAN NOTE
REFERENCED PLAN NOTES	
7	SIP PANEL ROOF DESIGNED TO SUPPORT ALL BUILDING CODE REQUIRED LOADS AND DESIGNED AS A DIAPHRAGM TO DISTRIBUTE WIND/SEISMIC LOADS TO SHEAR WALLS. REF 1-S3.0 FOR ADDITIONAL FRAMING AT OPENINGS.
8	REF 1-S3.0 FOR RTU DUCT OPENING AND ROOF OPENING FRAMES. GC TO VERIFY LOCATION, SIZE AND WEIGHT OF MECHANICAL UNITS. OPERATING WEIGHT SHALL NOT EXCEED THE WEIGHT NOTED ON THE PLAN.
9	EXTERIOR ROOF ACCESS LADDER, REF ARCH FOR LOCATION. SIP PANEL MANUFACTURER TO COORDINATE CONNECTION.
10	INTERIOR SOFFIT FRAMING, REF ARCH FOR LOCATIONS AND REF APPLICABLE STRUC FRAMING SECTIONS FOR SUPPORT AND ADDITIONAL LOADS TO TRUSSES.
11	SOFFIT ACCESS HATCH BELOW ROOF, REF ARCH FOR SIZE AND LOCATION.

WALL LEGEND	
	STRUCTURAL INSULATED PANELS (SIPS)

ROOF DEAD LOADS	
DEAD LOADS	
MEMBRANE (UNBALASTED)	= 1.0 PSF
SIP PANEL	= 4.0 PSF
WOOD TRUSSES	= 3.0 PSF
MECH/ELEC/FIRE SPRINK	= 5.0 PSF
MISC	= 4.0 PSF
TOTAL	= 17.0 PSF

IFC SET 06/12/26


RDC-S111
INC.

20365 Exchange Street, Suite 220
Ashburn, VA 20147
703.668.0086
rdcollaborative.com

COPYRIGHT NOTICE

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional.

PROFESSIONAL SEAL

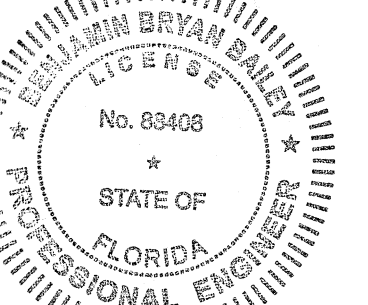

REVISIONS

△	ISSUE	DATE
1	OTB	01/16/26
3	OTB	04/16/26
4	IFC	06/12/26

JBA JOHNSTON BURKHOLDER ASSOCIATES
consulting structural engineers
930 CENTRAL, KANSAS CITY, MO 64105
816.421.4200 - WWW.JBAJBA.COM

ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

PROFESSIONAL IN CHARGE

BBB

PROJECT MANAGER

KSH

QUALITY CONTROL

BWM

DRAWN BY

JBA

PROJECT NAME

CIRCLE K STORES, INC.

LEESBURG, FL

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROTOCOL # R0 03/07/25














CIRCLE K STORES, INC.

PROJECT NUMBER: 25172

ROOF FRAMING PLAN


S1.1




S2.0

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY BENJAMIN BRYAN BAILEY, P.E. ON THE DATE ADJACENT TO THE SEAL.


PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

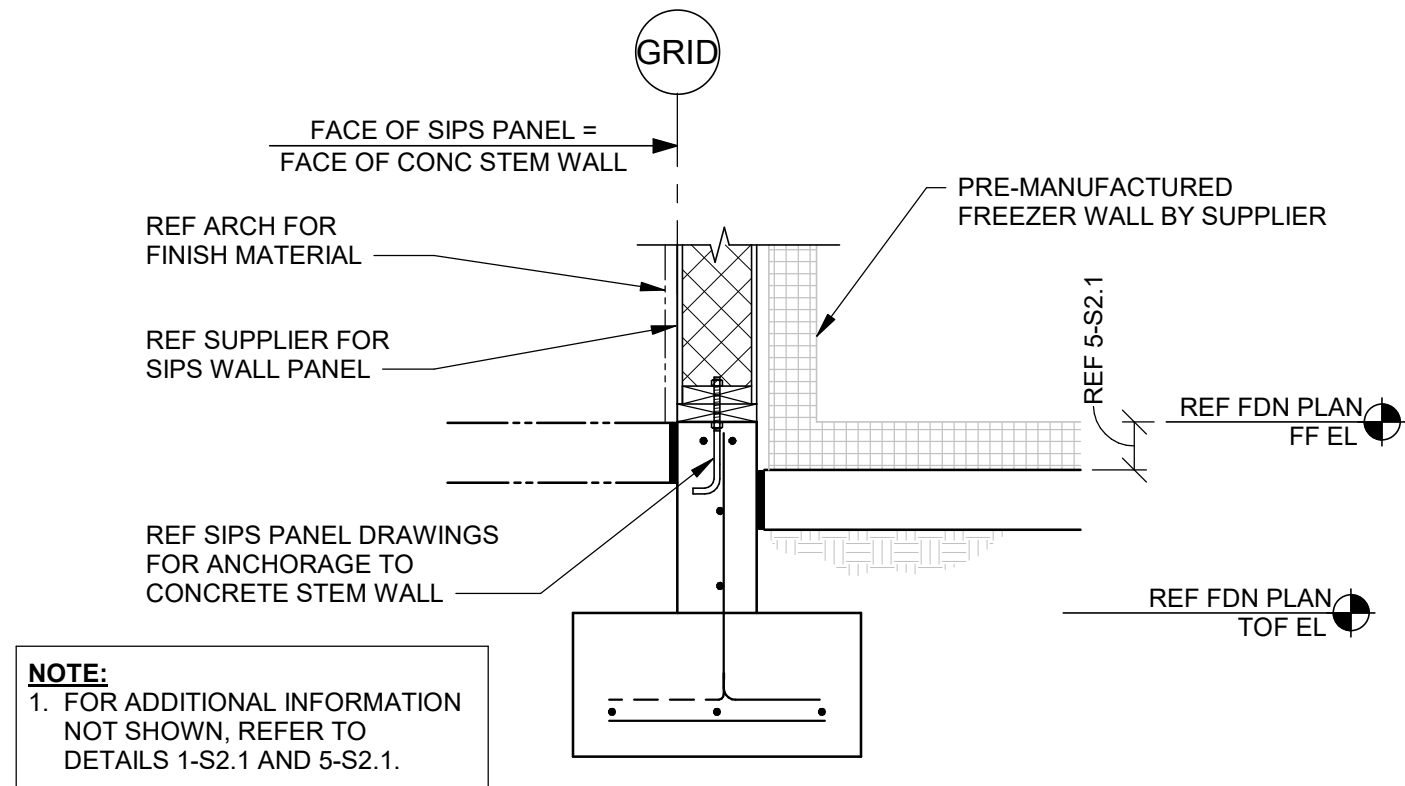


WALL SECTION AT RECESSED SLAB 6

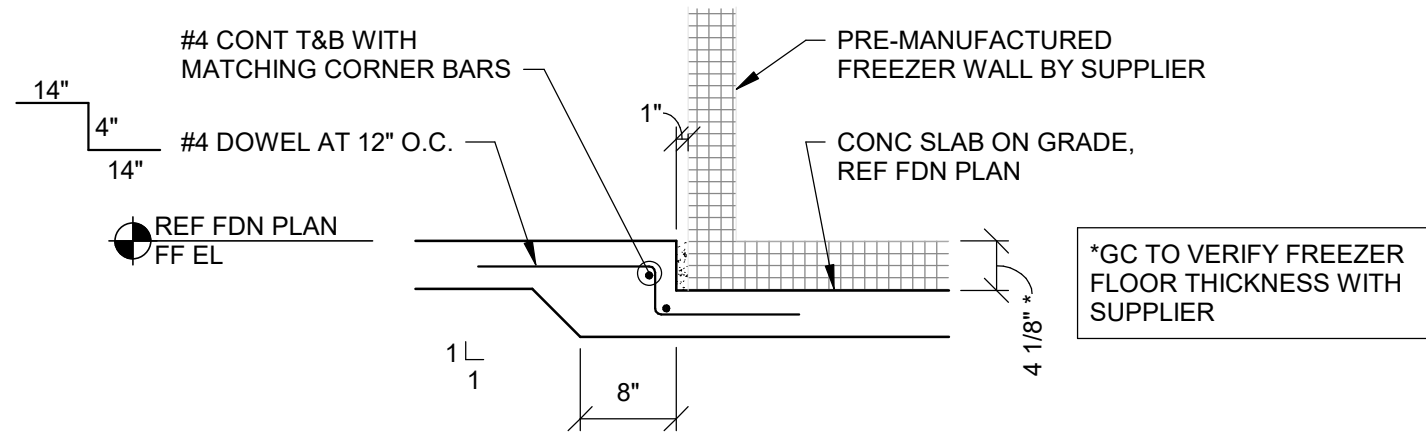


SECTION AT RECESSED SLAB 5

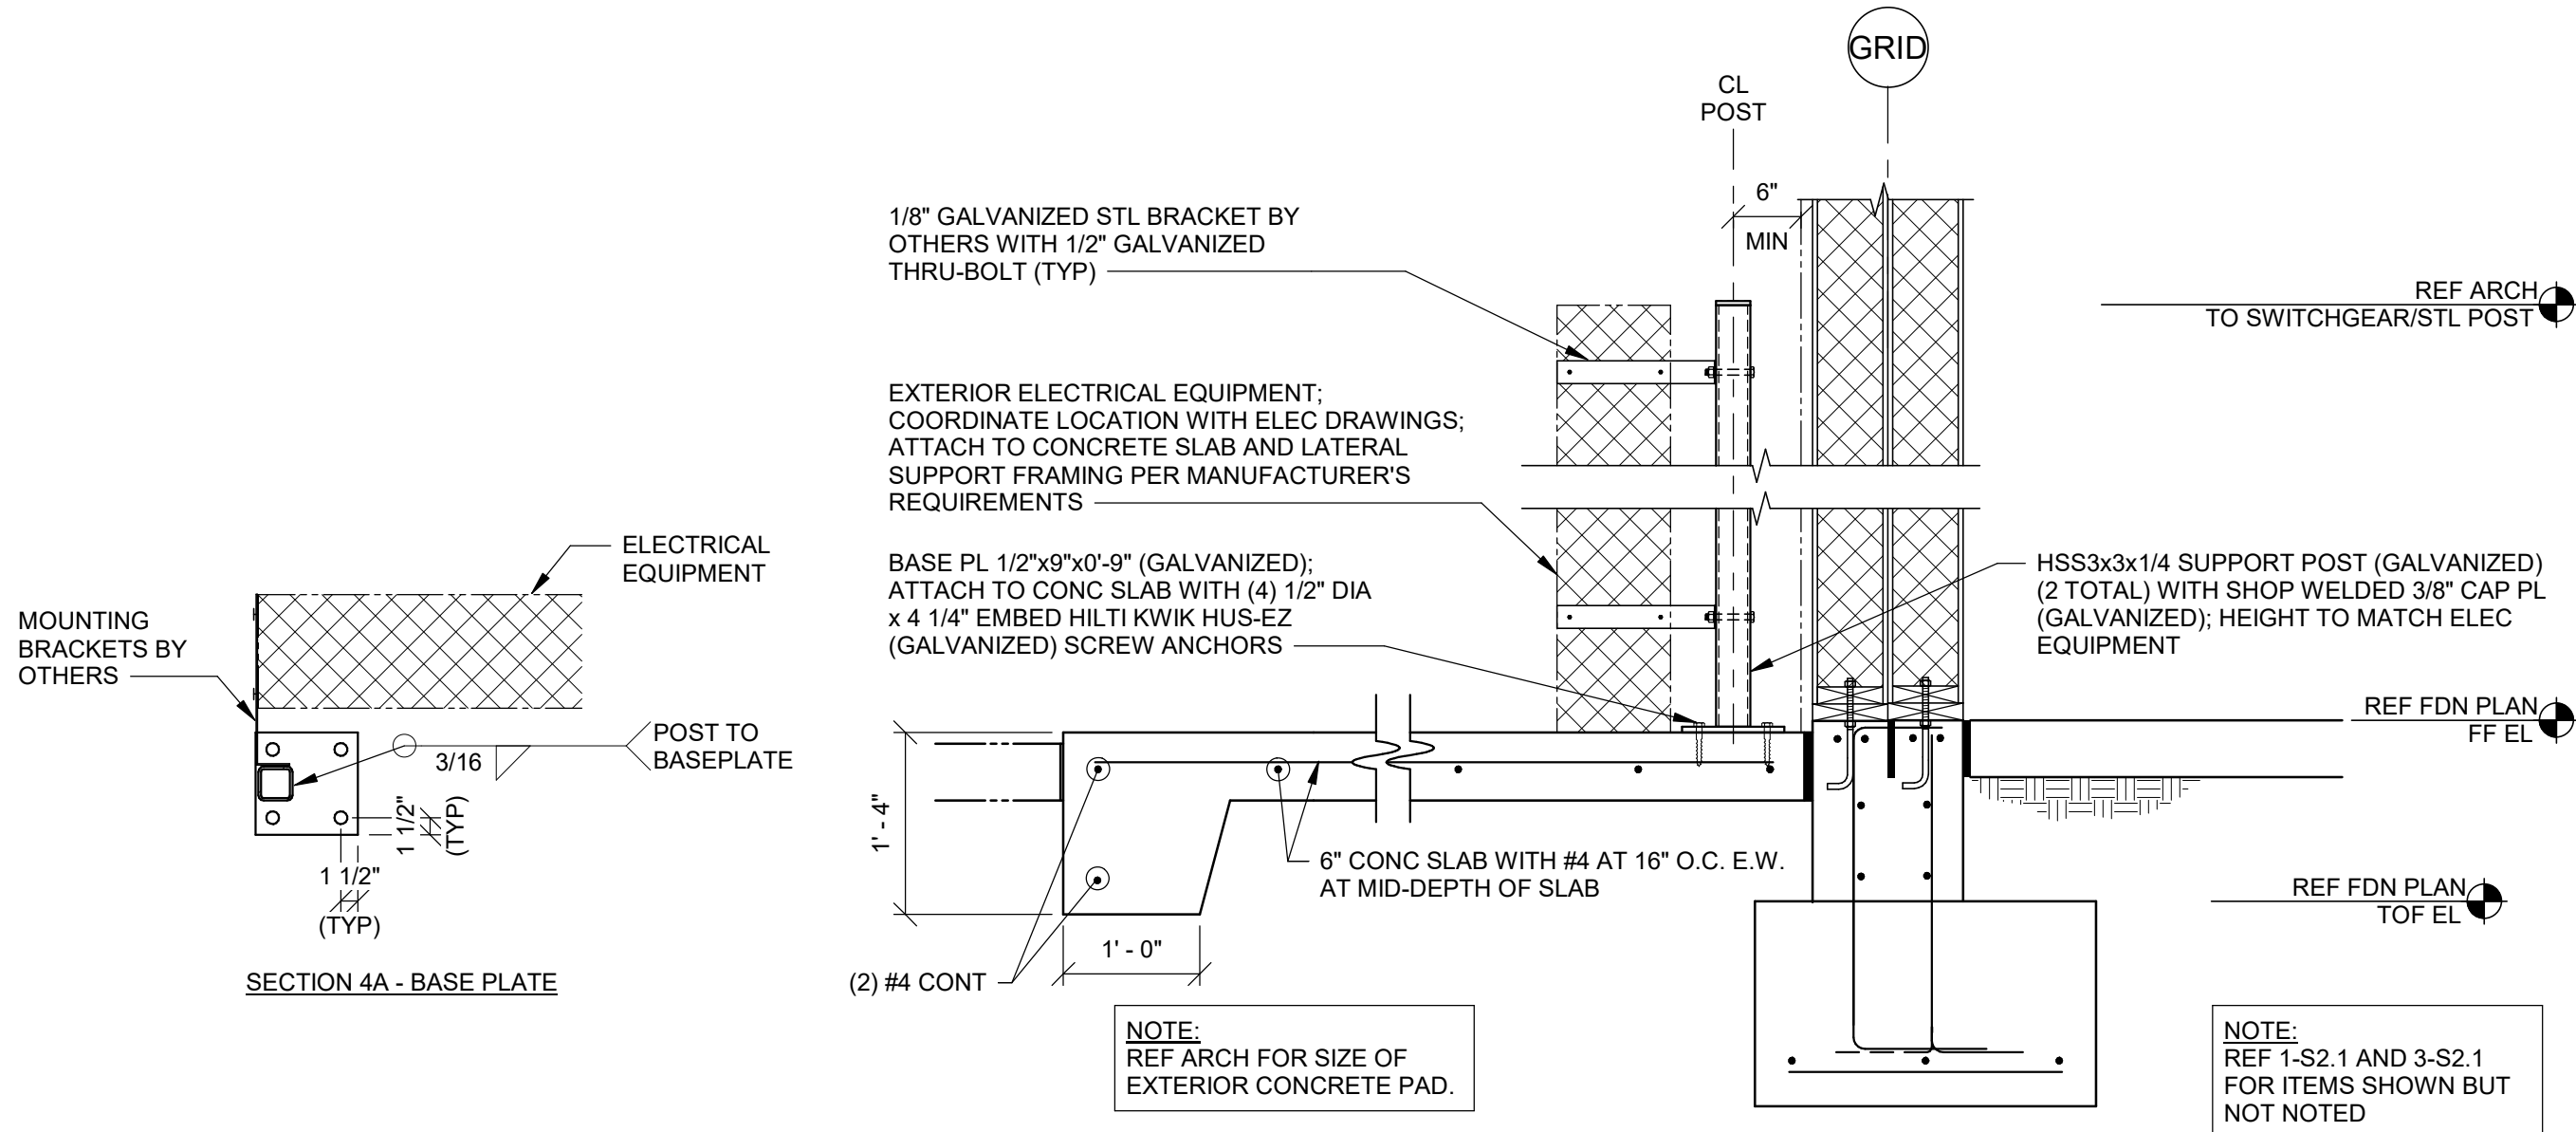


SECTION AT EXTERIOR SLAB 4








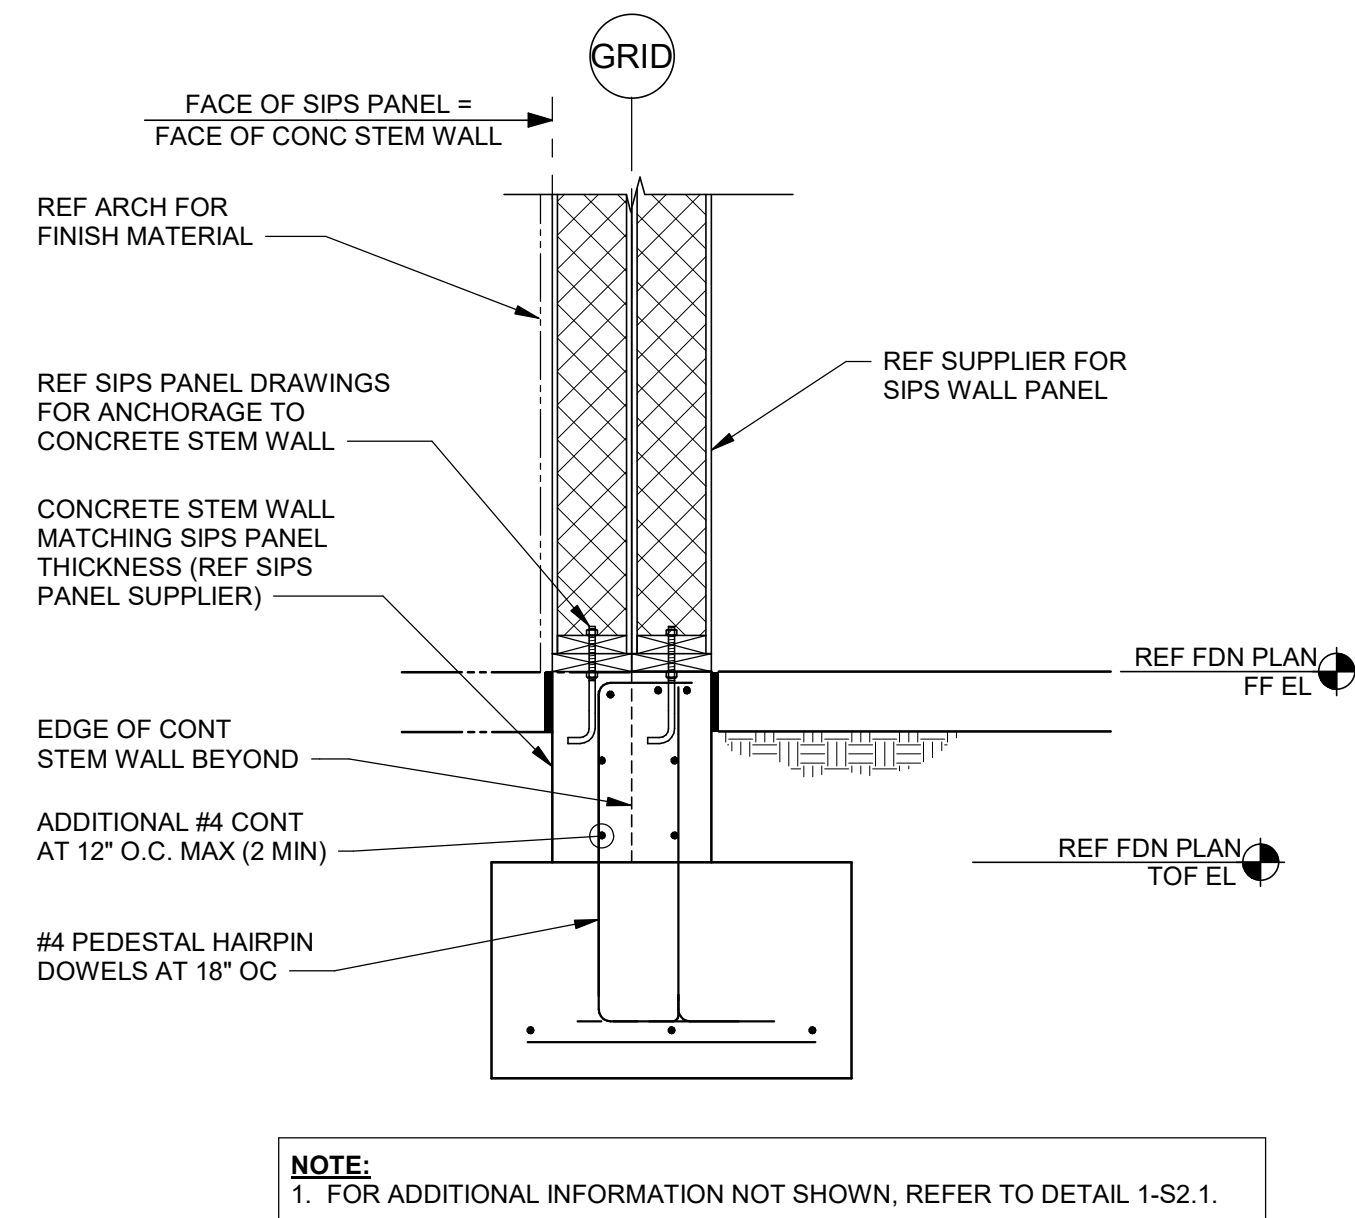


NOTE: 1. FOR ADDITIONAL INFORMATION NOT SHOWN, REFER TO DETAIL 1-S2.1.

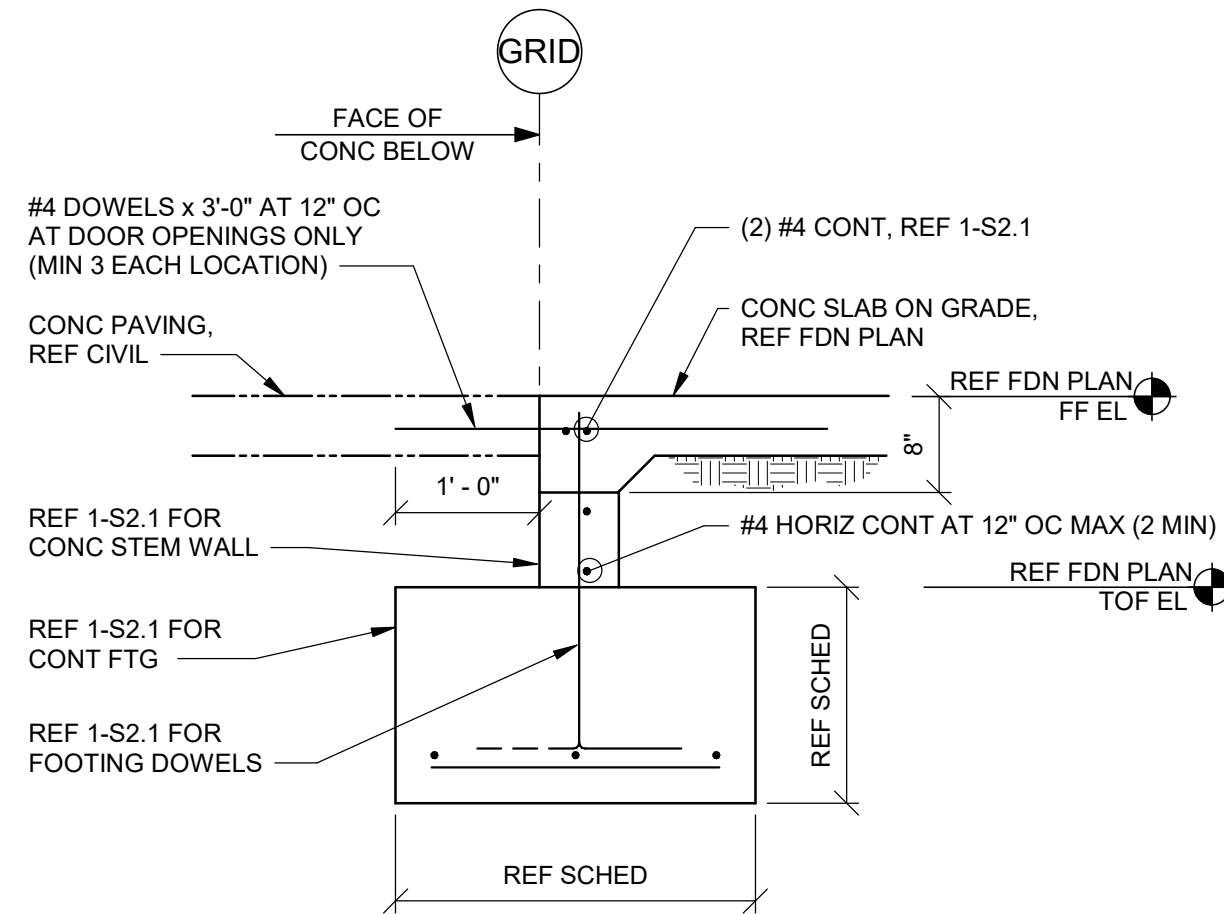

NOTE: 1. FOR ADDITIONAL INFORMATION NOT SHOWN, REFER TO DETAIL 1-S2.1.

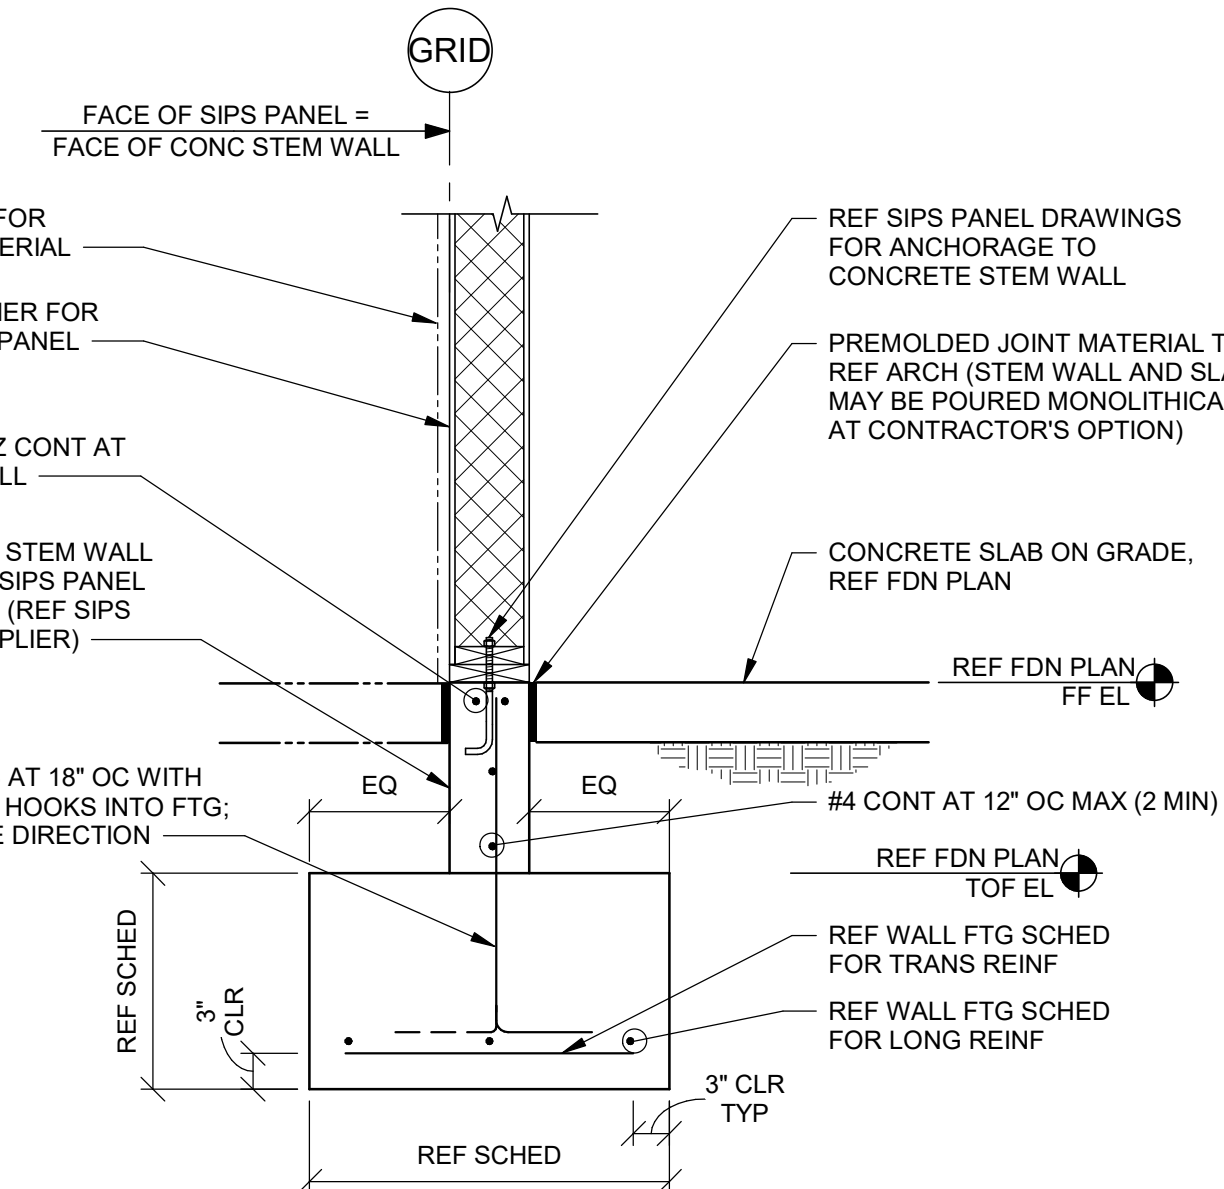

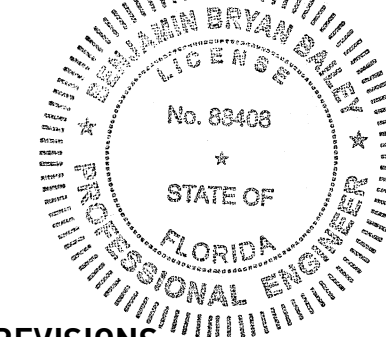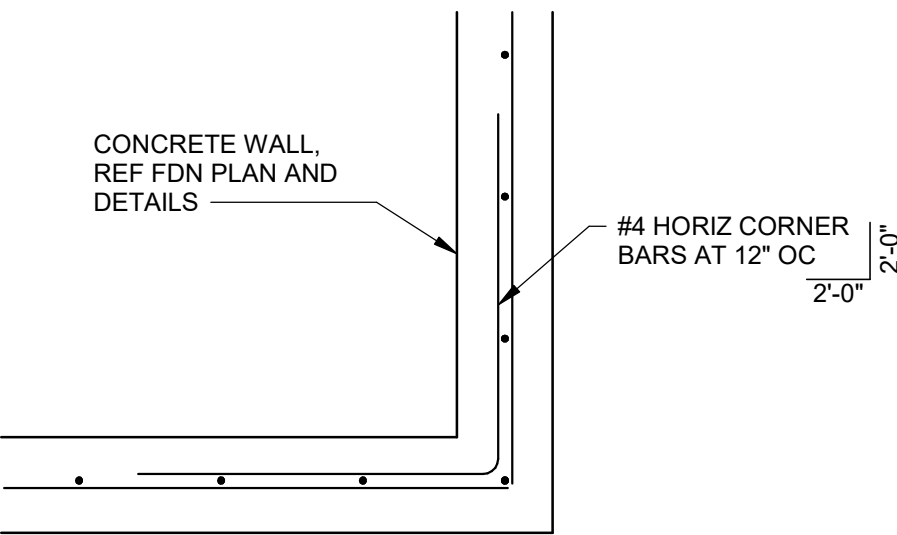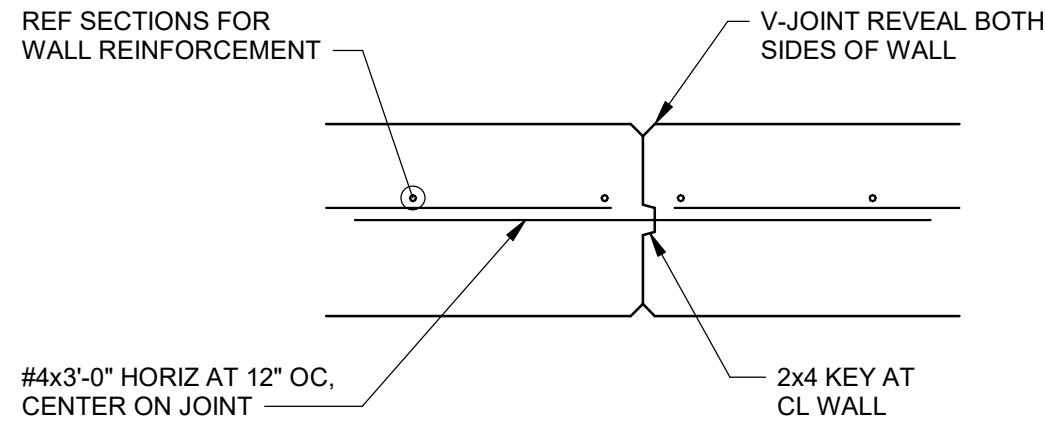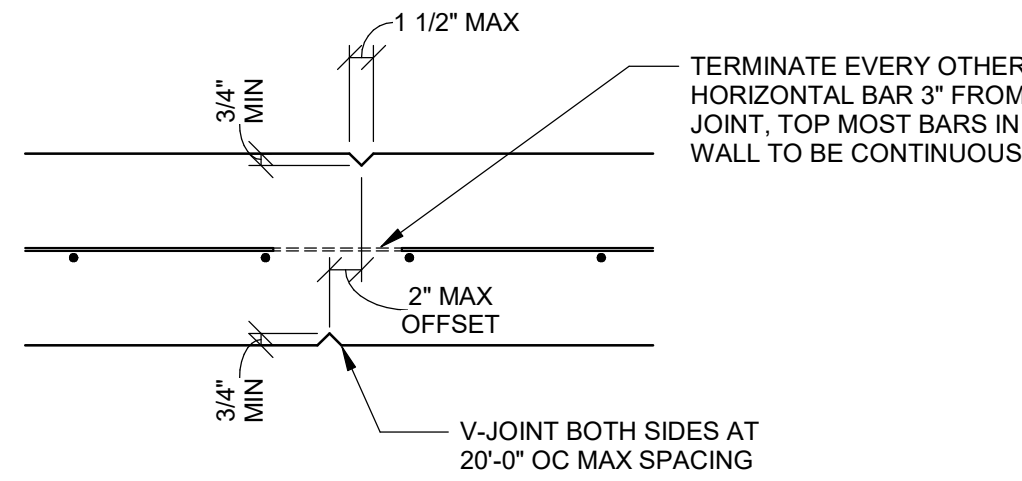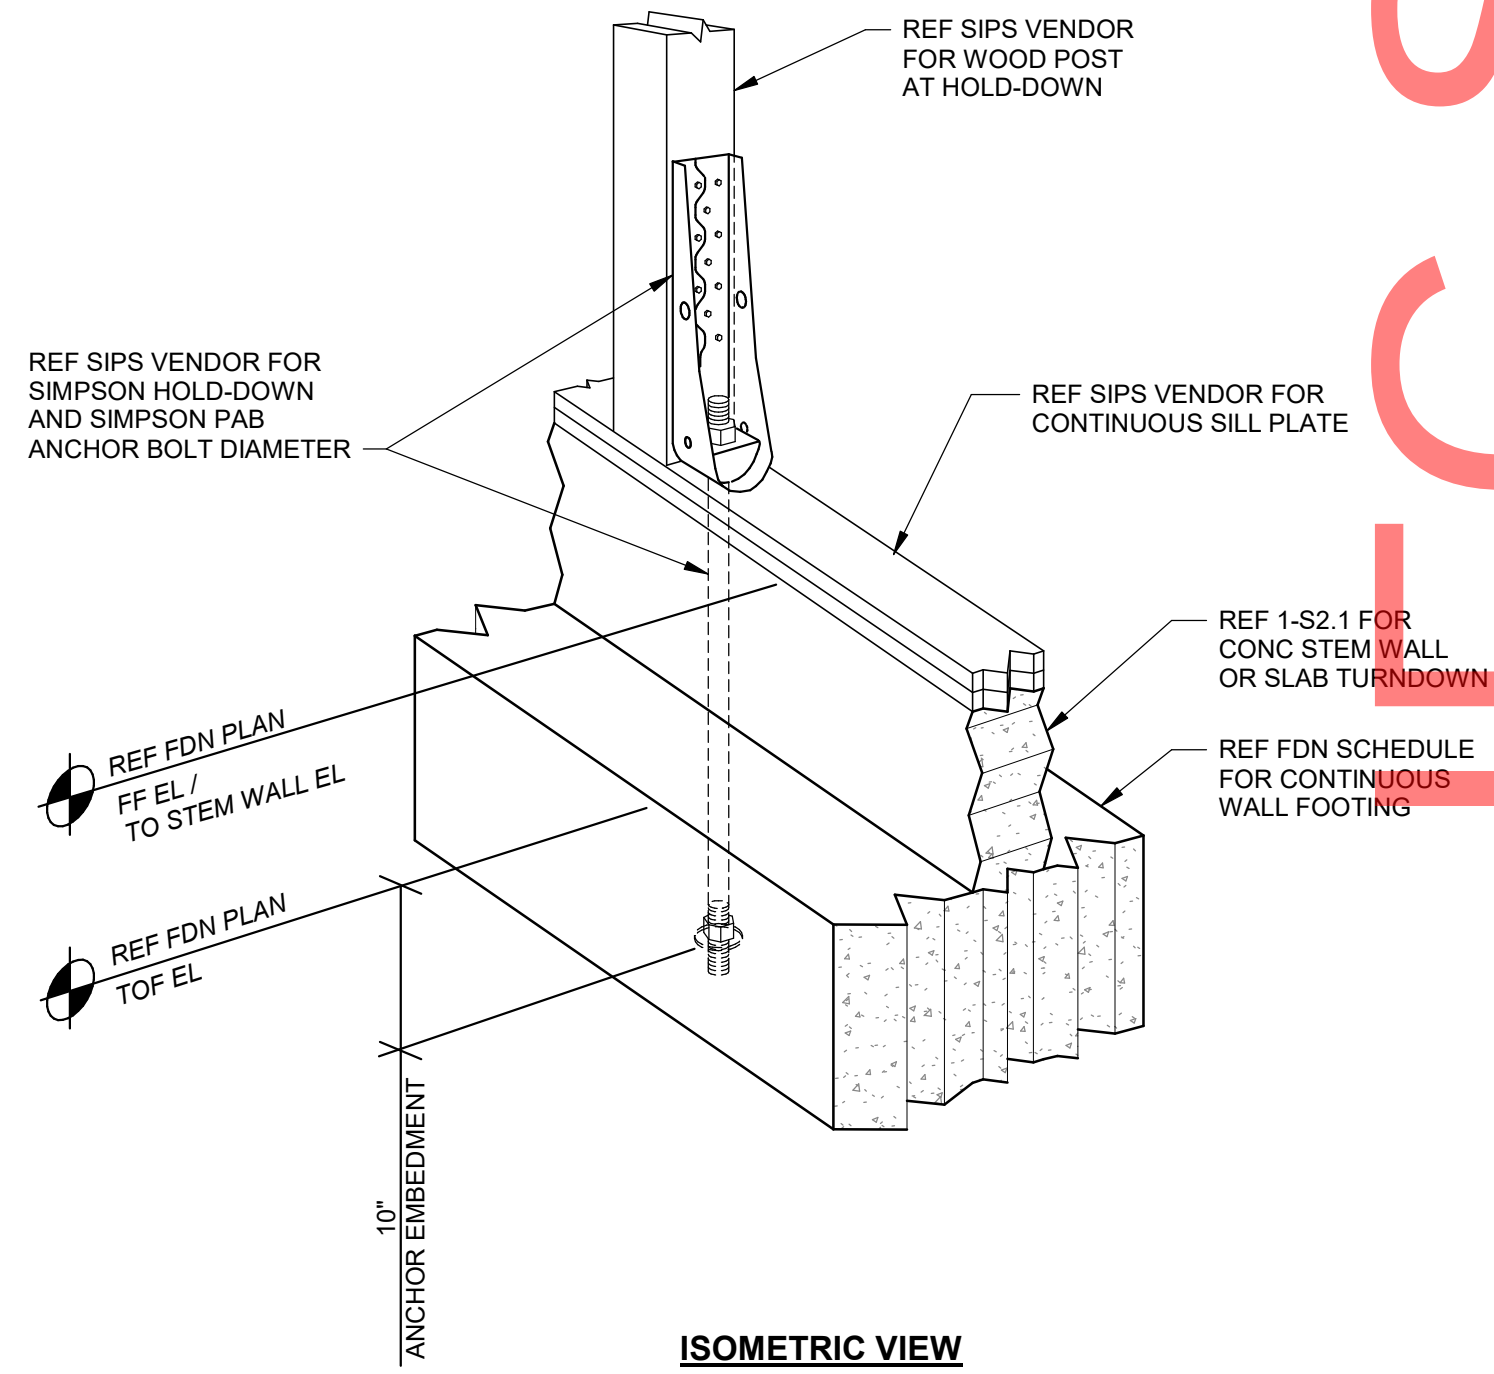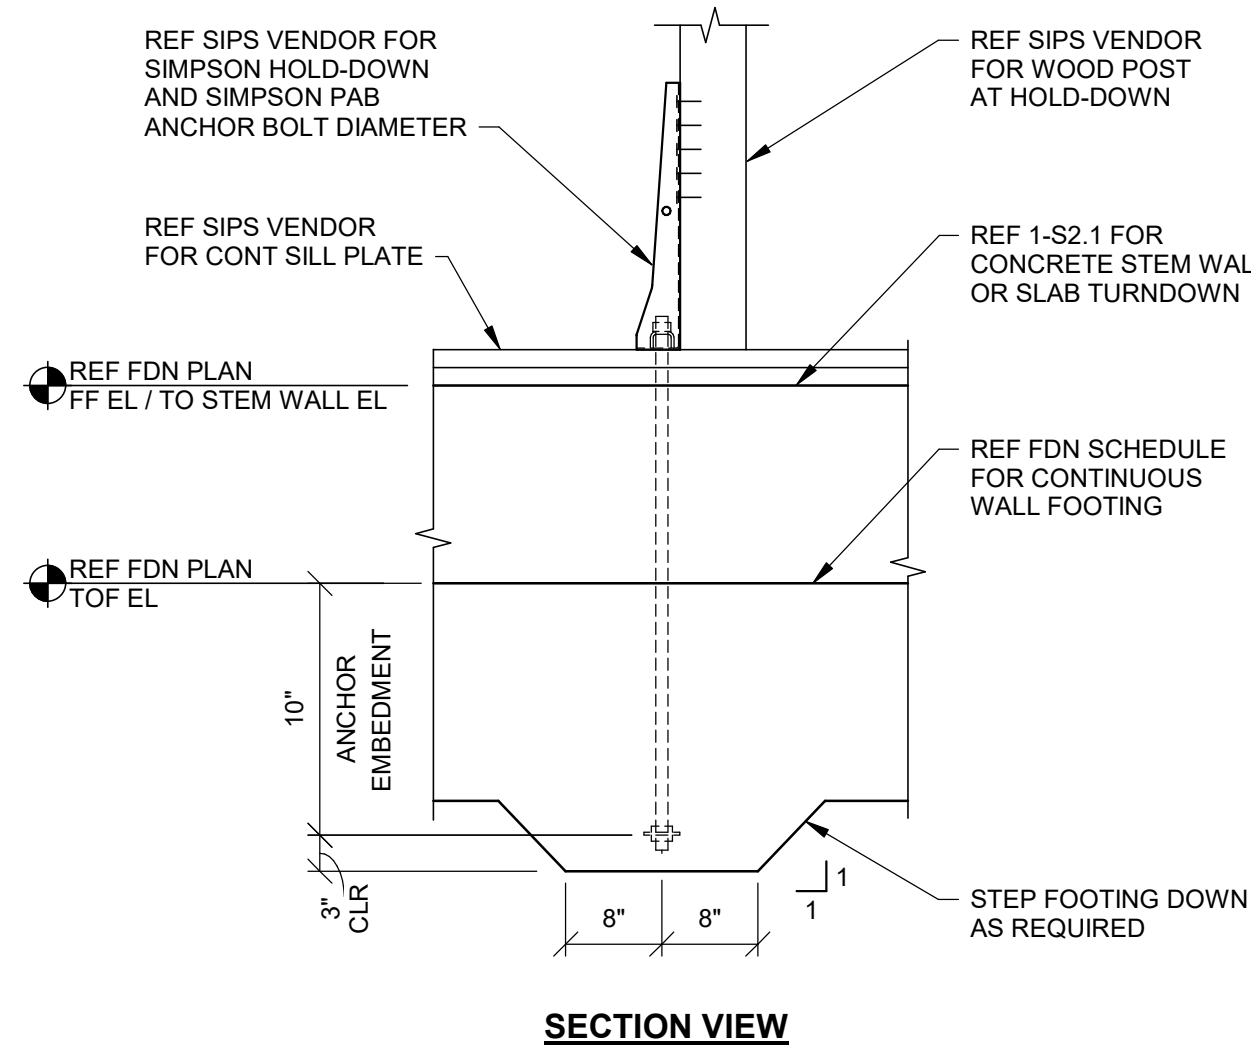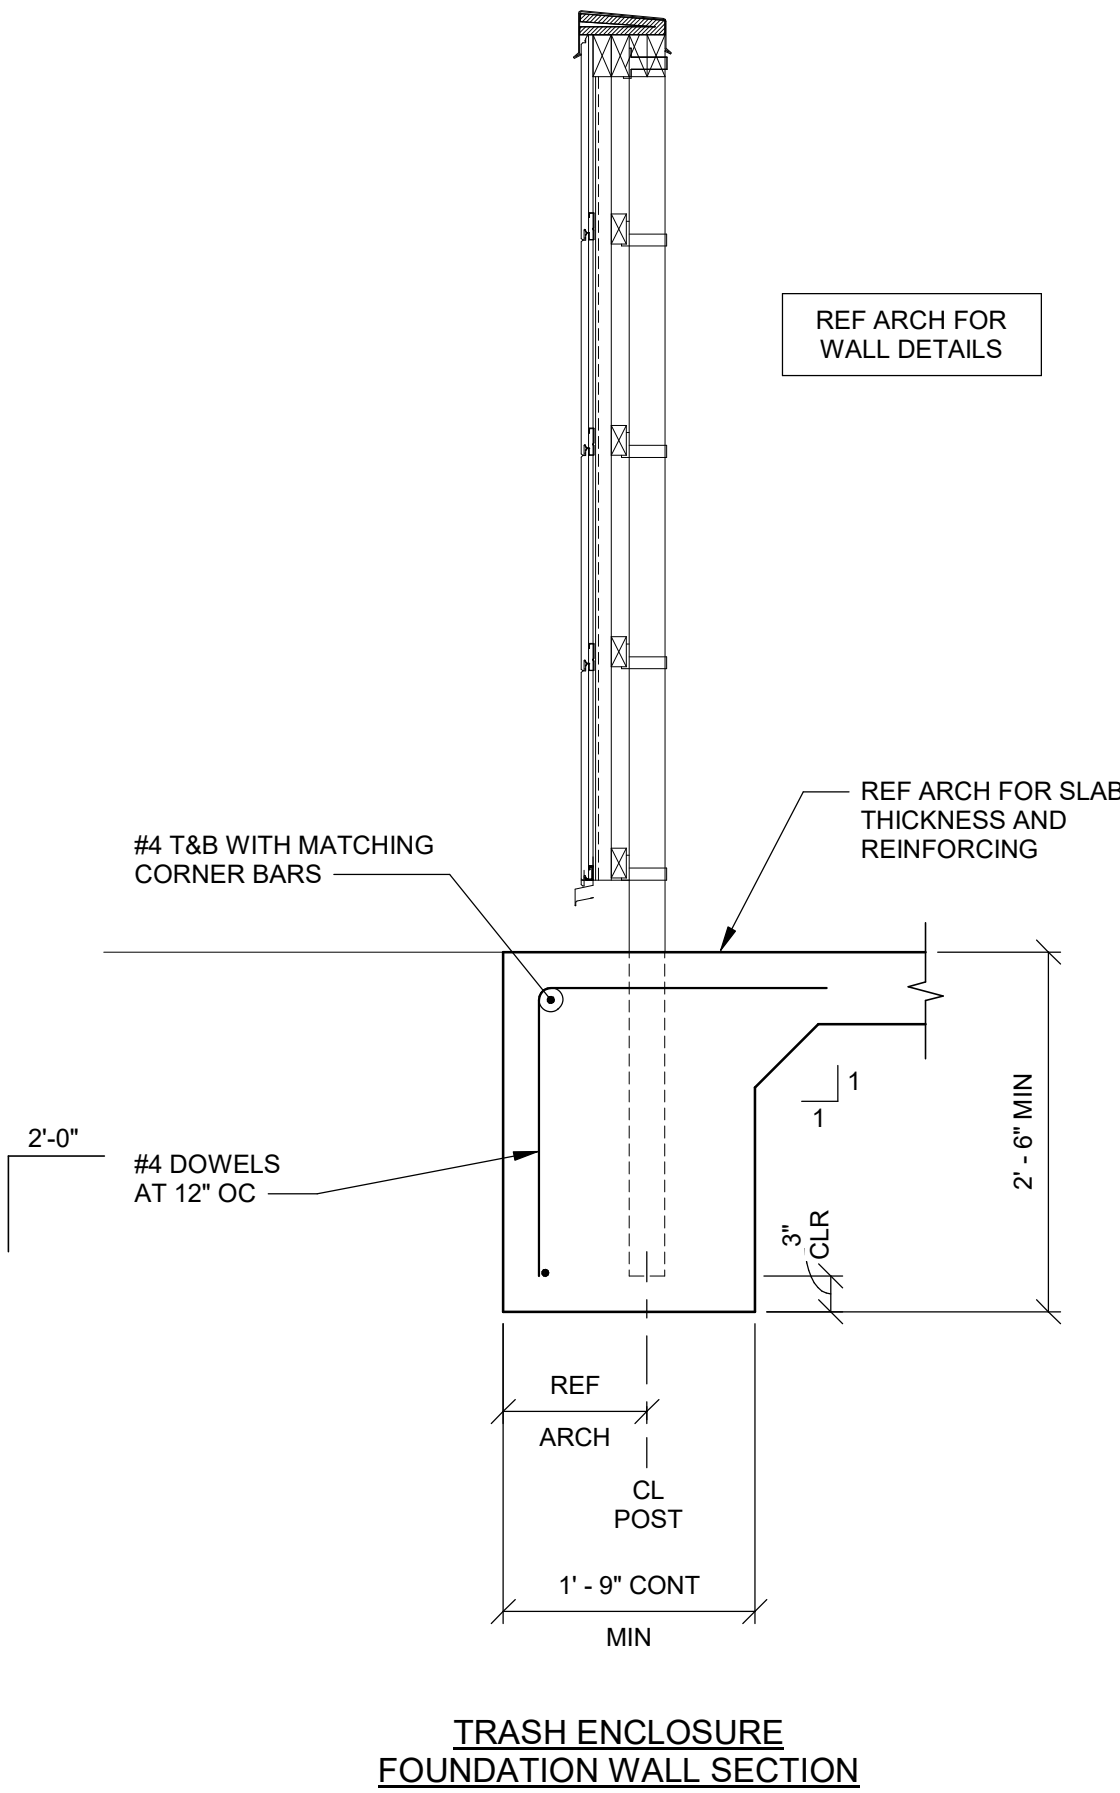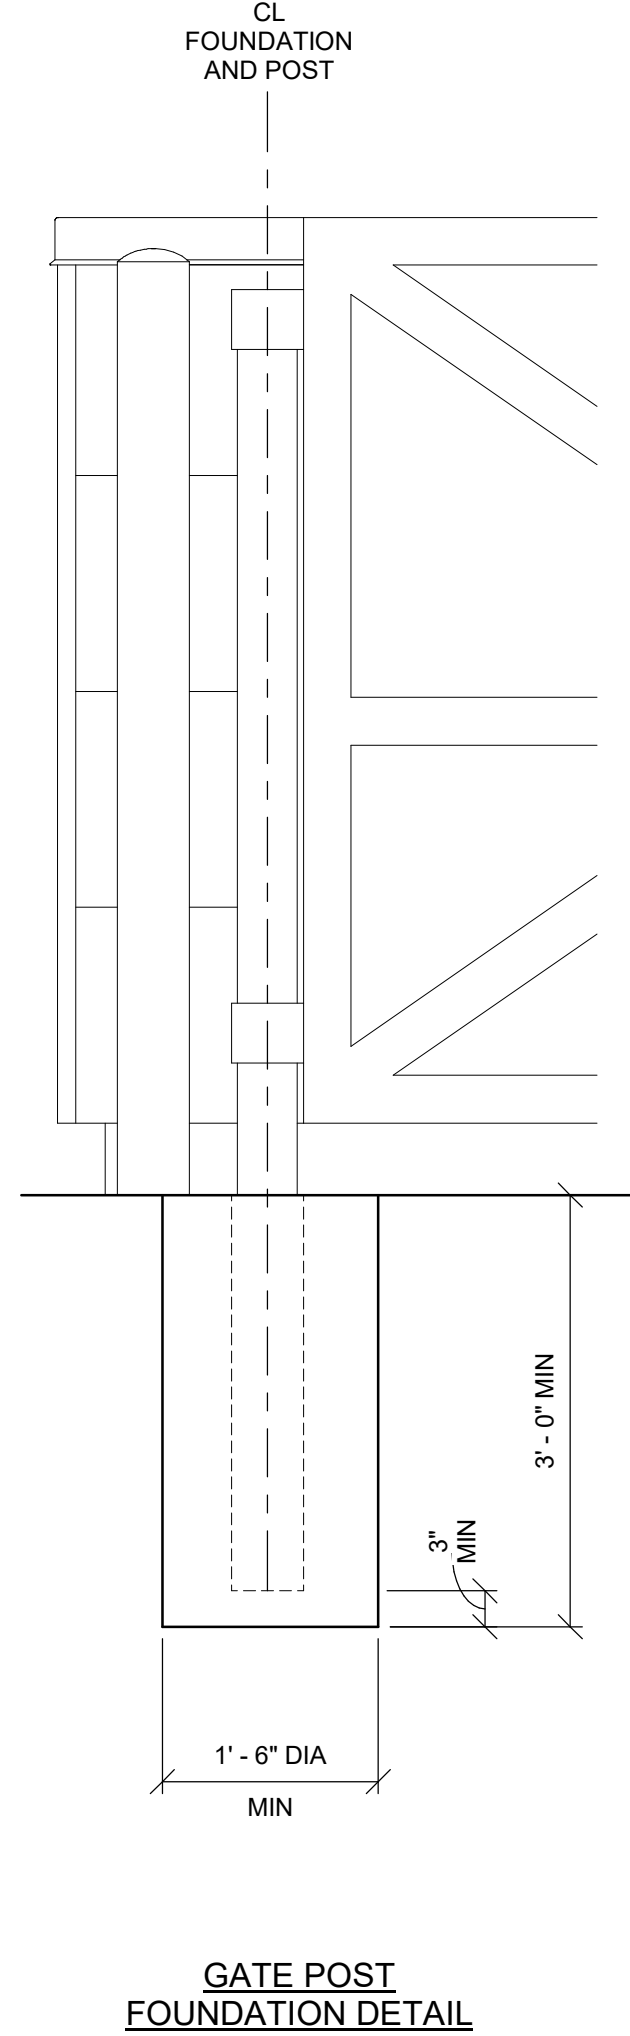

REVISIONS	
△ ISSUE	DATE
1 OTP	01/16/26
3 OTB	04/16/26
4 IFC	06/12/26

JBA JOHNSTON BURKHOLDER ASSOCIATES
consulting structural engineers
930 CENTRAL, KANSAS CITY, MO 64105
816.621.4200 • WWW.JBAENGINE.COM
JBA NO. 26007


ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408



COPYRIGHT NOTICE

This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site named herein, and cannot be reproduced in any manner without the express written permission from the professional.

PROFESSIONAL SEAL

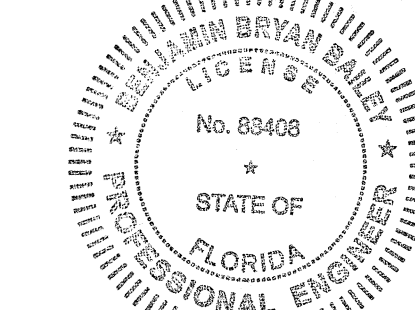

REVISIONS	
△ ISSUE	DATE
1 OTP	01/16/26
3 OTB	04/16/26
4 IFC	06/12/26

JBA JOHNSTON
BURKHOLDER
ASSOCIATES
consulting structural engineers
930 CENTRAL, KANSAS CITY, MO 64105
816.421.4200 - WWW.JBAENGINEER.COM
JBA NO. 26007
ENGINEER OF RECORD:
BENJAMIN BRYAN BAILEY, P.E.
930 CENTRAL ST.
KANSAS CITY, MO 64105
FL LICENSE #88408

PROFESSIONAL IN CHARGE

BBB

PROJECT MANAGER

KSH

QUALITY CONTROL

BWM

DRAWN BY

JBA


PROJECT NAME

CIRCLE K
STORES, INC.

LEESBURG, FL

US 441 & COLLEGE DR.
LEESBURG, FL 34788

PROTCYCLE # R0 03/07/25

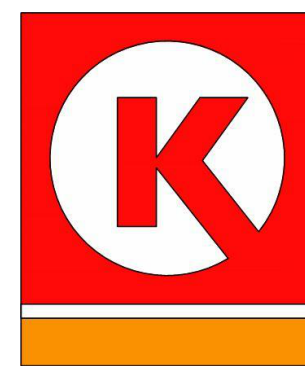


CIRCLE K STORES, INC.

PROJECT NUMBER: 25172


ROOF FRAMING
DETAILS

S3.0

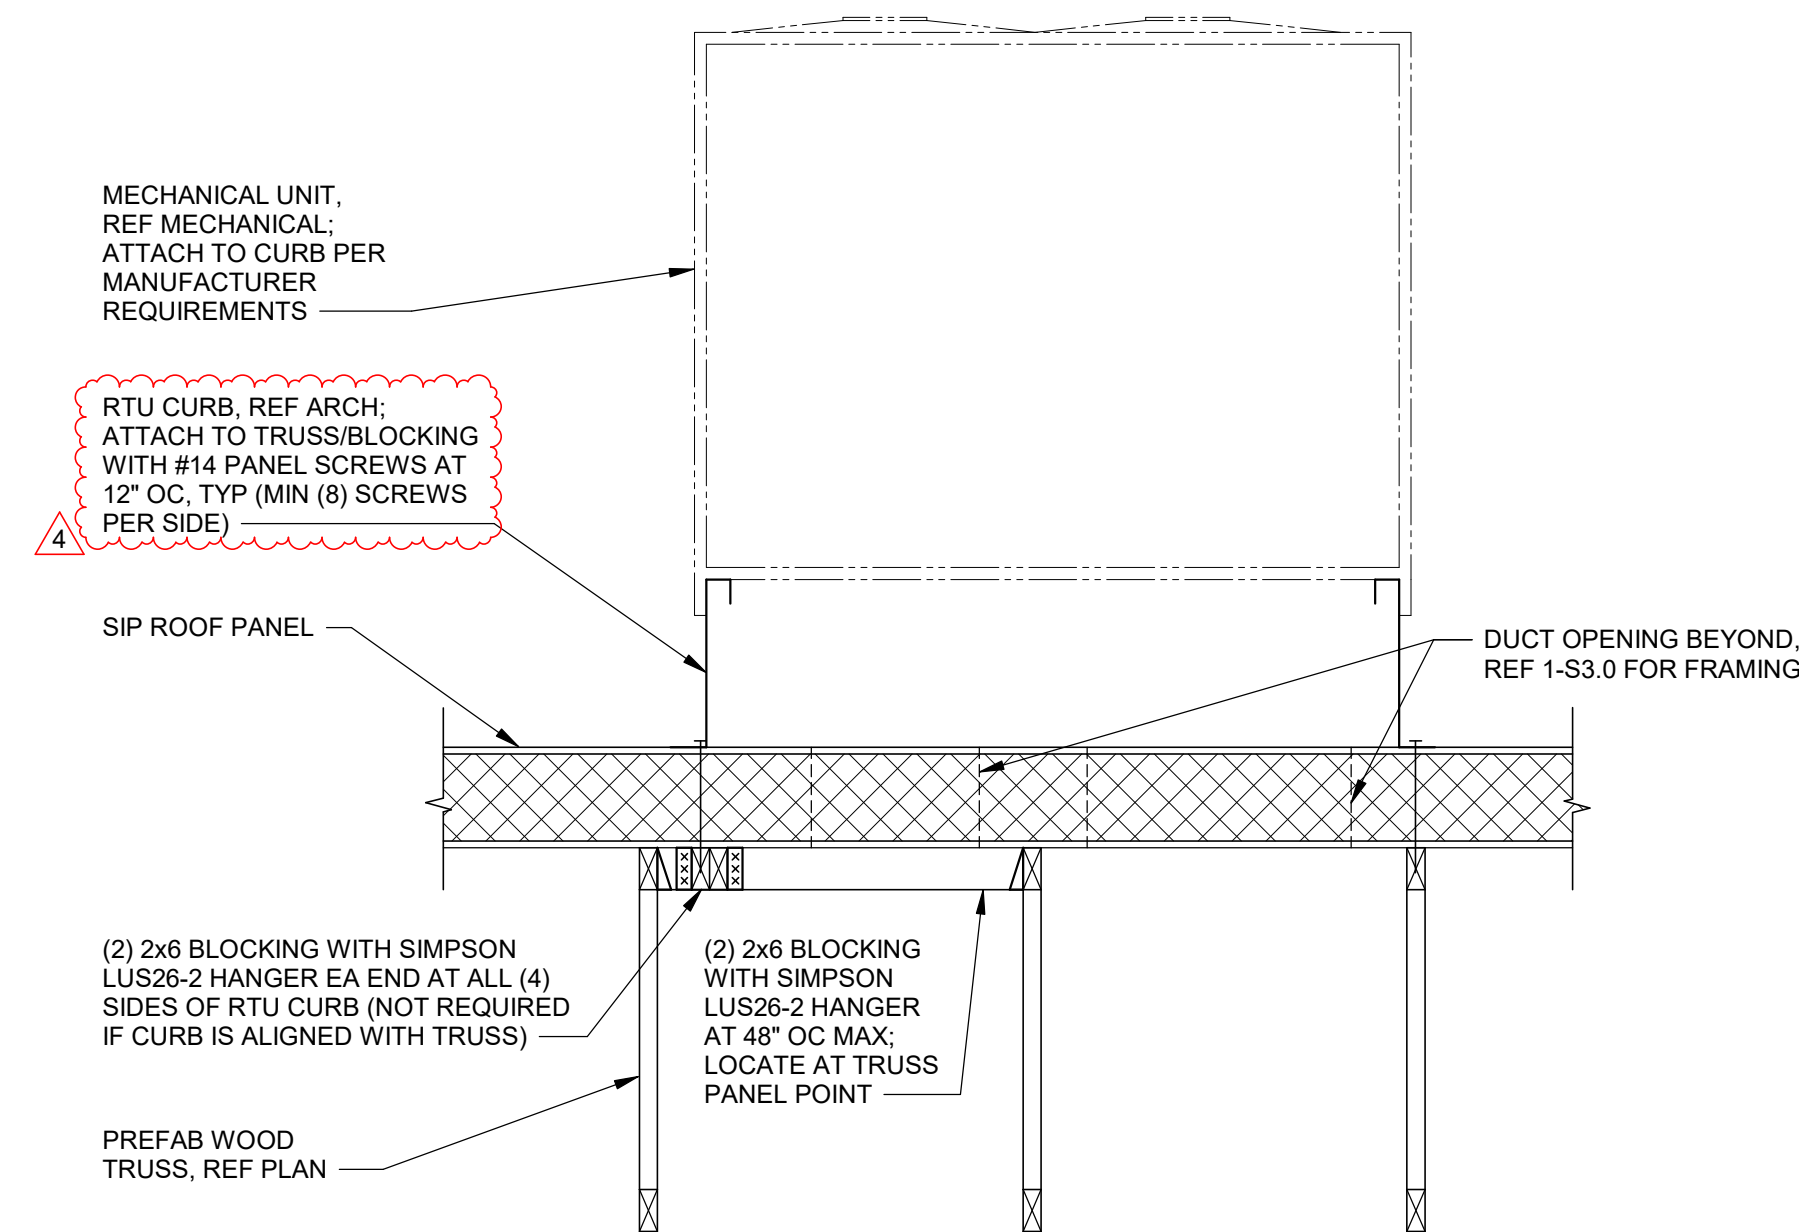


RTU SUPPORT | 3

3/4" = 1'-0"

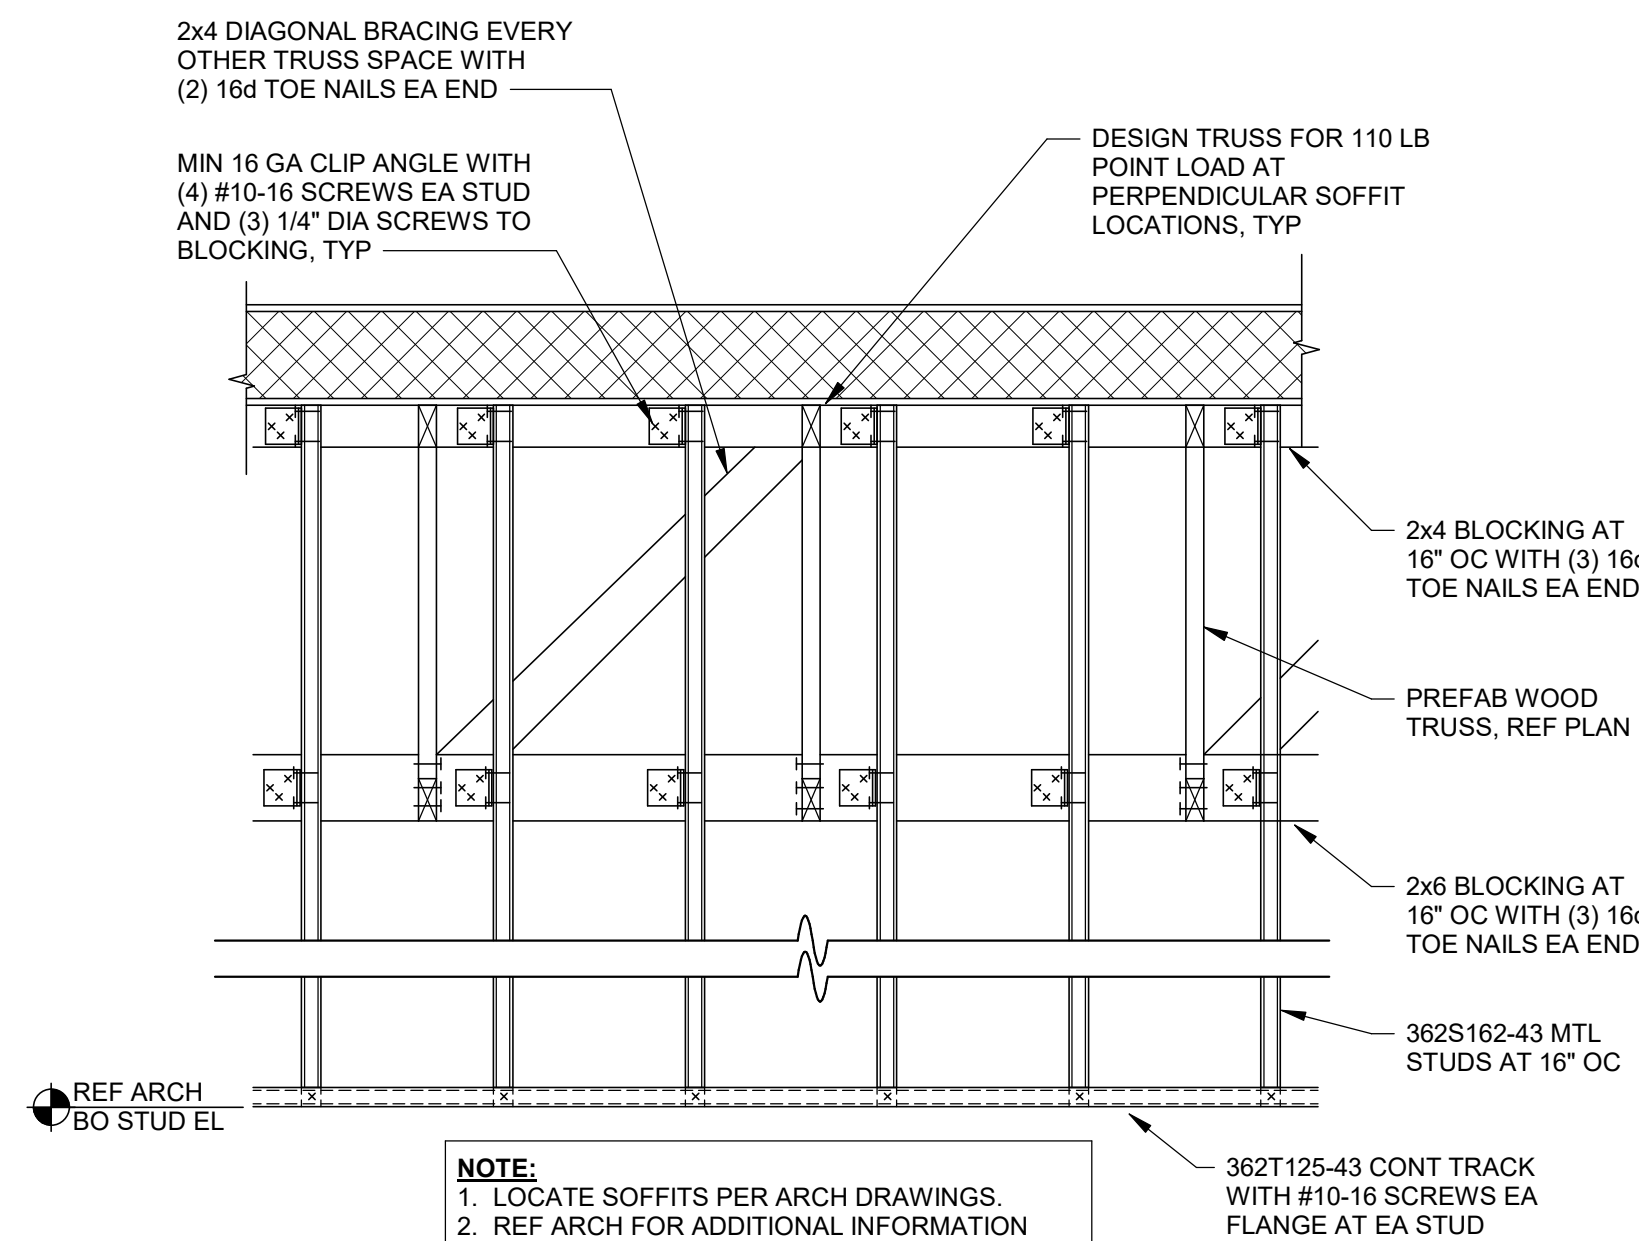


SOFFIT DETAIL PERPENDICULAR TO TRUSS | 5

3/4" = 1'-0"

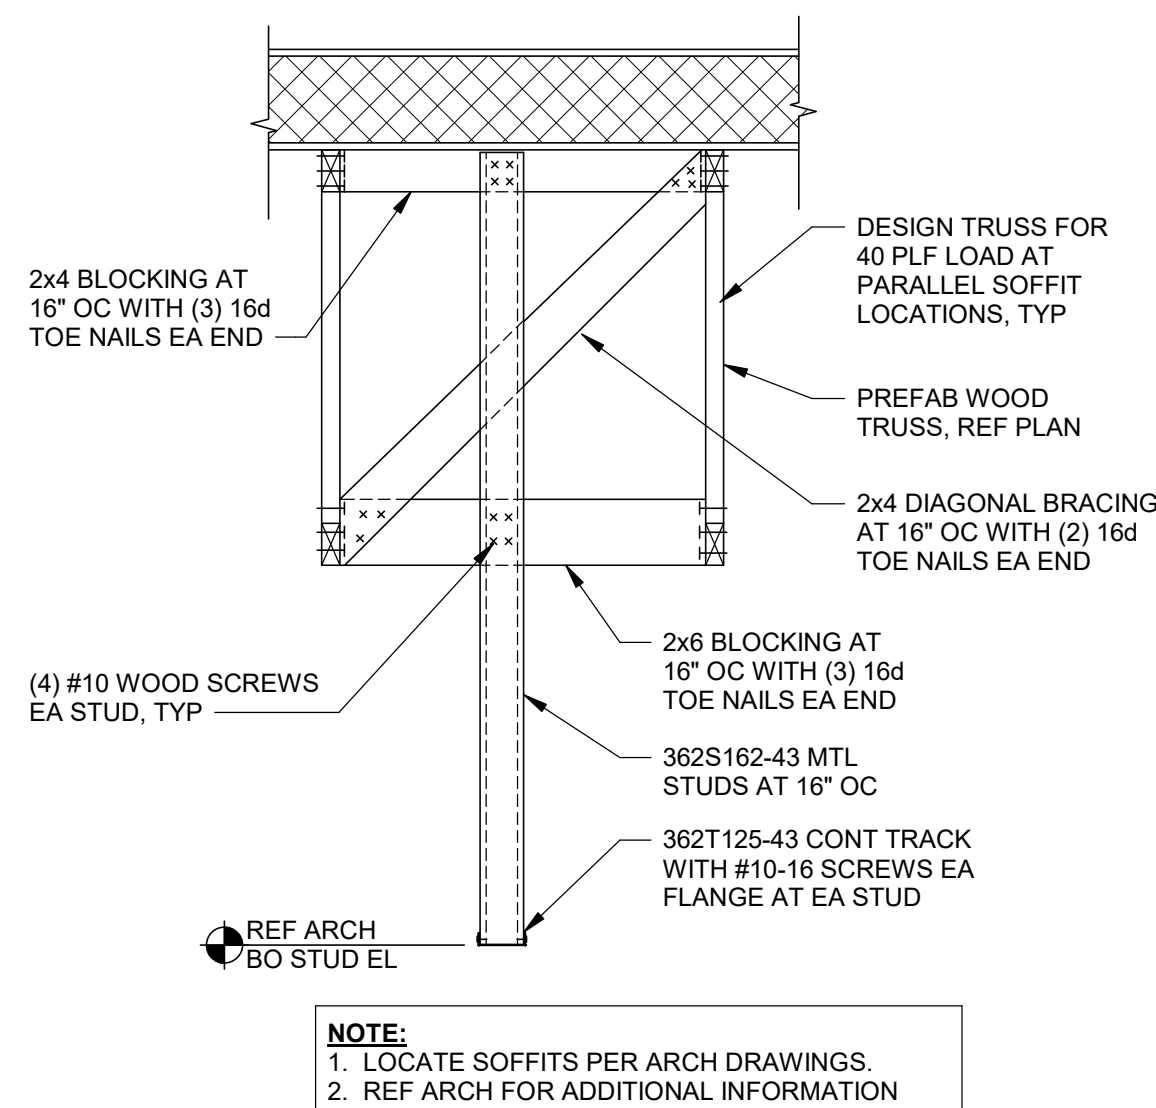


SOFFIT DETAIL PARALLEL TO TRUSS | 4

3/4" = 1'-0"

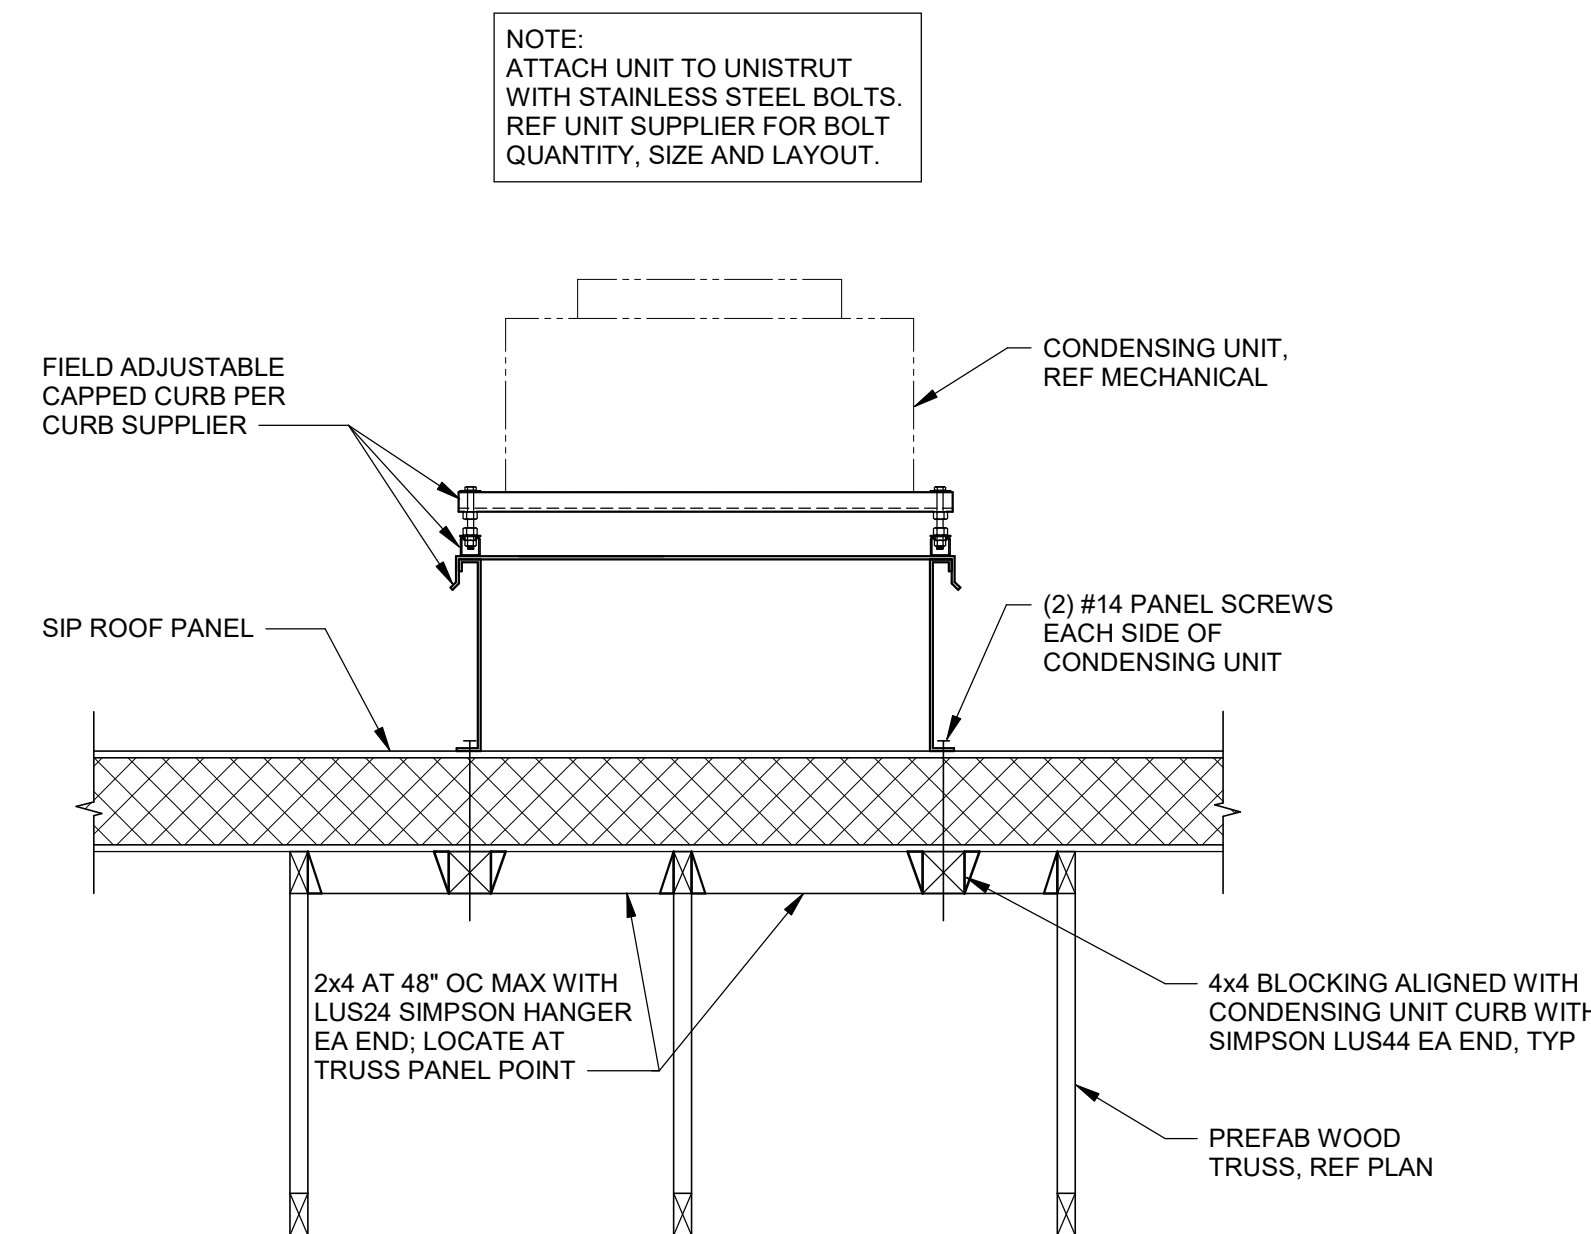

CONDENSING UNIT SUPPORT | 2

NTS

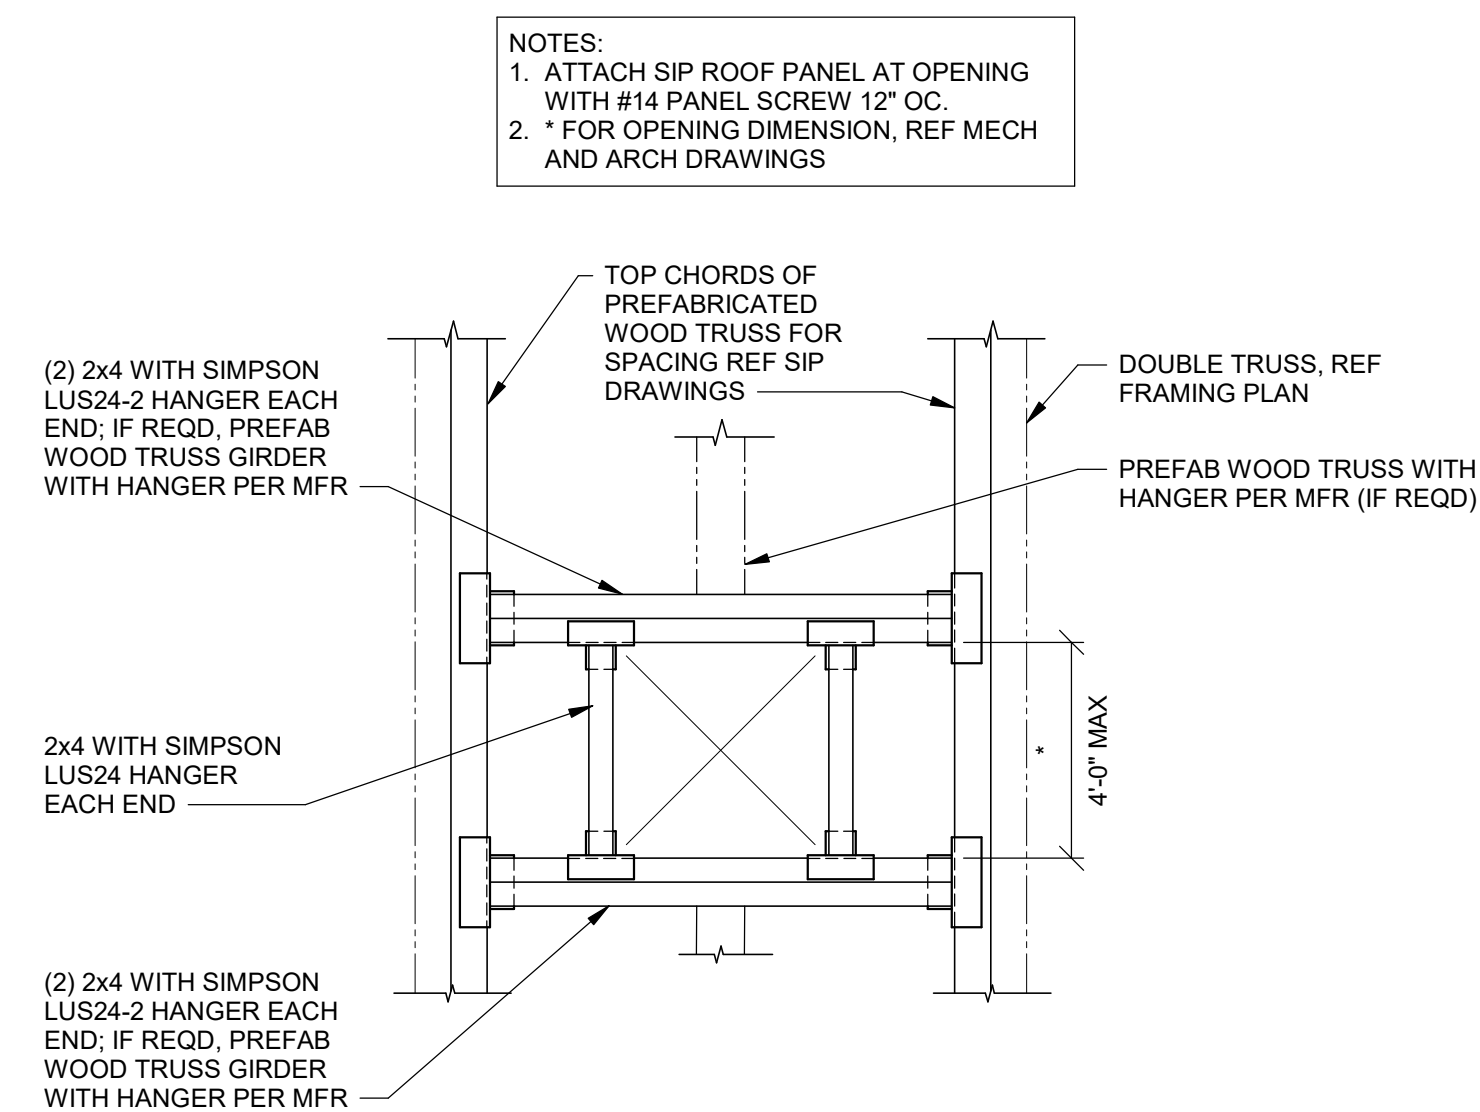

TYP FRAMING AROUND SMALL ROOF OPNG | 1

NTS