


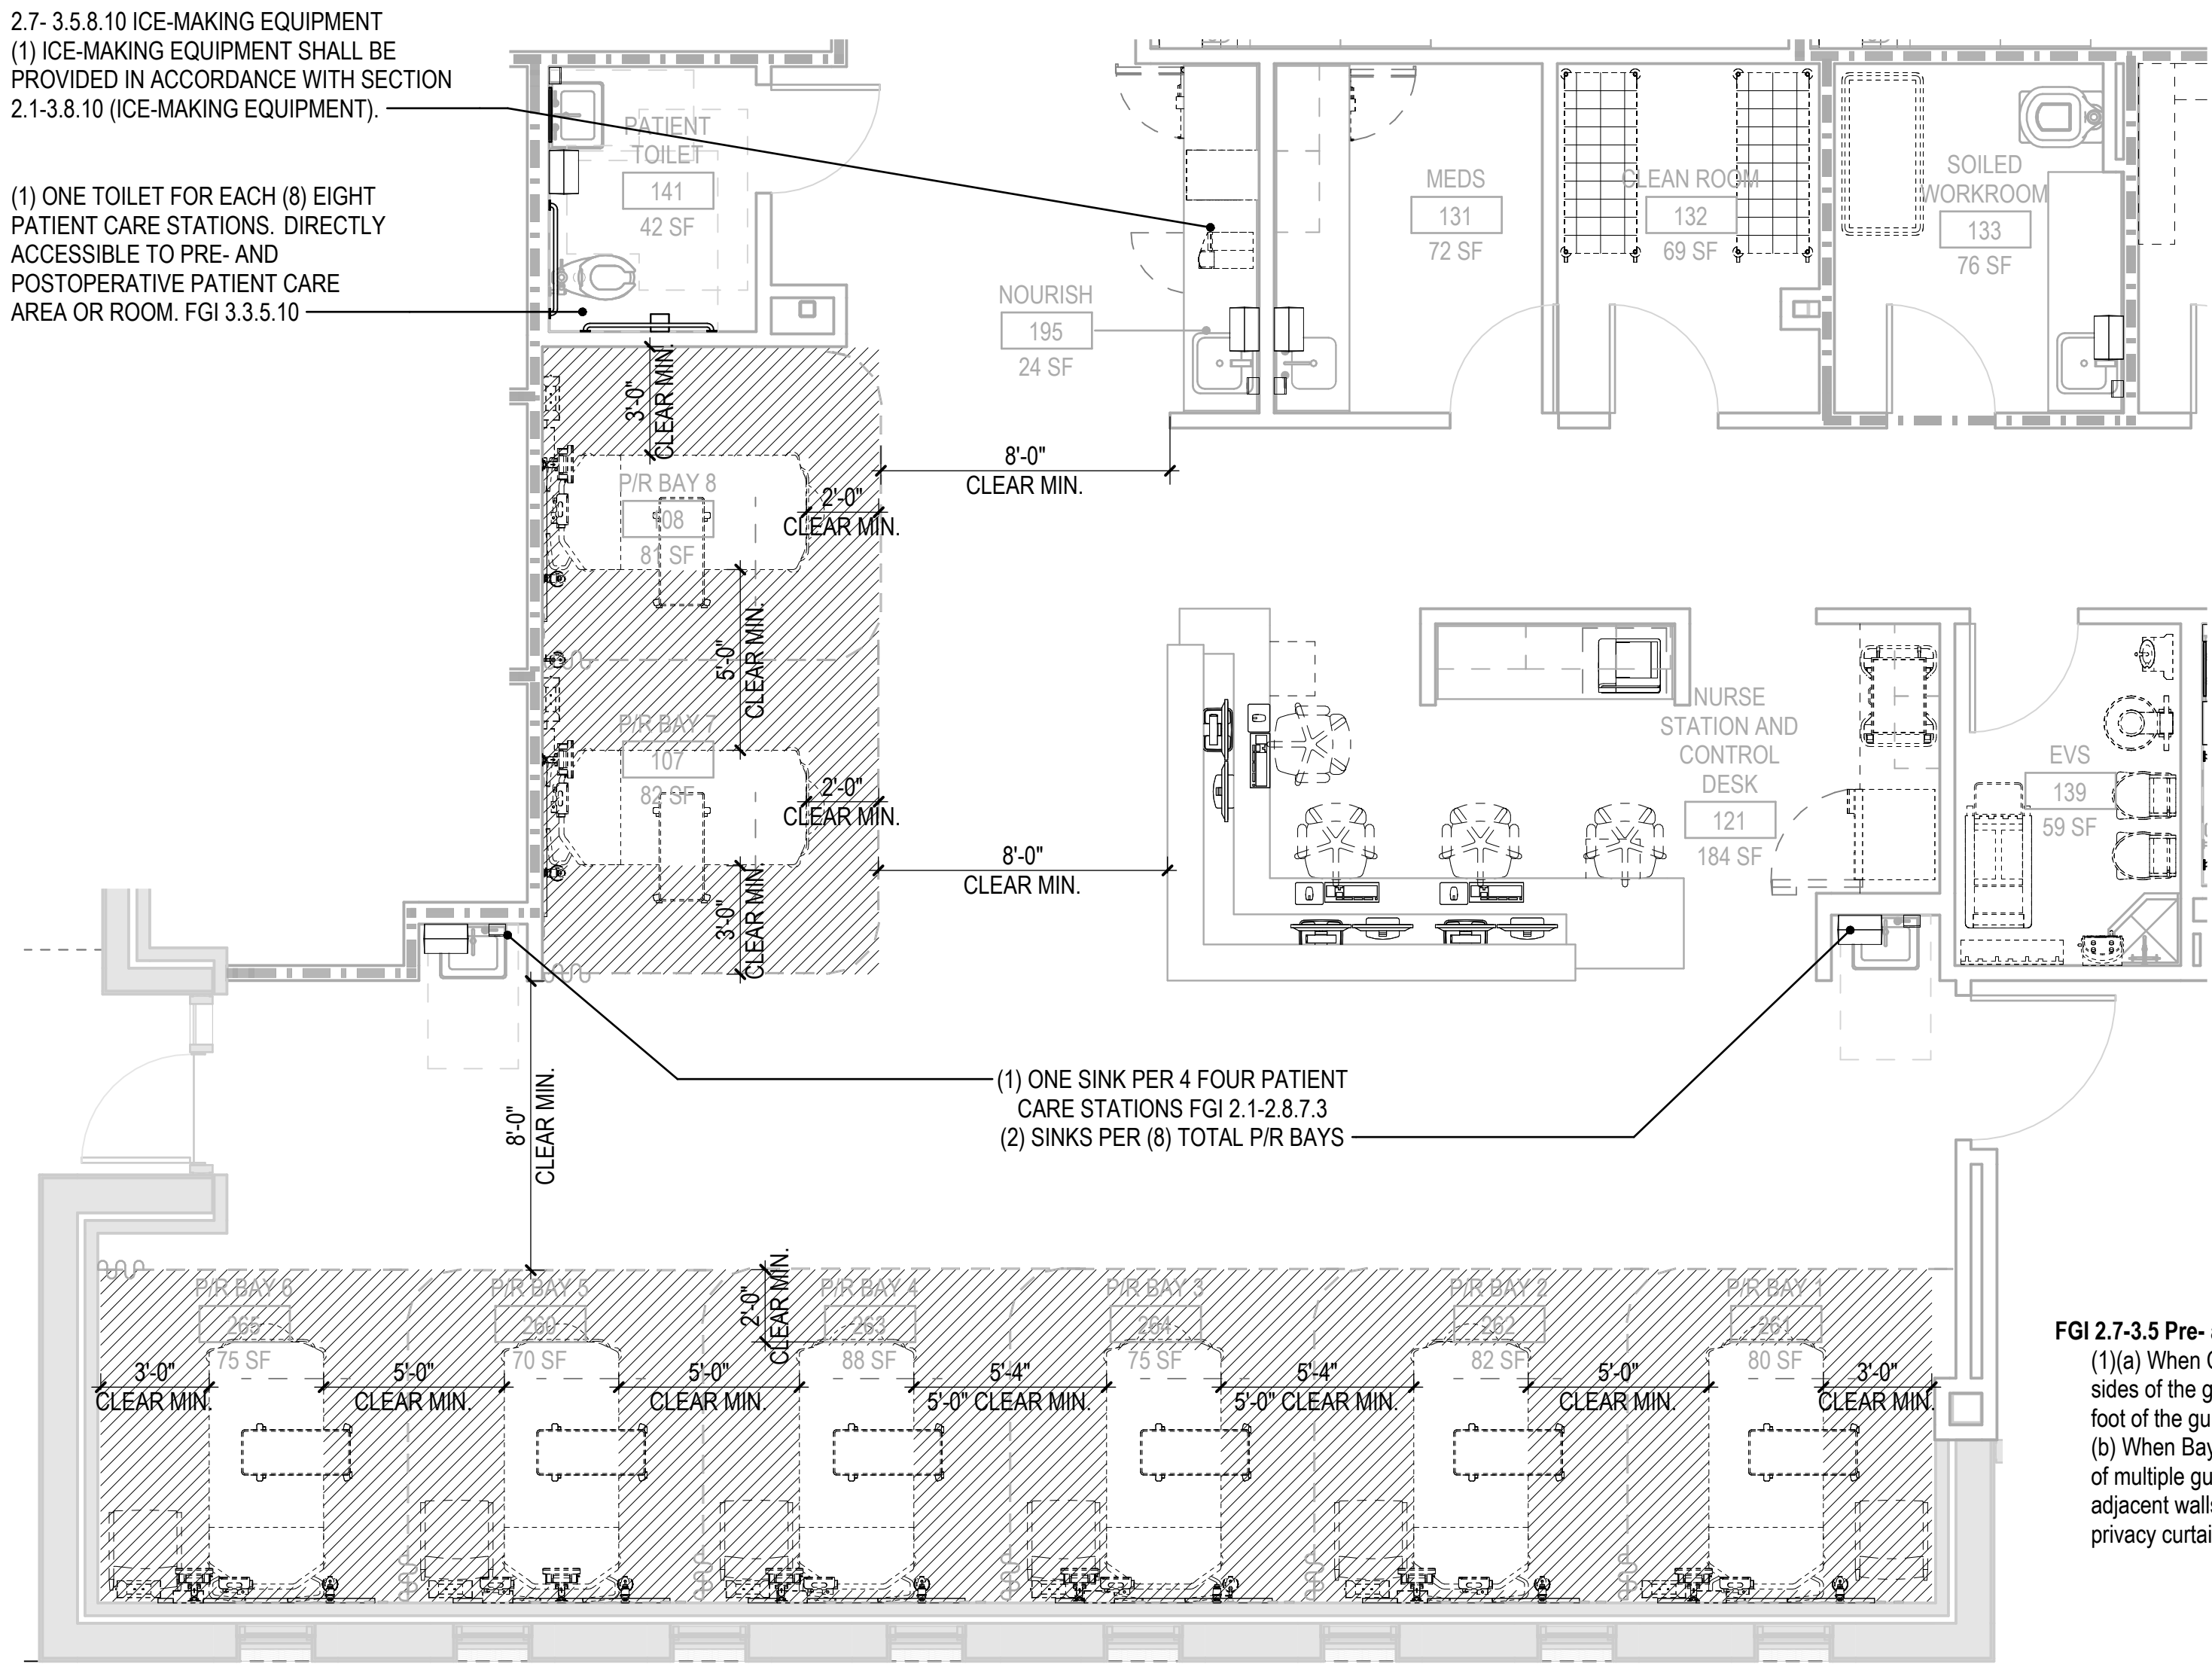


2.7-3.5.8.10 ICE-MAKING EQUIPMENT
(1) ICE-MAKING EQUIPMENT SHALL BE PROVIDED IN ACCORDANCE WITH SECTION 2.1-3.8.10 (ICE-MAKING EQUIPMENT).

(1) ONE TOILET FOR EACH (8) EIGHT PATIENT CARE STATIONS. DIRECTLY ACCESSIBLE TO PRE- AND POSTOPERATIVE PATIENT CARE AREA OR ROOM. FGI 3.3.5.10

(1) ONE SINK PER 4 FOUR PATIENT CARE STATIONS FGI 2.1-2.8.7.3
(2) SINKS PER (8) TOTAL PIR BAYS


BAYS

FGI 2.7-3.5 Pre- and Postoperative Patient Care Areas
(1)(a) When Cubicles are used, 3'-0" is provided between the sides of the gurneys and adjacent walls, and 2'-0" between the foot of the gurney and the privacy curtain.
(b) When Bays are provided, 5'-0" is provided between the sides of multiple gurneys, 3'-0" between the sides of the gurneys and adjacent walls, and 2'-0" between the foot of the gurney and the privacy curtain.

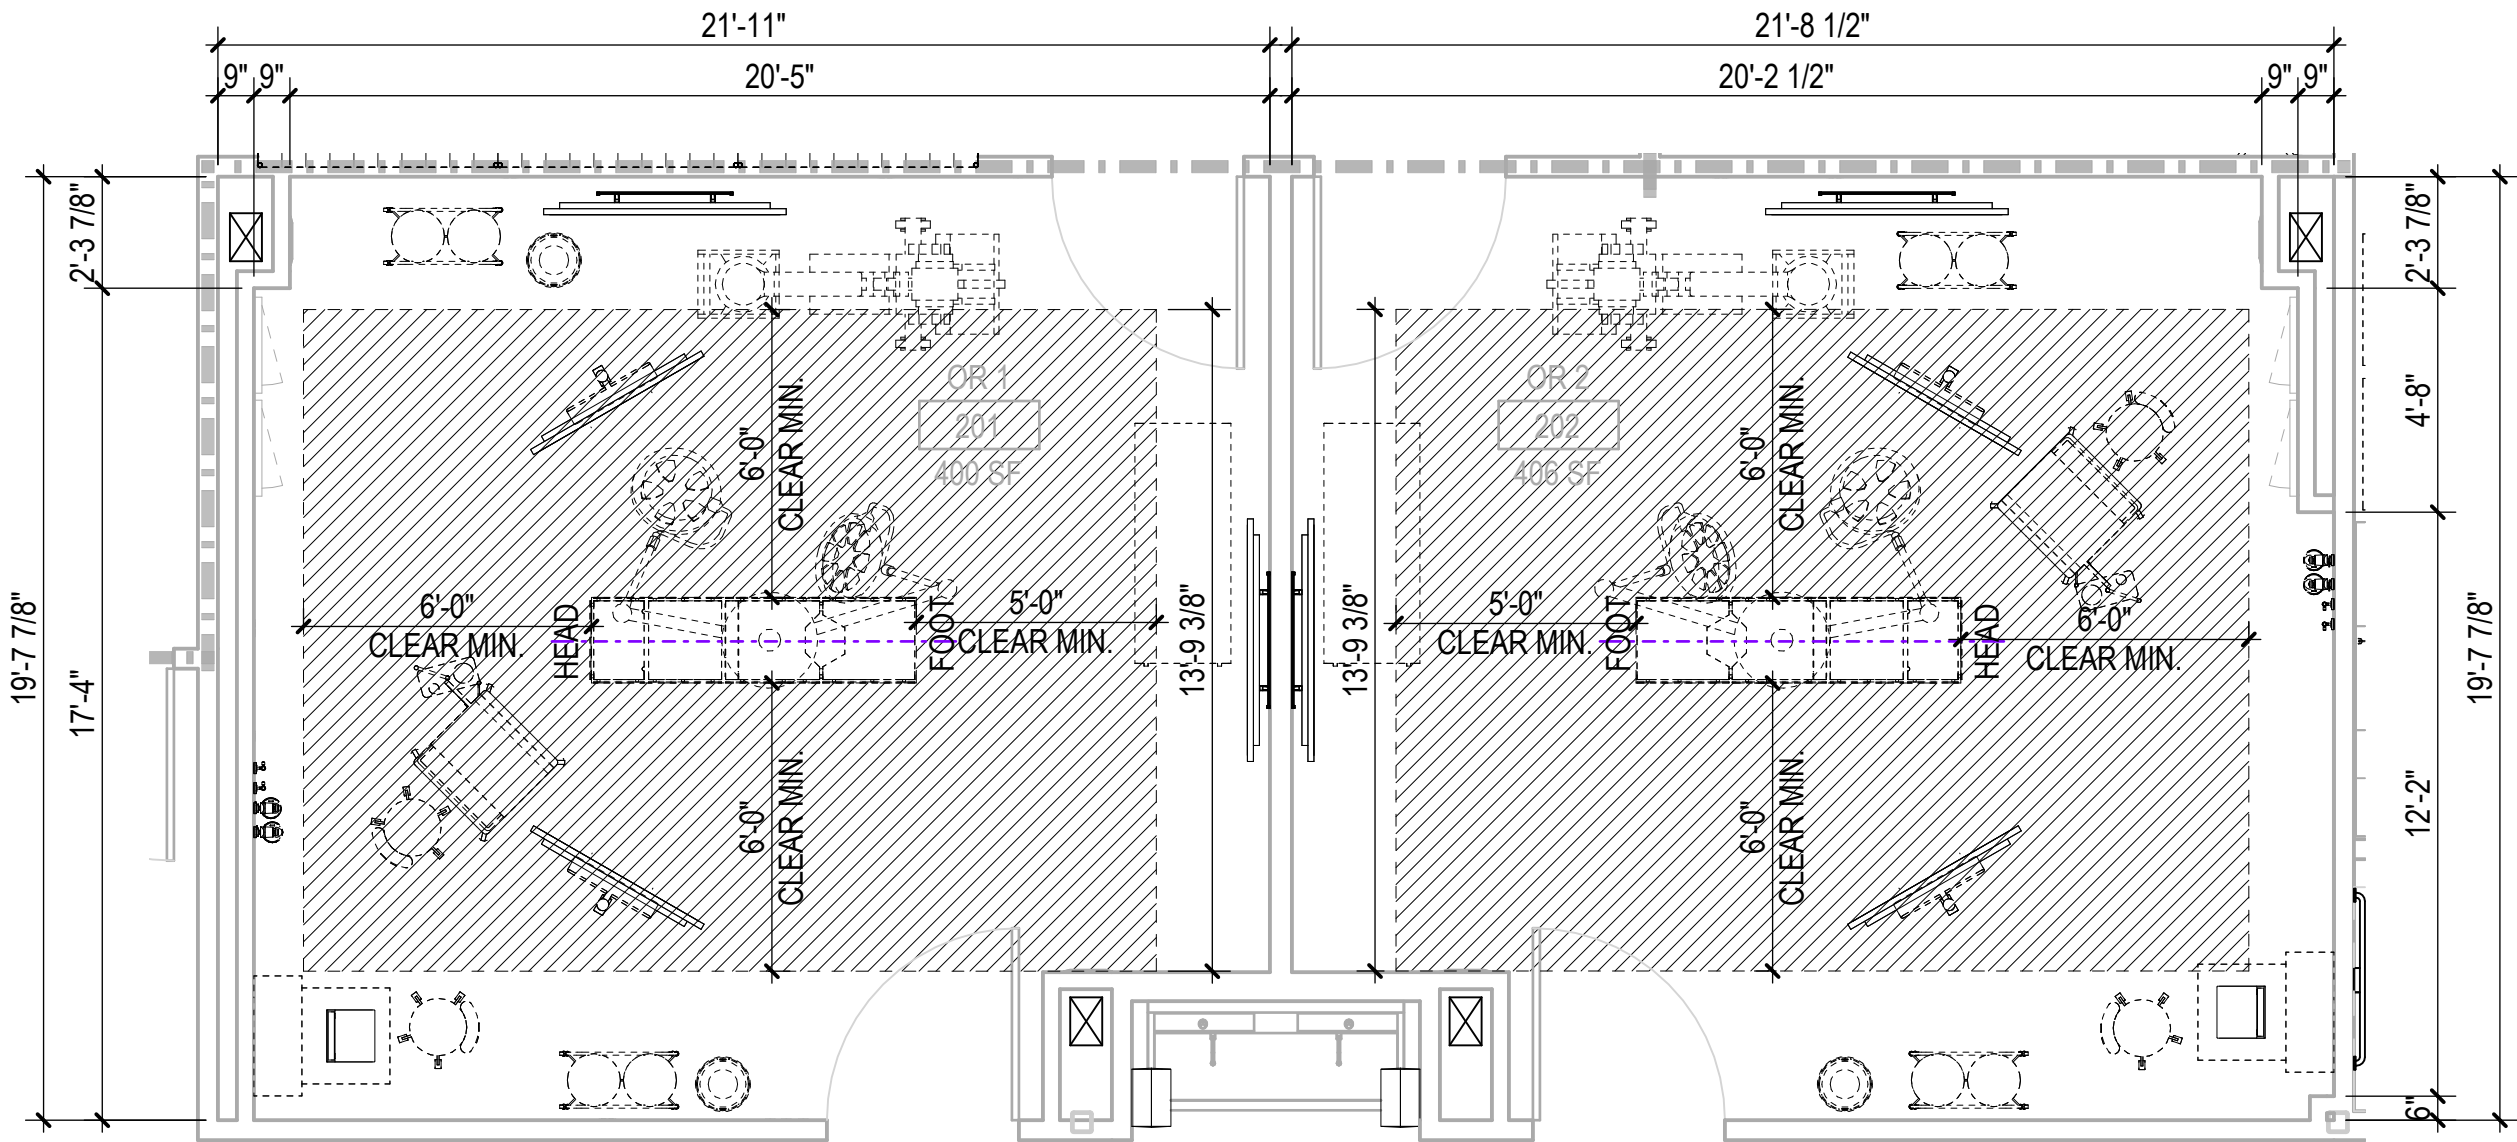

OPERATING ROOM


FGI 2.1-3.2.3 (Operating Rooms)
(1) Area
(a) An operating room shall have a minimum clear floor area of 255 square feet (23.69 square meters).
(b) An operating room where anesthetics will be administered using an anesthesia machine and supply cart shall have a minimum clear floor area of 270 square feet (25.08 square meters).
(c) An operating room where surgery that may require additional staff and equipment will be performed shall have a minimum clear floor area of 400 square feet (37.16 square meters).
(2) Clearances. The following minimum clearances shall be provided around the operating table, gurney, or procedural chair:
(a) For a 255-square-foot operating room:
(i) 6 feet (1.83 meters) on each side
(ii) 5 feet (1.52 meters) at the head and foot
(b) For a 270-square-foot operating room:
(i) 6 feet (1.83 meters) on each side
(ii) 6 feet x 8 feet (1.83 meters x 2.4 meters) at the head. This shall result in an anesthesia work zone with a clear floor area of 48 square feet (4.46 square meters).
(iii) 5 feet (1.52 meters) at the foot
(c) For a 400-square-foot operating room:
(i) 8 feet 6 inches (2.59 meters) on each side
(ii) 6 feet (1.83 meters) at the head. This dimension shall result in an anesthesia work

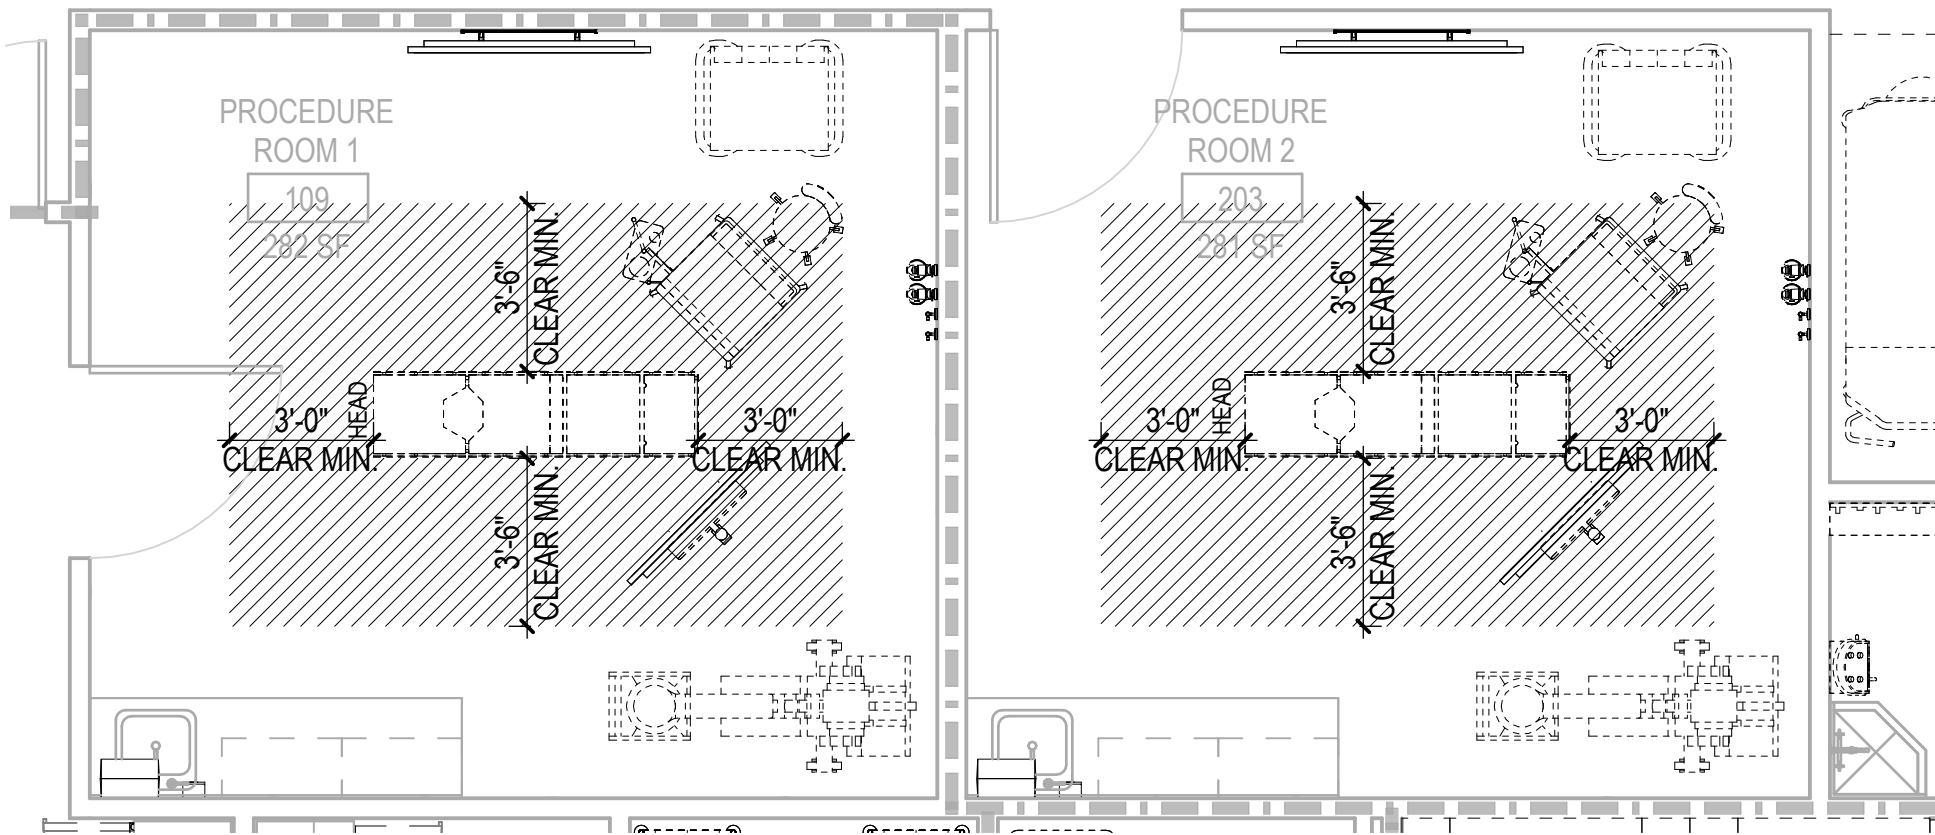

PROCEDURE ROOM

FGI 2.1-3.2.2 (Procedure Rooms)
(1) Area
(a) Procedure rooms shall have a minimum clear floor area of 130 square feet (12.08 square meters).
(b) Procedure rooms where anesthetics will be administered using an anesthesia machine and supply cart shall have a minimum clear floor area of 160 square feet (14.86 square meters).
(c) Procedure rooms where procedures will be performed that require additional personnel and/or large equipment shall be sized to accommodate the personnel and equipment planned to be in the room during procedures, including any additional personnel and equipment needed for emergency rescue.
(2) Clearances
(a) Procedure rooms shall have the following minimum clearances around the procedure table, gurney, or procedural chair:
(i) 3 feet 6 inches (1.07 meters) on each side
(ii) 3 feet (91.44 centimeters) at the head and foot

SEAL

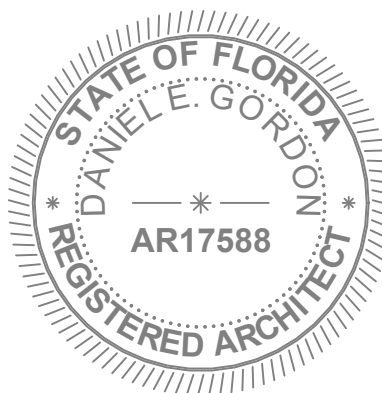

DANIEL E. GORDON, AIA AR17588

DEUK SPINE
INSTITUTE
Surgery Center at Millenia, LLC

Hunton Brady
ARCHITECTS

DATE	SUBMISSION	NO.
12.12.23	CONSTRUCTION DOCUMENTS	

FGI GUIDELINES

PROJ. NO. H-23016.00 SHEET
DRAWN AA

G102