
FUNCTION OF SPACE	AREA	LOAD FACTOR	OCCUPANT LOAD
Business areas	18,434 SF	150 SF	123
1ST LEVEL	18,434 SF		123
TOTAL	18,434 SF		123

EGRESS WIDTH REQUIRED = 192 * 0.2 = 238"
EGRESS WIDTH PROVIDED = 332"

EXIT ACCESS DISTANCE ALLOWABLE = 200 FEET
EXIT ACCESS DISTANCE AS DESIGNED = 120'-10"

COMMON PATH ALLOWABLE = 100 FEET
COMMON PATH AS DESIGNED = 0 FEET

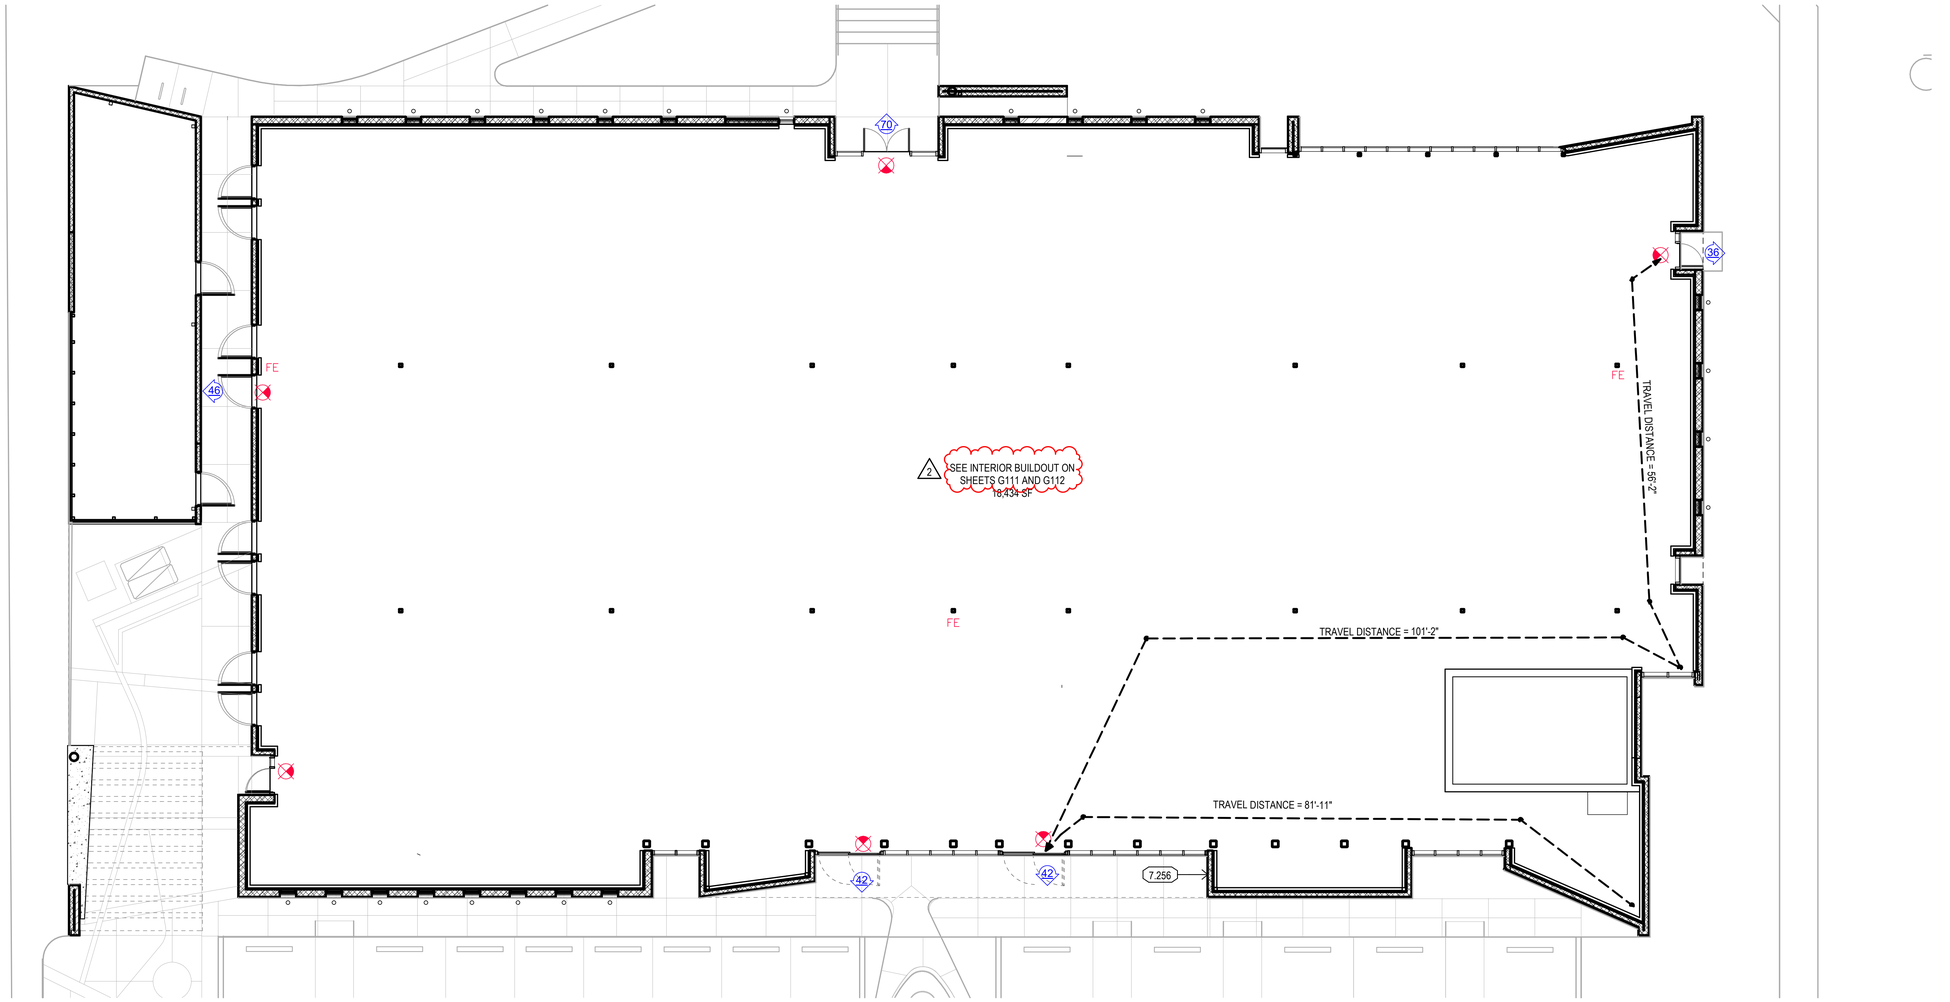

LIFE SAFETY LEGEND

FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FVC	FIRE VALVE CABINET WITH EXTINGUISHER
FB	FIRE BLANKET
	ACCESS CONTROL
	MAGNETIC HOLD OPEN
MD	MAGNETIC LOCK
	SMOKE DETECTOR
	HEAT DETECTOR
	EXIT LIGHT
	MANUAL PULL STATION
	VOICE EVACUATION SPEAKER
	AUDIBLE/VISUAL ALARM
	VISUAL ALARM
44	EXIT ARROW / CLEAR WIDTH
	LIMITS OF EXIT PASSAGEWAY
	LIMITS OF SUITES
	SMOKE RESISTANT CORRIDORS WITH PARTITIONS EXTENDED TO DECK ABOVE
	SMOKE PARTITION - SEAL ALL OPENINGS
	1-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	1-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	2-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	2-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	3-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	3-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	4-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	4-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
LK07	LOCKED DOOR IDENTIFICATION RELATING TO THE PATH OF EGRESS (NFPA 101)
FE	FREE EGRESS DOOR: NO EXISTING OR NEW LOCKING MECHANISMS TO PREVENT EGRESS
AC	SENSOR-RELEASE EGRESS DOOR (7.2.1.6.2 & 18.2.2.2.4)
DE	DELAYED-EGRESS EGRESS DOOR (7.2.1.6.1 & 18.2.2.2.4)
LK1	LOCKED DOOR: DOOR NOT CONSIDERED TO BE AN EXIT OR REQUIRED FOR EGRESS
LK2	LOCKED DOOR: CLINICAL OR SPECIAL NEEDS (18.2.2.2.4(1) & 18.2.2.2.5)

GENERAL PLAN NOTES

1. CONSTRUCTION TOLERANCES ARE CRITICAL TO UNFORM ENFORECEMNT OF CODE PROVISIONS. WHEN RANGES ARE SPECIFIED MAXIMUM/ MINIMUM REQUIREMENTS REINSTALLATION OF THE ITEM WELL BE REQUIRED. IF A SPECIFIC ITEM IS REQUIRED BY CODE TO BE A SPECIFIC DIMENSION THEN A CONSTRUCTION TOLERANCE OF +/- 1/4" IS PERMITTED. IF THE ITEM IS INSTALLED OUTSIDE OF THE CONSTRUCTION TOLERANCE REINSTALLATION WILL BE REQUIRED.
2. REFER TO ELECTRICAL AND FIRE ALARM DRAWINGS FOR LOCATIONS OF EXIT LIGHTS, EMERGENCY LIGHTS, AND FIRE ALARM SYSTEM.
3. REFER TO FIRE PROTECTION SPRINKLER DRAWINGS FOR LOCATIONS OF SPRINKLERS AND FIRE PUMP.
4. REFER TO PLUMBING DRAWINGS FOR PLUMBING FIXTURE COUNTS.
5. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL LOADS.
6. CLOSER AT RATED PARTION DOORS IN RATED PARTITIONS SHALL HAVE SELF-CLOSING DEVICES COORDONATION WITH RATED CONSTRUCTION. CROSS CORRIDOR DOORS ON HOLD-OPENS SHALL BE TIED TO FIRE ALARM SYSTEM TO RELEASE AS APPROPRIATE.
7. ALL F.M.E.P. ELEMENTS THAT PENETRATE RATED WALL, CEILING, FLOOR ASSEMBLIES MUST HAVE FIRE DAMPERS/ CONDUITS/ SEALS OF THE SAME RATING OF ELEMENT PENETRATED.

GENERAL NOTES

7.256	key lock box tied to fire alarm system

SEAL

STATE OF FLORIDA · DANIEL E. GORDON · AR17588 · REGISTERED ARCHITECT

This item has been electronically signed and sealed by Daniel E. Gordon, AIA on the Date and/or Time Stamp shown using a digital signature.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

DEUK SPINE INSTITUTE

Surgery Center at Millenia, LLC

Hunton Brady ARCHITECTS

DATE	SUBMISSION	NO
12.12.23	CONSTRUCTION DOCUMENTS	
05.19.26	CCD NO. 1	1
08.07.26	CCD NO. 2R	2

LIFE SAFETY PLAN - 1ST LEVEL - CORE & SHELL

PROJ. NO. H-23016.00 SHEET
DRAWN AA
G110

2 **A1** **INTERIM LIFE SAFETY PLAN - 1ST LEVEL**
1/8" = 1'-0"

1

Copyright 2026, HuntonBrady Architects, PA.

Copyright HuntonBrady Architects P.A. All Rights Reserved. 333 S. Garland Ave., Suite 1100, Orlando, Florida 32801 (407) 839-0886 (407) 839-1709/Fax www.huntonbrady.com License AR91515