


SMOKE COMPARTMENT	COMPARTMENT OCCUPANCY	AREA (SQUARE FEET)	SQUARE FOOTAGE PER OCCUPANT	OCCUPANT EXIT CAPACITY				HORIZONTAL WIDTHS	
				OCCUPANT LOAD	HORIZONTAL CAPACITY PROVIDED (NO. OF PEOPLE)	VERTICAL (STAIR) CAPACITY PROVIDED (NO. OF PEOPLE)	TOTAL EXIT CAPACITY PROVIDED (NO. OF PEOPLE)	HORIZONTAL EXIT WIDTH REQUIRED (INCHES)	HORIZONTAL EXIT WIDTH PROVIDED (INCHES)
3.1									
3.1	BUILDING SUPPORT	58 SF	300	0	390.0	0.0	390.0	0.0	78.0
3.1	CLINIC	8,791 SF	150	59	0.0	0.0	0.0	11.8	0.0
		8,849 SF		59	390.0	0.0	390.0	11.8	78.0
	1ST LEVEL	8,849 SF		59	390.0	0.0	390.0	11.8	78.0

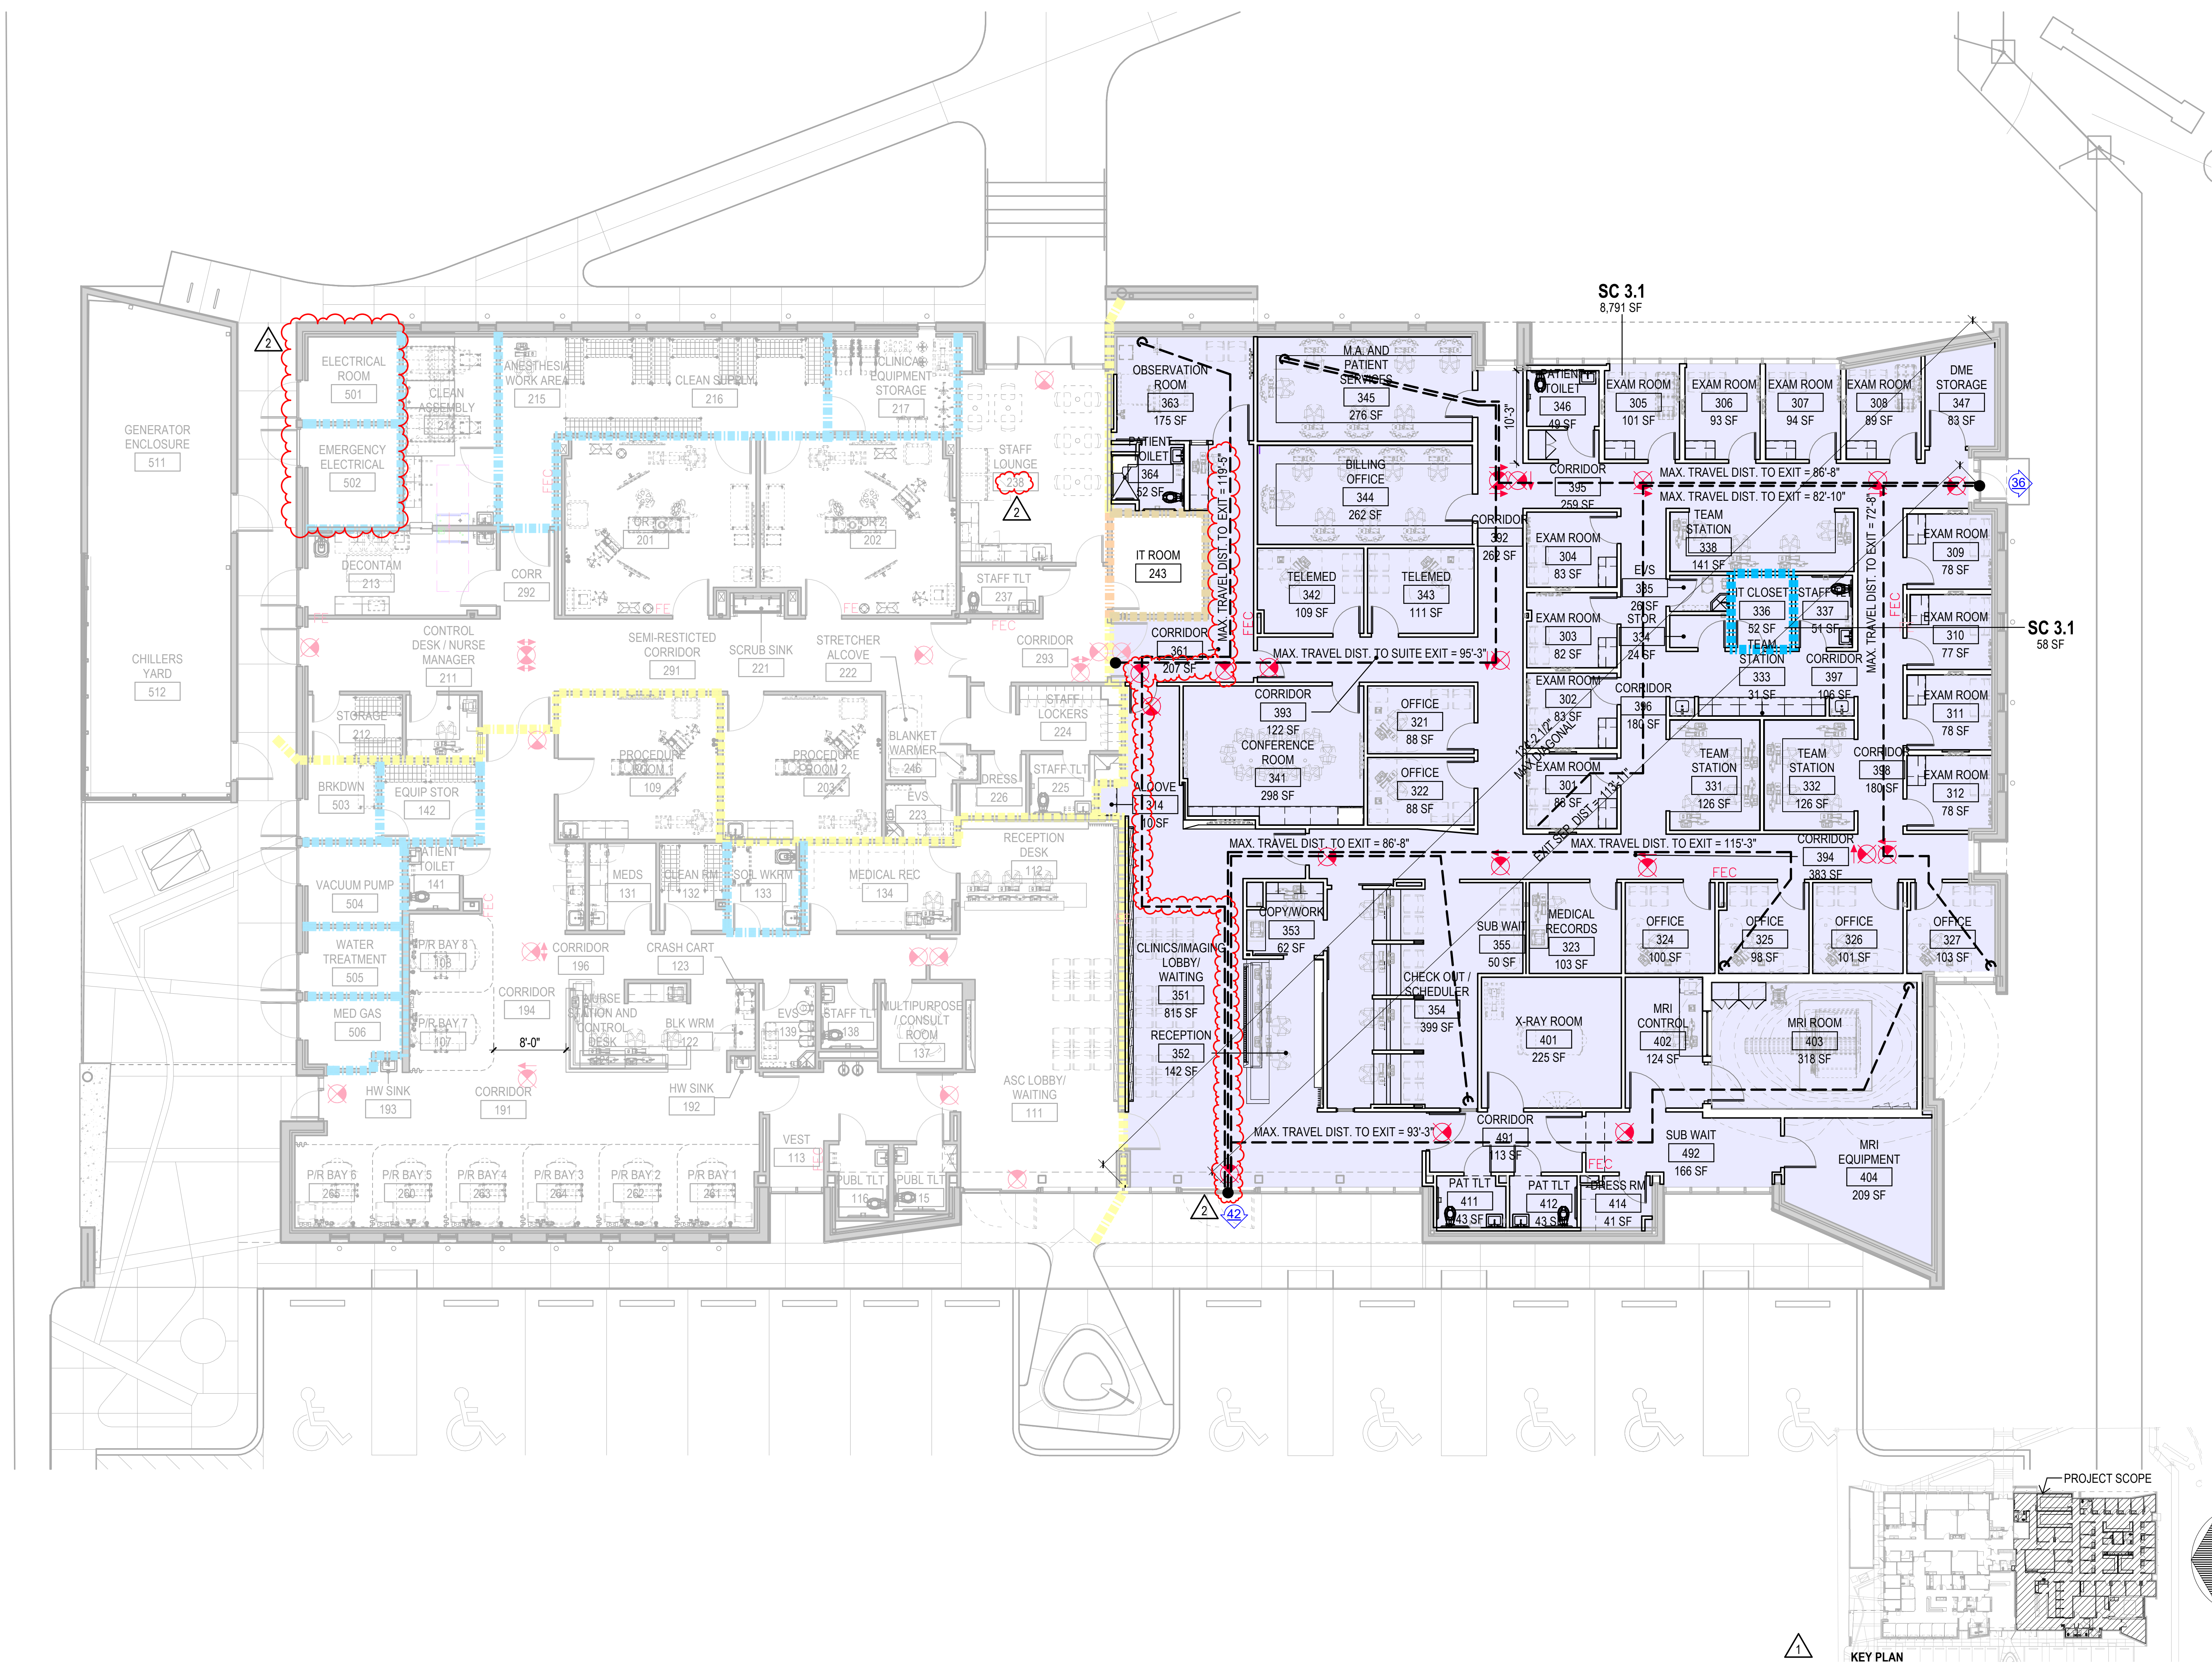

LIFE SAFETY LEGEND	
FE	FIRE EXTINGUISHER
FEG	FIRE EXTINGUISHER CABINET
FVCG	FIRE VALVE CABINET WITH EXTINGUISHER
FB	FIRE BLANKET
	ACCESS CONTROL
	MAGNETIC LOCK OPEN
	MAGNETIC LOCK
	SMOKE DETECTOR
	HEAT DETECTOR
	EXIT LIGHT
	MANUAL PULL STATION
	VOICE EVACUATION SPEAKER
	AUDIOBVISUAL ALARM
	VISUAL ALARM
	EXIT ARROW / CLEAR WIDTH
LIMITS OF EXIT PASSAGEWAY	
	
LIMITS OF SUITES	
	
SMOKE RESISTANT CORRIDORS WITH PARTITIONS EXTENDED TO CEILING ABOVE	
	
SMOKE PARTITION - SEAL ALL OPENINGS	
	1-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	1-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	2-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	2-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	3-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	3-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS
	4-HOUR FIRE BARRIER - PROTECT ALL OPENINGS
	4-HOUR FIRE/SMOKE BARRIER - PROTECT ALL OPENINGS

GENERAL PLAN NOTES

SEAL

DEUK SPINE
INSTITUTE
Surgery Center at Millenia, LLC

Hunton Brady
ARCHITECTS

DATE	SUBMISSION	NO
12.12.23	CONSTRUCTION DOCUMENTS	
05.18.26	CCD NO. 1	1
08.07.26	CCD NO. 2R	2

LIFE SAFETY PLAN - 1ST LEVEL

PROJ. NO.	H-23016.00	SHEET
DRAWN	AA	