


LEGEND

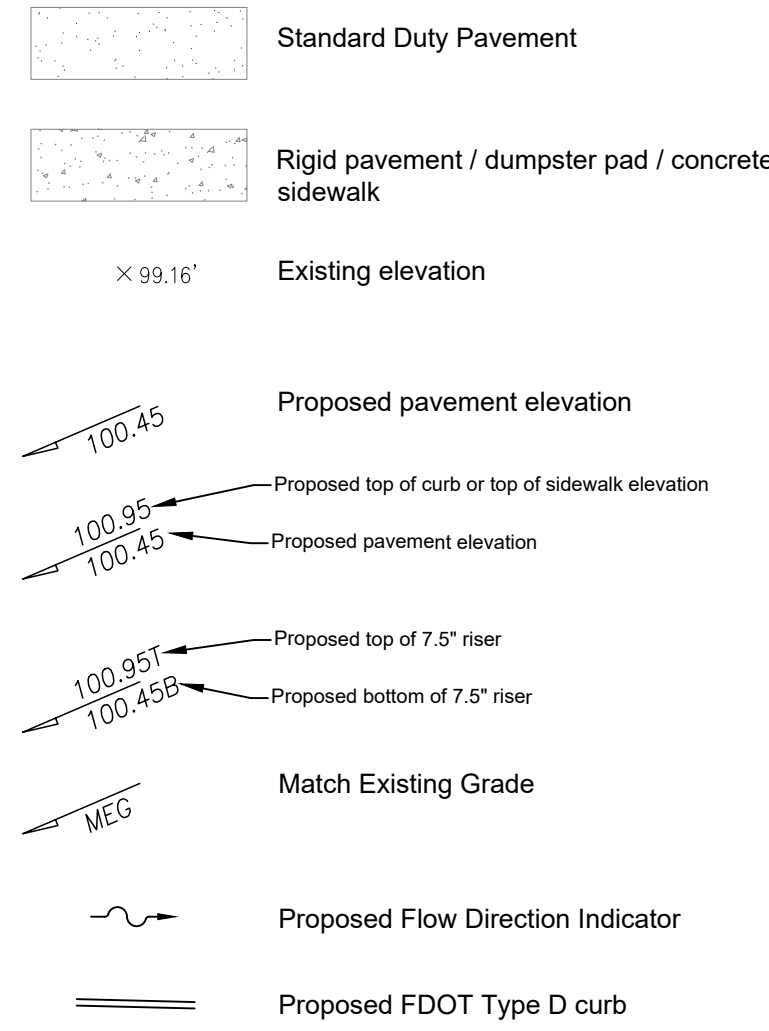


Note: Elevations shown are in NAVD83 datum; elevations reference the NAVD83 datum per the survey prepared by American Surveying, Inc.


GENERAL NOTES:

- Contractor to ensure a minimum 1% slope away from building in all landscape areas immediately adjoining the building.
- Provide below slab connection between internal, 8" roof downspout and proposed 12" ADS storm pipes. Contractor to verify downspout locations as shown on the Architect's plans prior to construction. Sizes to match pipe sizes indicated on plans.
- Contractor shall match grades at property lines unless otherwise specified.
- All quantities and linear footages identified are approximate. Contractor shall use his best judgement in evaluating and determining quantities and items as required and necessary to perform the scope of work described.
- The Contractor shall protect the off-site stormwater system from construction activity related discharges and/or runoff until Substantial Completion.
- Maintenance of Traffic shall be in accordance with FDOT Standard Plans Index 102-601 & 102-603.
- All sidewalk cross-slopes shall be a maximum of 2%. All sidewalk longitudinal slopes shall be a maximum of 5%.


Standard Duty Pavement Detail

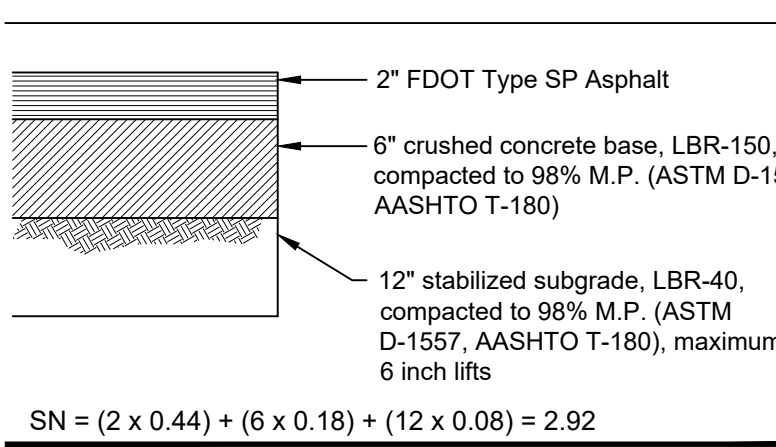

Dumpster Pad Pavement Detail

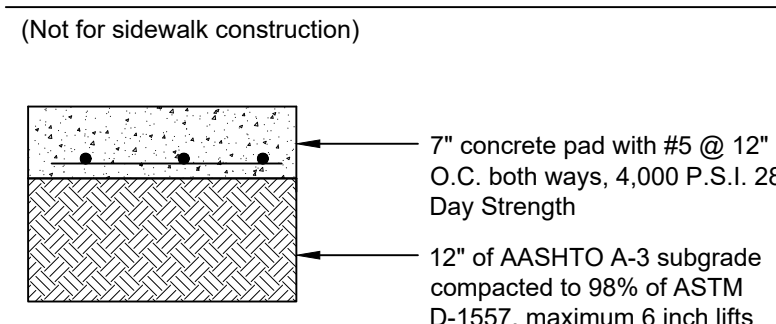

Note: The contractor shall also refer to the recommendations detailed in the Geotechnical Report prepared by Intertek PSI for this project for all pavement.

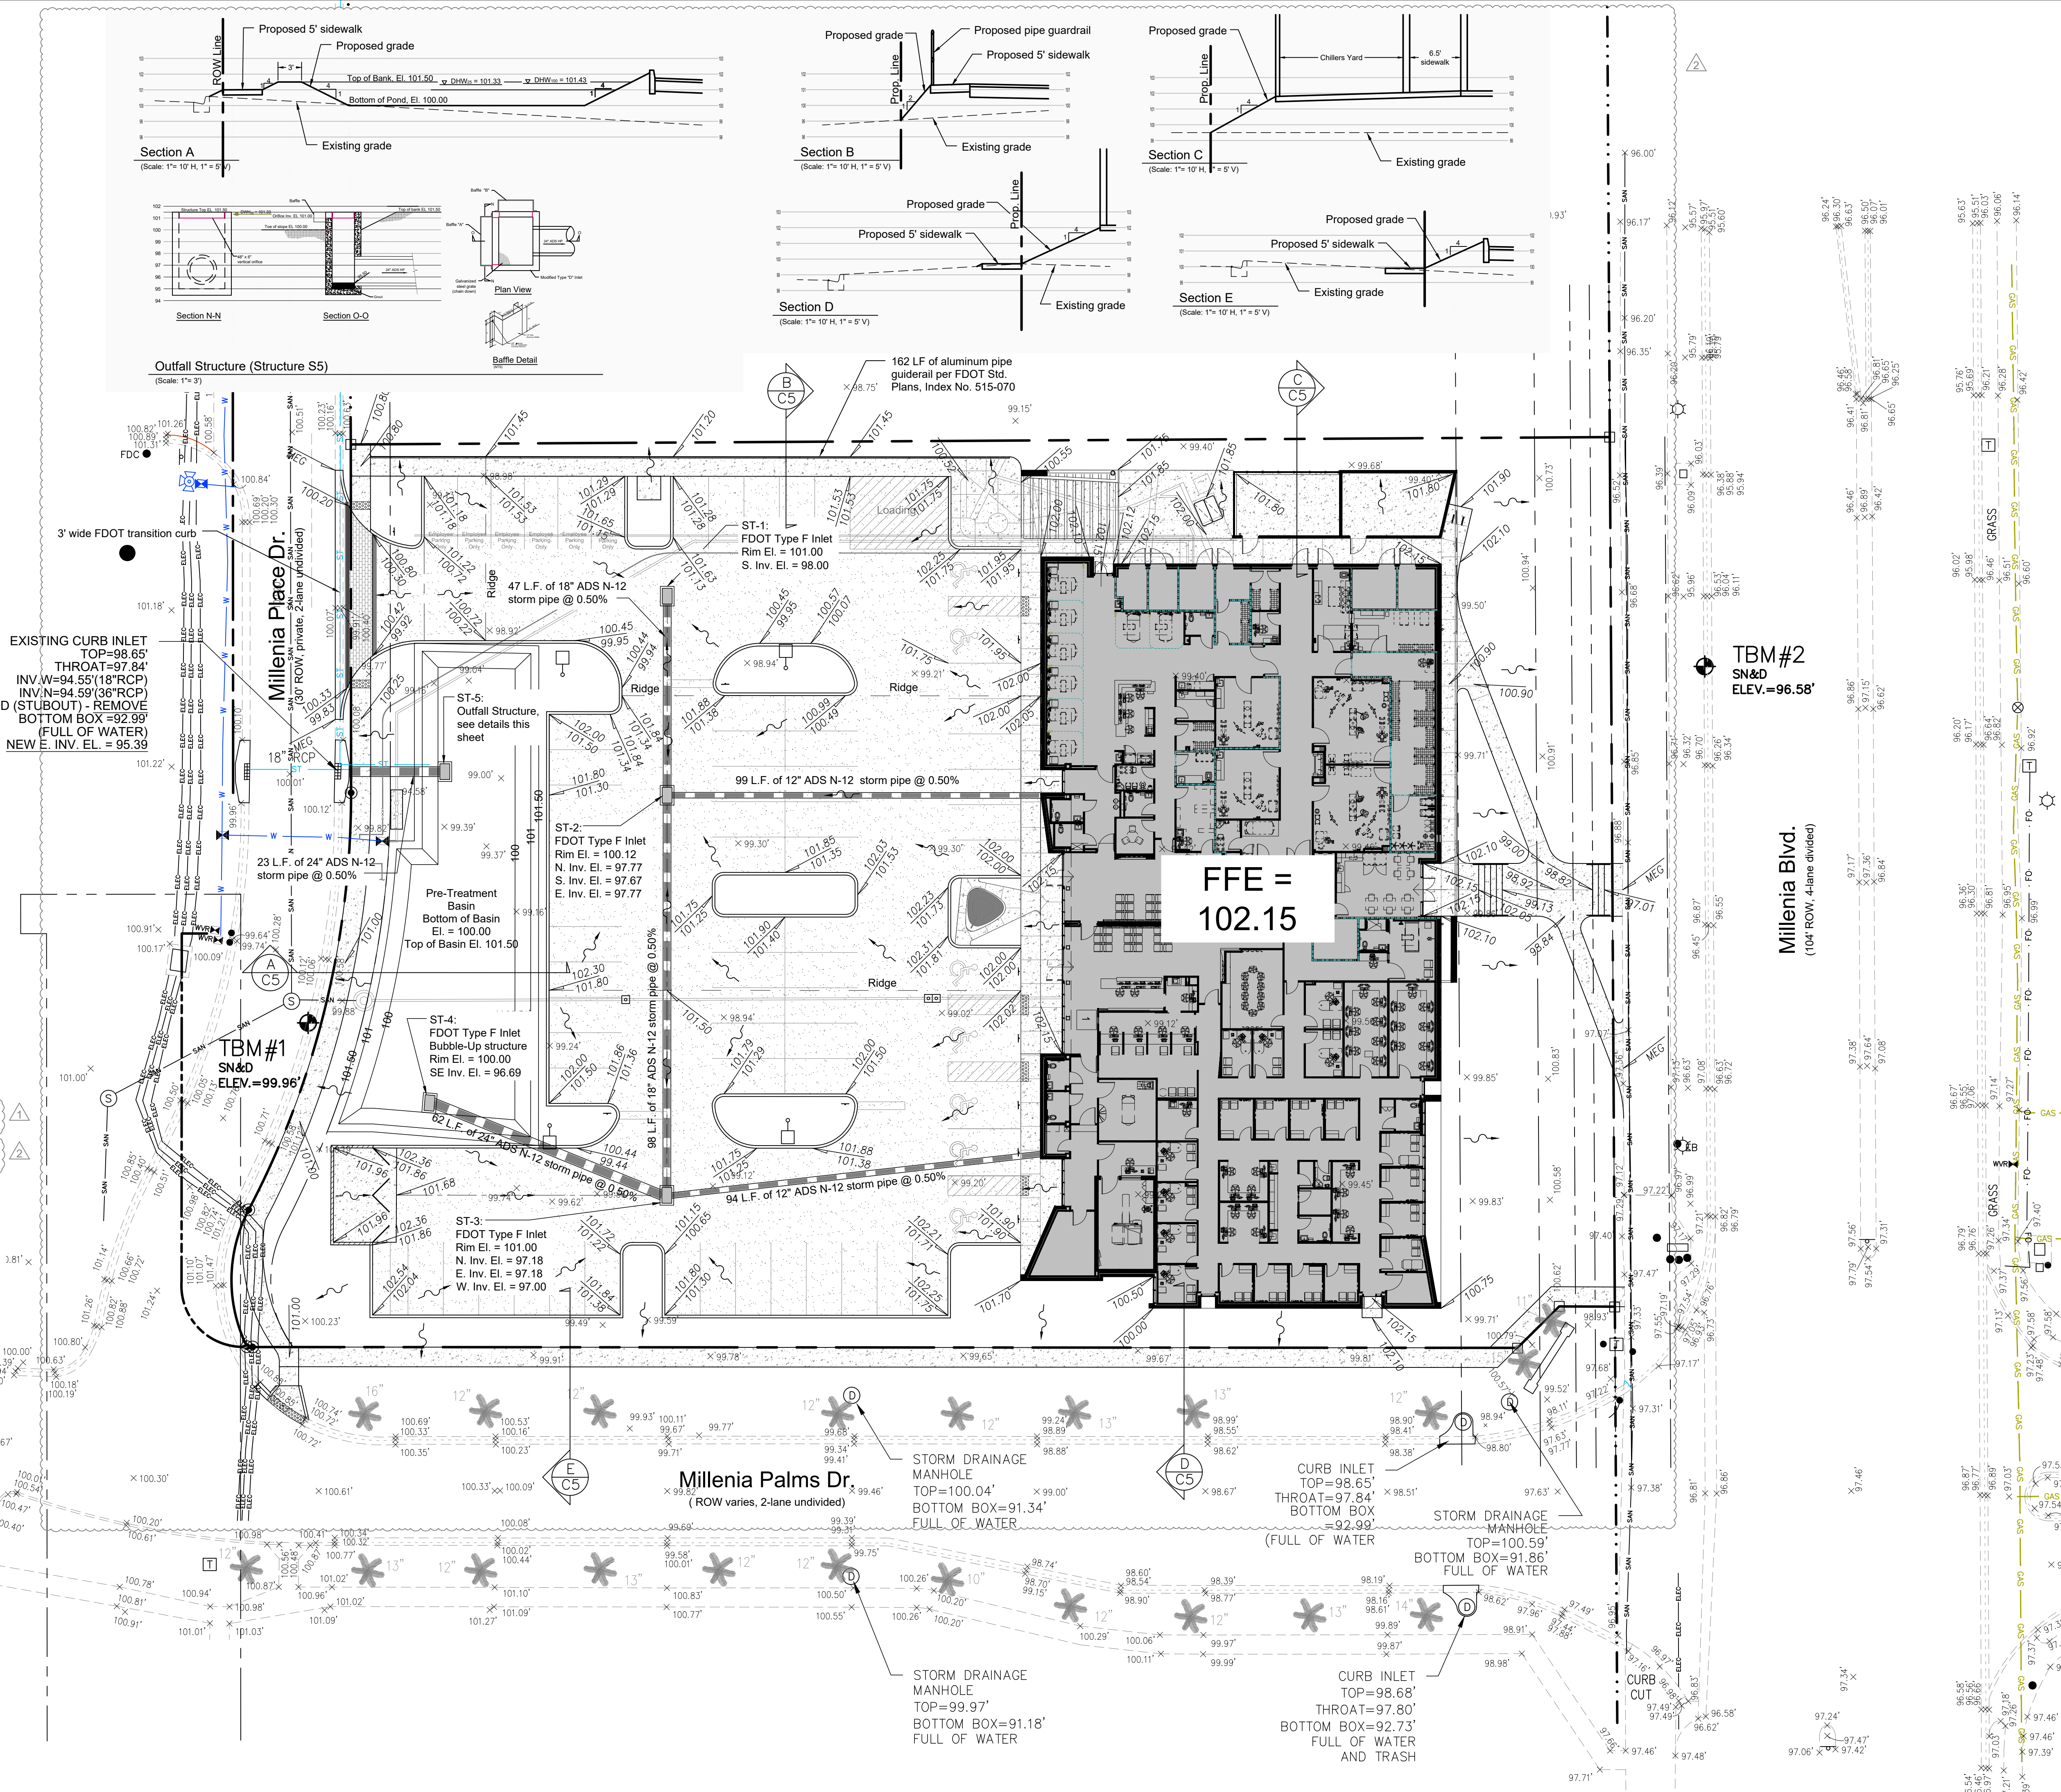


Issue / Revisions

- 1, 5-14-26, Revised per City of Orlando staff review comments.
- 2, 8-3-26, Revised per City of Orlando staff review comments.



Scale
1" = 20'

Deuk Spine of Orlando

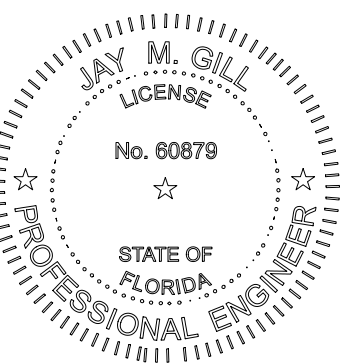

Reviewed by
JMG/RMO

Date

Plan Description
Paving,
Grading &
Drainage Plan

Sheet No.

C5