



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Product Evaluation Report

of

Allegion-Schlage Lock Company, LLC.

Single and Double Flush Outswing Commercial Steel Doors with Vertical Rod Exit Device

(HVHZ) (Missile Level E Impact)

for

Florida Product Approval

FL# FL14022

Report No. 8720

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Single and Double Flush Outswing Commercial Steel Doors with Vertical Rod Exit Device
Door Materials:	16 Ga. Min. Cold Rolled Steel
Frame Materials:	16 Ga. Min. Cold Rolled Steel
Product Dimensions:	See Installation Instructions, F3580-1

Prepared for:

Allegion-Schlage Lock Company, LLC.
11819 N. Pennsylvania Street
Carmel, IN 46032

Prepared by:


Hermes F. Norero, P.E.

Florida Professional Engineer # 73778

Date: 10/12/2020

Contents:

Evaluation Report Pages 1 – 4

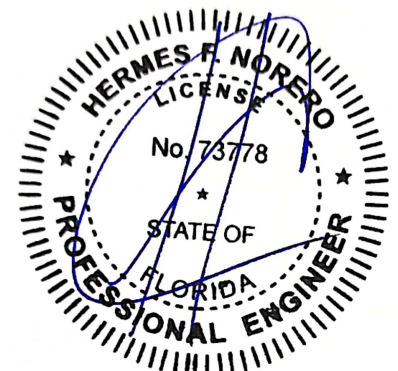

Hermes F. Norero, P.E.
Florida No. 73778



FL#: FL14022
Date: 8/14/2023
Report No: 8720

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Manufacturer: Allegion - Schlage Lock Company, LLC.

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(d)

Product Name: Single and Double Flush Outswing Commercial Steel Doors with Vertical Rod Exit Device (HVHZ) (Missile Level E Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Allegion - Schlage Lock Company, LLC.** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **F3580-1**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the “High Velocity Hurricane Zone” (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering. Approved for ASTM E1996 Missile Level E impact requirements.
4. Site conditions that deviate from the details of installation instruction **F3580-1** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **F3580-1** for size and design pressure limitations.



FL#: FL14022
Date: 8/14/2023
Report No: 8720

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Quality Assurance: The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Intertek Testing Services NA, Inc. - QA Entity** (FBC Organization # QUA1673).

Performance Standards: The product described herein has been evaluated per:

- ASTM E330-14
- ASTM E1886-19
- ASTM E1996-17
- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **National Certified Testing Laboratories, Inc.** (FBC Organization # TST1589)
Report #: NCTL-210-03-0514-11, Report Date: 08/31/04
Report #: NCTL-210-03-3511-1, Report Date: 04/09/08
Report #: NCTL-210-03-3549-1, Report Date: 08/26/08
Report #: NCTL-210-3357-1, Report Date: 03/09/08
Report #: NCTL-210-3580-1, Report Date: 02/26/09
Report #: NCTL-210-3580-2, Report Date: 02/26/09
Reports Signed and Sealed by Gerard Ferrara, FL PE No. 11985
2. Product Testing performed by **Element Materials Technology** (FBC Organization # TST2613)
Report #: ESP011623P, Report Date: 05/14/13
Report Signed and Sealed by Jason Sheen, FL PE No. 67814
3. Product Testing performed by **Certified Testing Laboratories** (FBC Organization # TST1577)
Report #: CTLA-3045W, Report Date: 02/16/15
Report Signed and Sealed by Ramesh Patel, FL PE No. 20224
4. Quality Assurance
Intertek Testing Services NA, Inc. - QA Entity
(FBC Organization # QUA1673)



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

FL#: FL14022
Date: 8/14/2023
Report No: 8720

Installation:

Refer to Installation Instructions (**F3580-1**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**F3580-1**) for design pressures based on size, configuration, and glass types.

Equivalence of Test Standards:

Various test standards have been evaluated for differences in test methodology, if any, between tested editions of the test standards listed below and those editions referenced in the current Florida Building Code. Allegion - Schlage Lock Company, LLC. has tested their products to the following test standard edition(s):

- 1) ASTM E330-02
- 2) ASTM E1886-02/05
- 3) ASTM E1996-05

Chapter 35 of the current Florida Building Code references the following editions of the above mentioned test standards:

- 1) ASTM E330-14
- 2) ASTM E1886-19
- 3) ASTM E1996-17

After review of the above mentioned referenced standards and editions, it has been found that the results and tests carried out meet the requirements for compliance. All referenced standards have been found to be equivalent.