

BROKEN SOUND - RETAIL WASTE ENCLOSURE

LOCATED AT:
6600 NORTH MILITARY TRAIL
BOCA RATON, FL. 33496
FOR:
PEBB ENTERPRISES



INDEX OF DRAWINGS

#	SHEET	REV.	DATE	DESCRIPTION	#	SHEET	REV.	DATE	DESCRIPTION	#	SHEET	REV.	DATE	DESCRIPTION
A-0.0			10/02/25	COVER SHEET & INDEX	MECHANICAL					-				
A-0.1			10/02/25	SITE PLAN										
A-0.2			10/02/25	PARTIAL SITE PLAN										
SURVEY														
SURVEY PLANS														
CIVIL														
CIVIL PLANS UNDER SEPARATE CIVIL PERMIT.														
LANDSCAPE														
LANDSCAPE PLANS														
ARCHITECTURAL														
A-2.1			10/02/25	FLOOR TRASH COMPACTOR										
					ELECTRICAL									
					ETC-1			10/02/25	TRASH ENCLOSURE ELECTRICAL					

05/14/26 - 10:45 AM - 25-035 MANOR BROKEN SOUND

STRUCTURAL NOTES

GENERAL NOTES:

STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATIONS AND ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR DEPRESSIONS, AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.

DIMENSIONS AND CONDITIONS MUST BE VERIFIED IN THE FIELD. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK.

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCE TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS OR TIEDOWNS.

DESIGN LOADS:

THE STRUCTURAL SYSTEM FOR THE BUILDING HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2023 FLORIDA BUILDING CODE, 8TH EDITION. THE FOLLOWING SUPERIMPOSED LOADINGS HAVE BEEN UTILIZED:

WIND:

WIND PER ASCE 7-22
3 SECOND GUST WIND SPEED = 170 MPH
RISK CATEGORY = II
EXPOSURE C

SPECIAL INSPECTIONS:

SPECIAL INSPECTION OF THE CONSTRUCTION IS REQUIRED BY THE STATE OF FLORIDA IN ACCORDANCE WITH CHAPTER 553 OF THE FLORIDA STATUTES. CONSTRUCTION SHALL BE INSPECTED IN ACCORDANCE WITH THE SPECIAL INSPECTION PLAN.

SHOP DRAWING REVIEW:

SHOP DRAWINGS WILL BE REVIEWED FOR GENERAL COMPLIANCE WITH THE DESIGN INTENT OF THE CONTRACT DOCUMENTS ONLY. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY COMPLIANCE WITH THE CONTRACT DOCUMENTS AS TO QUANTITY, LENGTH, ELEVATIONS, DIMENSIONS, ETC.

SHOP DRAWINGS SHALL BE REVIEWED BY THE CONTRACTOR PRIOR TO SUBMITTAL TO THE ARCHITECT/ENGINEER. DRAWINGS SUBMITTED WITHOUT REVIEW WILL BE RETURNED UNCHECKED.

SHOP DRAWING SUBMITTALS SHALL INCLUDE ONE GOOD QUALITY REPRODUCIBLE DIGITAL SET OF PLANS AND THREE SETS OF SIGNED AND SEALED PLANS. ONE SET OF PLANS WILL BE RETAINED BY THE ENGINEER, ONE BY THE ARCHITECT, ONE BY THE LOCAL BUILDING DEPARTMENT (WHERE REQUIRED) AND THE CONTRACTOR SHALL MAKE COPIES FROM THE DIGITAL SET OF PLANS AS REQUIRED FOR DISTRIBUTION.

THE CONTRACT DOCUMENTS WILL GOVERN OVER THE SHOP DRAWINGS UNLESS OTHERWISE SPECIFIED IN WRITING BY THE ENGINEER.

CHANGES AND ADDITIONS MADE ON RE-SUBMITTALS SHALL BE CLEARLY FLAGGED AND NOTED. THE PURPOSE OF THE RE-SUBMITTALS SHALL BE CLEARLY NOTED ON THE LETTER OF TRANSMITTAL. ARCHITECT/ENGINEER REVIEW WILL BE LIMITED TO THOSE ITEMS CAUSING THE RE-SUBMITTAL.

SHOP DRAWINGS FOR SPECIALTY ENGINEERED PRODUCTS:

THE FOLLOWING SYSTEMS AND COMPONENTS AS A MINIMUM REQUIRE FABRICATION AND ERECTION DRAWINGS PREPARED BY A DELEGATED ENGINEER:

LIGHT GAGE STEEL EXTERIOR WALL SYSTEMS, ALUMINUM WALL SYSTEMS, OPEN WEB STEEL JOISTS, STRUCTURAL STEEL CONNECTIONS REQUIRING ENGINEERING, WINDOWS, DOORS.

SUBMITTALS SHALL CLEARLY IDENTIFY THE SPECIFIC PROJECT AND APPLICABLE CODES, LIST THE DESIGN CRITERIA, AND SHOW ALL DETAILS AND PLANS NECESSARY FOR PROPER FABRICATION AND INSTALLATION. CALCULATIONS AND SHOP DRAWINGS SHALL IDENTIFY SPECIFIC PRODUCT UTILIZED. GENERIC PRODUCTS WILL NOT BE ACCEPTED.

SHOP DRAWINGS AND CALCULATIONS SHALL BE PREPARED UNDER THE DIRECT SUPERVISION AND CONTROL OF THE DELEGATED ENGINEER.

SHOP DRAWINGS AND CALCULATIONS ARE REQUIRED TO BE DATED, SIGNED AND SEALED BY THE DELEGATED ENGINEER. COMPUTER PRINTOUTS ARE AN ACCEPTABLE SUBSTITUTE FOR MANUAL COMPUTATIONS PROVIDED THEY ARE ACCOMPANIED BY SUFFICIENT DESCRIPTIVE INFORMATION TO PERMIT THEIR PROPER EVALUATION. SUCH DESCRIPTIVE INFORMATION SHALL BEAR THE IMPRESSED SEAL AND SIGNATURE OF THE DELEGATED ENGINEER AS AN INDICATION THAT HE/SHE HAS ACCEPTED RESPONSIBILITY FOR THE RESULTS. THE STRUCTURAL ENGINEER WILL RETAIN ONE SIGNED AND SEALED SET OF PLANS FOR RECORD.

DRAWINGS PREPARED SOLELY TO SERVE AS A GUIDE FOR FABRICATION AND INSTALLATION (SUCH AS REINFORCING STEEL SHOP DRAWINGS OR STRUCTURAL STEEL ERECTION DRAWINGS) AND REQUIRING NO ENGINEERING, DO NOT REQUIRE THE SEAL OF A DELEGATED ENGINEER.

CATALOG INFORMATION ON STANDARD PRODUCTS DOES NOT REQUIRE THE SEAL OF A DELEGATED ENGINEER.

REVIEW BY THE STRUCTURAL ENGINEER OF RECORD OF SUBMITTALS IS LIMITED TO VERIFYING THE FOLLOWING:

- THAT THE SPECIFIED STRUCTURAL SUBMITTALS HAVE BEEN FURNISHED.
- THAT THE STRUCTURAL SUBMITTALS HAVE BEEN SIGNED AND SEALED BY THE DELEGATED ENGINEER.
- THAT THE DELEGATED ENGINEER HAS UNDERSTOOD THE DESIGN INTENT AND HAS USED THE SPECIFIED STRUCTURAL CRITERIA. (NO DETAILED CHECK OF CALCULATIONS WILL BE MADE).
- THAT THE CONFIGURATION SET FORTH IN THE STRUCTURAL SUBMITTALS IS CONSISTENT WITH THE CONTRACT DOCUMENTS. (NO DETAILED CHECK OF DIMENSIONS OR QUANTITIES WILL BE MADE).

SUBMITTALS NOT MEETING THE ABOVE CRITERIA WILL NOT BE REVIEWED.

FOUNDATIONS:

SEE THE FOLLOWING REPORT FOR COMPLETE GEOTECHNICAL RECOMMENDATIONS AND INSTALLATION PROCEDURES. SITE PREPARATION AND FOUNDATION INSTALLATION SHALL COMPLY WITH:

REPORT No.: 320-24445
PREPARED BY: PACIFICA ENGINEERING SERVICES
TITLED: ICON / MANOR BROKEN SOUND.
6600 N MILITARY TRAIL, BOCA RATON, FL 33496
DATED: DECEMBER 12, 2024

FOUNDATION DESIGN IS BASED ON A SOIL BEARING PRESSURE OF 7,000 PSF.

SOIL COMPACTION:

FOUNDATIONS ARE DESIGNED FOR AN ALLOWABLE SOIL BEARING PRESSURE OF 7,000 PSF. TOP-SOIL SHALL BE REMOVED TO A MINIMUM DEPTH OF ONE FOOT OVER THE ENTIRE BUILDING AREA AND 5 FEET MINIMUM BEYOND BUILDING LINES (INCLUDING ISOLATED COLUMNS). THE CLEARED SURFACES IN CONSTRUCTION AREAS SHOULD BE PROOF-ROLLED USING THE APPROPRIATE COMPACTION EQUIPMENT FOR SITE AND SOIL CONDITIONS. THE SUBSEQUENT FILL TO THE UNDERSIDE OF THE GROUND FLOOR SLAB SHALL BE ADDED IN LIFTS NOT EXCEEDING 12 INCHES AND EACH LIFT COMPACTED TO 98% OF A MODIFIED PROCTOR DENSITY DETERMINED IN ACCORDANCE WITH ASTM D 1557.

SITE PREPARATION AND GROUND IMPROVEMENT REQUIREMENTS SHALL COMPLY WITH THE FOLLOWING REPORT:

REPORT No.: 320-24445
PREPARED BY: PACIFICA ENGINEERING SERVICES
TITLED: ICON / MANOR BROKEN SOUND.
6600 N MILITARY TRAIL, BOCA RATON, FL 33496
DATED: DECEMBER 12, 2024

VERIFICATION THAT THE COMPACTION REQUIREMENTS HAVE BEEN MET SHALL BE MADE BY AN INDEPENDENT GEOTECHNICAL CONSULTANT EMPLOYED BY THE OWNER AND APPROVED BY THE ENGINEER. LOCATIONS FAILING TO MEET THE REQUIREMENTS SHALL BE RECOMPACTED AND RETESTED AT THE CONTRACTOR'S EXPENSE AND AS DIRECTED BY THE INDEPENDENT GEOTECHNICAL CONSULTANT.

FORMWORK AND SHORING:

NO STRUCTURAL CONCRETE SHALL BE STRIPPED UNTIL IT HAS REACHED AT LEAST TWO THIRDS OF THE 28 DAY DESIGN STRENGTH. DESIGN, ERECTION AND REMOVAL OF ALL FORMWORK, SHORES AND RESHORES SHALL MEET THE REQUIREMENTS SET FORTH IN ACI STANDARDS 347 AND 301.

PLUMBING SLEEVES:

MINIMUM SLEEVE SPACING SHALL BE THREE DIAMETERS CENTER TO CENTER OF THE LARGER SLEEVE OR 6" CLEAR BETWEEN SLEEVES, WHICHEVER IS GREATER. PRIOR TO CONSTRUCTION SLEEVE LOCATIONS AND SIZES SHALL BE APPROVED BY THE ENGINEER.

CONSTRUCTION JOINTS:

ANY DEVIATION OR ADDITION OF CONSTRUCTION JOINT FROM THAT SHOWN ON THE PLANS, MUST BE REVIEWED BY THE ENGINEER, ALTERNATE OR ADDED CONSTRUCTION JOINT LOCATIONS ARE ACCEPTABLE ONLY AS A CHANGE ORDER, WHICH WILL INCLUDE ENGINEERING CHARGES BY THE ENGINEER OF RECORD FOR REDESIGN OF THE STRUCTURE, SHORING, ETC.

REINFORCING STEEL:

SHALL BE ASTM A615 GRADE 60 DEFORMED BARS, FREE FROM OIL, SCALE AND RUST AND PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAM AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. SECURE APPROVAL OF SHOP DRAWINGS PRIOR TO COMMENCING FABRICATION.

GALVANIZED REINFORCING STEEL:

REINFORCING BARS AT EXPOSED AREAS SUCH AS BALCONIES AND AS SHOWN ON STRUCTURAL PLANS SHALL BE HOT DIPPED GALVANIZED ACCORDING TO ASTM A767/A767M.

B REINFORCEMENT COVER

COVER FOR REINFORCEMENT SHALL NOT BE LESS THAN THE FOLLOWING:

CONCRETE COVER, IN

- CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
- CONCRETE EXPOSED TO EARTH OR WEATHER:
No. 6 THROUGH No. 18 BARS 2"
No. 5 BAR, W31 OR D31 WIRE, AND SMALLER 1.5"
- CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND: SLABS, WALLS, JOIST:
No. 14 AND No. 18 BARS 1.5"
No. 11 BAR AND SMALLER 0.75"
- BEAMS, COLUMNS:
PRIMARY REINFORCEMENT, TIES, STIRRUPS, SPIRALS 1.5"
- SHELLS, FOLDED PLATE MEMBERS:
No. 6 BAR AND LARGER 0.75"
No. 5 BAR, W31 OR D31 WIRE, AND SMALLER 0.5"

WELDED WIRE FABRIC:

TO CONFORM TO ASTM A-185, FREE FROM OIL, SCALE AND RUST AND PLACED IN ACCORDANCE WITH THE TYPICAL PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. MINIMUM LAP SHALL BE ONE SPACE PLUS TWO INCHES. USE OF FLAT MANUFACTURED SHEETS IS RECOMMENDED.

CONCRETE:

CONCRETE SHALL BE PER AN APPROVED MIX DESIGN PROPORTIONED TO ACHIEVE A STRENGTH AT 28 DAYS AS LISTED BELOW WITH A PLASTIC AND WORKABLE MIX:

3000 PSI FOR FOUNDATIONS AND SLABS ON GRADE.
4000 PSI FOR OTHER STRUCTURAL CONCRETE.

CONCRETE SHALL BE PLACED AND CURED ACCORDING TO ACI STANDARDS AND SPECIFICATIONS.

WHERE SPECIFIED CONCRETE STRENGTH OF COLUMN IS GREATER THAN THE SPECIFIED SLAB CONCRETE STRENGTH, HIGHER STRENGTH CONCRETE SHALL BE PUDDLED AT THE COLUMN. THE STRENGTH OF PUDDLED CONCRETE SHALL BE AT LEAST 0.72 TIMES THE STRENGTH OF COLUMN CONCRETE.

SUBMIT PROPOSED MIX DESIGN WITH RECENT FIELD CYLINDER OR LAB TESTS FOR REVIEW PRIOR TO USE. MIX SHALL BE UNIQUELY IDENTIFIED BY MIX NUMBER OR OTHER POSITIVE IDENTIFICATION. MIX SHALL MEET THE REQUIREMENTS OF ASTM C39 FOR COARSE AGGREGATE. CONCRETE SHALL COMPLY WITH THE REQUIREMENTS OF ASTM STANDARD C94 FOR MEASURING, MIXING, TRANSPORTING, ETC. CONCRETE TICKETS SHALL BE TIME STAMPED WHEN CONCRETE IS BATCHED. THE MAXIMUM TIME ALLOWED FROM THE TIME THE MIXING WATER IS ADDED UNTIL IT IS DEPOSITED IN ITS FINAL POSITION SHALL NOT EXCEED ONE AND ONE HALF (1-1/2) HOURS. IF FOR ANY REASON THERE IS A LONGER DELAY THAN THAT STATED ABOVE, THE CONCRETE SHALL BE DISCARDED. IT SHALL BE THE RESPONSIBILITY OF THE TESTING LAB TO NOTIFY THE OWNER'S REPRESENTATIVE AND THE CONTRACTOR OF ANY NONCOMPLIANCE WITH THE ABOVE. SLABS SHALL BE CURED USING A DISSIPATING CURING COMPOUND MEETING ASTM STANDARD C309 TYPE I-D AND SHALL HAVE A FUGITIVE DYE. THE COMPOUND SHALL BE PLACED AS SOON AS THE FINISHING IS COMPLETED OR AS SOON AS THE WATER HAS LEFT THE UNFINISHED CONCRETE. SCUFFED OR BROKEN AREAS IN THE CURING MEMBRANE SHALL BE RECOATED DAILY. CALCIUM CHLORIDES SHALL NOT BE UTILIZED; OTHER ADMIXTURES MAY BE USED ONLY WITH THE APPROVAL OF THE ENGINEER.

CONCRETE MIX DESIGNS SHALL INCLUDE A WRITTEN DESCRIPTION INDICATING WHERE EACH PARTICULAR MIX IS TO BE PLACED WITHIN THE STRUCTURE. IF ACCEPTED, PEA ROCK PUMP MIX USE IS LIMITED TO VERTICAL ELEMENT POURS AND BEAM POURS LESS THAN 60 LINEAL FEET PER POUR.

CONCRETE DESIGN MIX SUBMITTALS SHALL INCLUDE TESTED, STATISTICAL BACK-UP DATA AS PER CHAPTER 5 OF ACI 318.

WATER/CEMENT RATIO FOR CONCRETE AT EXTERIOR BALCONIES SHALL NOT EXCEED 0.40 BY WEIGHT.

WEATHER RESISTANCE:

WHEREVER CONCRETE BALCONIES (OR OTHER FLAT SURFACES) OF THE REINFORCED OR POST-TENSIONED CONCRETE SLABS ARE TO REMAIN EXPOSED TO THE WEATHER THROUGHOUT THE LIFE OF THE BUILDING, THE TOP SURFACE OF THE CONCRETE SHALL BE TREATED WITH A CLEAR NONFLAMMABLE PENETRATING SEALER OF THE ALKYL-ALKOXY SILANE CLASSIFICATION, SUCH AS MASTERPROTECT H 200, OR OTHER ENGINEER APPROVED WEATHER RESISTANT SYSTEM. APPLICATION AND SURFACE PREPARATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

CONCRETE TESTING:

AN INDEPENDENT TESTING LABORATORY SHALL PERFORM THE FOLLOWING TESTS ON CAST IN PLACE CONCRETE:

- ASTM C143 - "STANDARD TEST METHOD FOR SLUMP OF PORTLAND CEMENT CONCRETE." MAXIMUM SLUMP SHALL BE 4" TO 6" INCHES.
- ASTM C39 - "STANDARD TEST METHOD FOR COMPRESSIVE STRENGTH OF CYLINDRICAL CONCRETE SPECIMENS." A SEPARATE TEST SHALL BE CONDUCTED FOR EACH CLASS, FOR EVERY 50 CUBIC YARDS (OR FRACTION THEREOF), PLACED PER DAY. REQUIRED CYLINDER(S) QUANTITIES AND TEST AGE AS FOLLOWS:

1 AT 3 DAYS
1 AT 7 DAYS
2 AT 28 DAYS

ONE ADDITIONAL RESERVE CYLINDER TO BE TESTED UNDER THE DIRECTION OF THE ENGINEER, IF REQUIRED. IF 28 DAY STRENGTH IS ACHIEVED, THE ADDITIONAL CYLINDER(S) MAY BE DISCARDED.

PENETRATIONS:

NO PENETRATIONS SHALL BE MADE IN ANY STRUCTURAL MEMBERS OTHER THAN THOSE LOCATED ON THE STRUCTURAL DRAWINGS WITHOUT PREVIOUS APPROVAL OF THE ENGINEER. CONTRACTOR SHOULD SUBMIT SLAB DRAWINGS INDICATING ANY CONCENTRATION OF PIPES, OPENINGS OR PENETRATIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS PRIOR TO CONCRETE POURS.

CHEMICAL (ADHESIVE) ANCHORS:

ADHESIVE ANCHORS SHALL HAVE BEEN TESTED IN ACCORDANCE WITH ACI 355.4 AND ICC-ES AC308 FOR CRACKED AND UNCRACKED CONCRETE. ADHESIVE ANCHORS SHALL BE INSTALLED IN CONCRETE HAVING A MINIMUM AGE OF 21 DAYS. HOLES SHALL BE DRY AT THE TIME OF INSTALLATION. ACI 355.4 TEMPERATURE CATEGORY 'B' ASSUMED IN DESIGN. PRIOR TO INSTALLATION OF ADHESIVE ANCHORS IN HORIZONTAL OR UPWARDLY INCLINED ORIENTATIONS RESISTING SUSTAINED TENSION LOADS, INSTALLERS ARE REQUIRED TO BE CERTIFIED IN ACCORDANCE WITH THE ACI/CRS ADHESIVE ANCHOR INSTALLER CERTIFICATION PROGRAM AND MUST BE CONTINUOUSLY INSPECTED.

PRODUCTS SHALL BE AN EQUAL TWO-PART EPOXY POLYMER INJECTION SYSTEM, SUCH AS SIMPSON "SET-3G", RAMSET "EPCON", HILTI "HIT HY", OR ENGINEER APPROVED SUBSTITUTION, INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. INSTALLERS SHALL BE TRAINED BY THE MANUFACTURER'S REPRESENTATIVE.

MASONRY WALLS:

MASONRY UNITS SHALL MEET ASTM C_90 FOR HOLLOW LOAD BEARING TYPE MASONRY WITH UNIT STRENGTH OF 2000 PSI ON THE NET AREA (f_m = 2000 PSI). MORTAR SHALL BE TYPE "M" OR "S" AND MEET ASTM C_270. GROUT SHALL BE 2,000 PSI MINIMUM COMPRESSIVE STRENGTH AND MEET ASTM C_476. PROVIDE HOOKED DOWELS IN FOOTINGS FOR VERTICAL REINFORCING ABOVE. LAP SPLICES 48 BAR DIAMETERS.

BLOCK CELLS SHALL BE GROUT FILLED WITH VERTICAL REINFORCING BARS AT CORNERS, INTERSECTIONS, EACH SIDE OF OPENINGS OVER 4 FEET WIDE, AND AS SHOWN ON THE PLANS. DOWELS SHALL BE USED TO PROVIDE CONTINUITY INTO THE STRUCTURE ABOVE AND/OR BELOW, UNLESS NOTED OTHERWISE. USE METAL LATH, MORTAR, OR SPECIAL UNITS TO CONFINED CONCRETE AND GROUT TO AREA REQUIRED. MASONRY SHALL BE LAID IN RUNNING BOND PATTERN UNLESS NOTED OTHERWISE.

PROVIDE 9 GAGE GALVANIZED HORIZONTAL JOINT REINFORCING (DUR_O_WALL OR ENGINEER APPROVED SUBSTITUTION) AT ALTERNATE BLOCK COURSES.

IF REQUIRED, CONTROL JOINTS SHALL BE PROVIDED IN CONCRETE MASONRY CONSTRUCTION AT LOCATIONS INDICATED ON THE ARCHITECTURAL DRAWINGS. HORIZONTAL WALL REINFORCING SHALL BE STOPPED EACH SIDE OF CONTROL JOINTS. SEE ARCHITECTURAL DRAWINGS FOR SEALANT REQUIREMENTS AT CONTROL JOINTS.

SUBMIT PROPOSED GROUT MIX DESIGN FOR REVIEW PRIOR TO USE. MIX SHALL BE UNIQUELY IDENTIFIED BY MIX NUMBER OR OTHER POSITIVE IDENTIFICATION. GROUT SLUMP SHALL BE BETWEEN 8 AND 11 INCHES. USE OF SUPERPLASTICIZER IS PROHIBITED.

CELLS TO BE GROUT FILLED SHALL HAVE VERTICAL ALIGNMENT SUFFICIENT TO MAINTAIN A CLEAR, UNOBSTRUCTED, CONTINUOUS VERTICAL GROUT SPACE. CLEANOUT OPENINGS SHALL BE PROVIDED AT THE BOTTOM OF CELLS TO BE GROUT FILLED IN EACH POUR IN EXCESS OF 5 FEET IN HEIGHT. ANY OVERHANGING MORTAR OR OTHER OBSTRUCTION OR DEBRIS SHALL BE REMOVED FROM THE INSIDES OF SUCH CELL WALLS. THE CLEANOUTS SHALL BE SEALED BEFORE GROUTING, AFTER INSPECTION.

VERTICAL REINFORCEMENT SHALL BE HELD IN POSITION AT TOP AND BOTTOM AND AT INTERVALS NOT EXCEEDING 192 BAR DIAMETERS. CELLS CONTAINING REINFORCEMENT SHALL BE FILLED SOLIDLY WITH GROUT. GROUT SHALL BE POURED IN LIFTS OF 4 FEET MAXIMUM HEIGHT. GROUT SHALL BE CONSOLIDATED AT TIME OF PLACING BY VIBRATING AND RECONSOLIDATED LATER BY VIBRATING BEFORE PLASTICITY IS LOST.

WHEN TOTAL GROUT POUR EXCEEDS 5 FEET IN HEIGHT, THE GROUT SHALL BE PLACED IN 4 FOOT LIFTS. MINIMUM CELL DIMENSION SHALL BE IN ACCORDANCE WITH TABLE 5 OF ACI 530.1 (3" X 3" FOR COARSE GROUT, 12 FT. MAXIMUM POUR HEIGHT).


WHEN THE GROUTING IS STOPPED FOR ONE HOUR OR LONGER, HORIZONTAL CONSTRUCTION JOINTS SHALL BE MADE BY STOPPING THE POUR OF GROUT NOT LESS THAN 1-1/2 INCH BELOW THE TOP OF THE UPPERMOST UNIT GROUTED.

TIE BEAMS:

BEAMS WITH THE PREFIX "TB" SHALL BE OF CONCRETE, POURED AFTER THE BLOCK WALLS BELOW ARE IN PLACE. REINFORCING SHALL BE CONTINUOUS THROUGH TIE BEAMS WITH MINIMUM LAP SPLICES OF 48 BAR DIAMETERS AND BENT BARS AT CORNERS. USE METAL LATH, MORTAR, OR SPECIAL UNITS TO CONFINED CONCRETE TO AREA REQUIRED. IN ACCORDANCE WITH ACI 550.1 (SOLID METAL OR FELT CAVITY CAPS ARE PROHIBITED).


CONTRACTOR QUALIFICATIONS:

THE QUALIFICATIONS OF BOTH THE GENERAL CONTRACTOR AND THE SHELL CONTRACTOR MUST BE SUBMITTED TO THIS OFFICE FOR REVIEW AND APPROVAL. SUBMISSIONS SHOULD INCLUDE THE FOLLOWINGS: A COPY OF EACH CONTRACTOR'S VALID STATE LICENSE, PROOF OF LIABILITY INSURANCE LISTING STRUCTURES INTERNATIONAL, INC. AS ADDITIONAL INSURED, AND A CURRENT PROJECT LIST DEMONSTRATING EXPERIENCE LISTING AT LEAST FIVE PROJECTS OF SIMILAR SCOPE AND SCALE, WITH WORK BEING PERFORMED WITHIN THE SAME GEOGRAPHIC REGION.

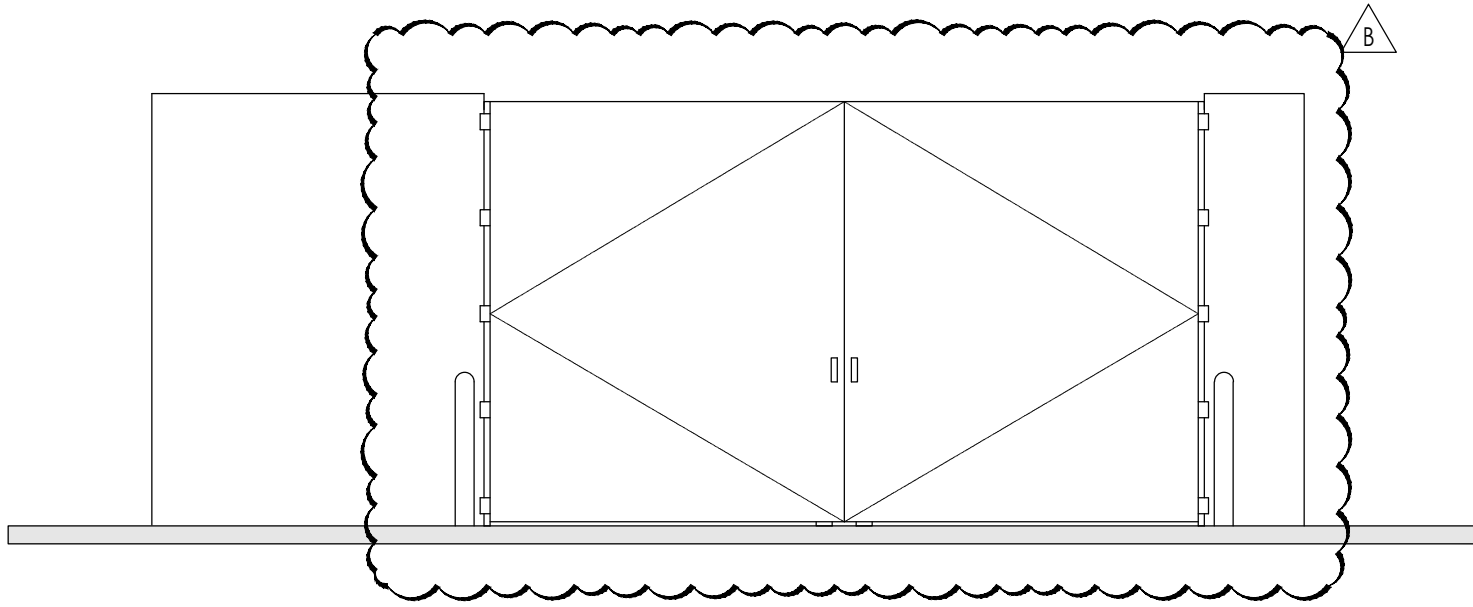

ELEVATION 1

1/4"=1'-0"




ELEVATION 2

1/4"=1'-0"



ELEVATION 3


1/4"=1'-0"

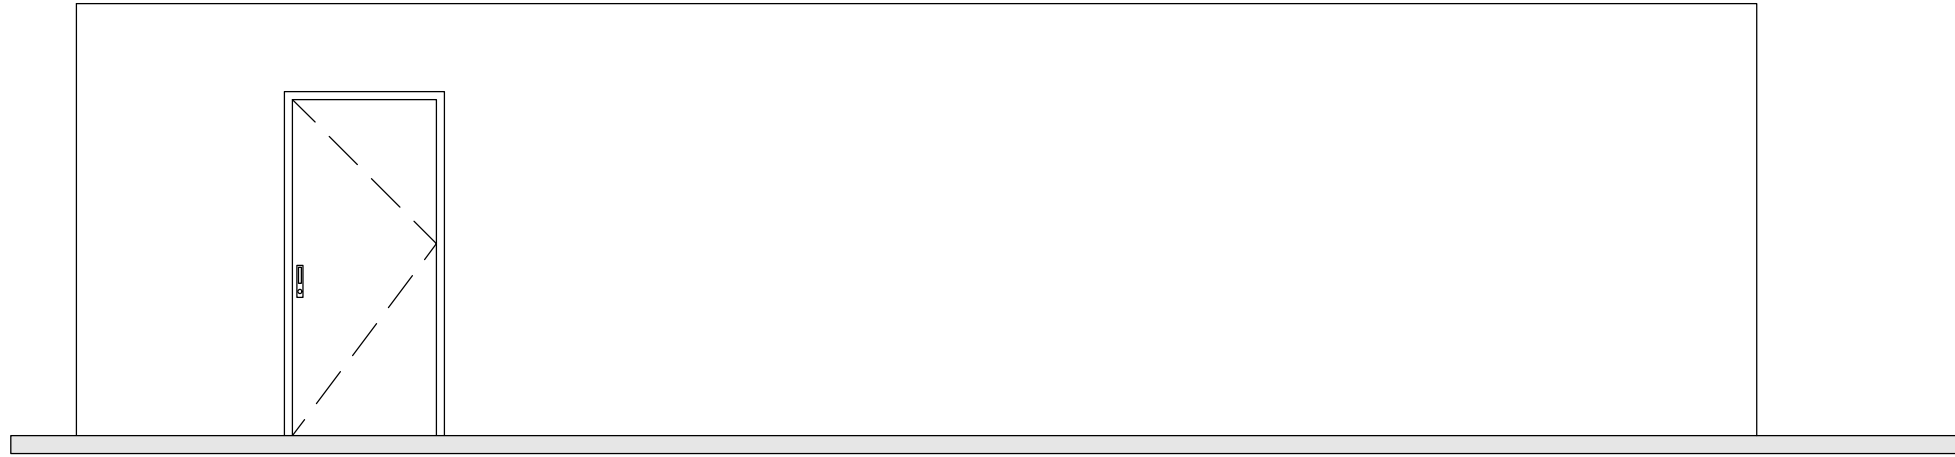

ELEVATION 4

1/4"=1'-0"

FOR BUILDING DEPARTMENT USE ONLY

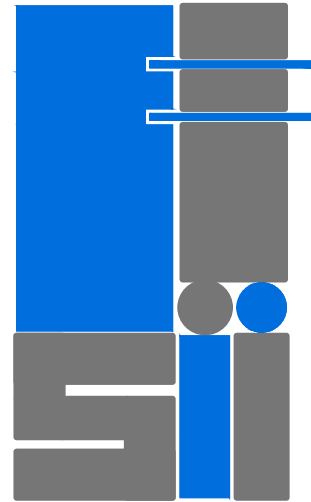

STRUCTURES
INTERNATIONAL, INC.

CONSULTING STRUCTURAL
ENGINEERS

7501 Wiles Road, Suite 106-B
Coral Springs, FL 33067
TEL: (954) 227-1512
www.sliengineers.com
C.A. #9446

MONZER I. FARAMAWI
FLORIDA P.E. #57439

TO THE BEST OF MY KNOWLEDGE AND
ABILITY, THE COMPLETED STRUCTURE
DEPICTED ON THESE PLANS COMPLIES WITH
THE APPLICABLE MINIMUM BUILDING CODES.

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED
& SEALED BY MONZER I. FARAMAWI, P.E., S.I.
ON THE DATE ADJACENT TO THE SEAL.
PRINTED COPIES OF THIS DOCUMENT ARE
NOT CONSIDERED SIGNED & SEALED AND
THE SIGNATURE MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.

BROKEN SOUND
RETAIL SHELL

6600 NORTH MILITARY TRAIL
BOCA RATON, FL 33496

REVISIONS

BLDG DEPT COMMENTS
04/10/2026

DRAWING TITLE:
STRUCTURAL NOTES
TRASH ENCLOSURE

JOB No: 25-035
DATE: 10/15/2025
STATUS: PERMIT SET
DRAWN: A.F.
CHECKED: M.I.F

S-0

SHEET INDEX - TRASH ENCLOSURE

SHEET NUMBER	SHEET NAME
-----------------	------------

S-0	STRUCTURAL NOTES & ELEVATIONS
-----	-------------------------------

S-0.1	SCHEDULES
-------	-----------


S-1	FOUNDATION FLOOR PLAN & SECTIONS
-----	----------------------------------

ABBREVIATION LEGEND

* @	AT	EXP	EXPANSION	O.H.	OVERHANG - OR -
* A.B.	ANCHOR BOLT	EXT.	EXTERIOR	OPP.	OPPOSITE HAND
* ABV	ABOVE	EXTR	EXTERIOR	OPNG	OPENING
ACI	AMERICAN CONCRETE INSTITUTE	FDN	FOUNDATION	O.S.B.	ORIENTED STRAND BOARD
ADD'L	ADDITIONAL	F.F.	FINISH FLOOR	O.W.S.J.	OPEN WEB STEEL JOIST
A.F.F.	ABOVE FINISHED FLOOR	* FIN.	FINISH	* O.W.J.G.	OPEN WEB JOIST GIRDER
* AGGREG.	AGGREGATE	* F.J.	FLOOR JOIST	* P.A.	POST ABOVE
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	* FLG	FLANGE	* P.A.F.	POWDER-ACTUATED FASTENER
* AITC	AMERICAN INSTITUTE OF TIMBER CONSTRUCTION	* FLR	FLOOR	* P.C.F.	POUNDS PER CUBIC FOOT
ALTN	ALTERNATE	* F.O.B.	FACE OF BLOCK	* PEN.	PENETRATION
ARCH.	ARCHITECT(URAL)	* F.N.	FACE NAIL	* PERP.	PERFORATED
ASTM	AMERICAN SOCIETY FOR TESTING & MATERIALS	* F.O.C.	FACE OF CONCRETE	* PERP.	PERPENDICULAR
AESS	ARCHITECTURAL EXPOSED STRUCTURAL STEEL	* F.O.M.	FACE OF MASONRY	PL.	PLATE
AISI	AMERICAN IRON AND STEEL INSTITUTE	* F.O.S.	FACE OF STUD	* PLY.	PLYWOOD
AR	ANCHOR ROD	* F.P.	FIREPLACE - OR - FULL PENETRATION	* PLYWD	PLYWOOD
ASD	ALLOWABLE STRESS DESIGN	* FRMD	FRAMED	* PR	PAIR
AWS	AMERICAN WELDING SOCIETY	* FRMG	FRAMING	* P.S.F.	POUNDS PER SQUARE FOOT
B/	BOTTOM OF	* F.S.	FACE SIDE	* P.S.I.	POUNDS PER SQUARE INCH
* B.C.	BOTTOM CHORD	* FT	FOOT	* P.S.L.	PARALLEL-STRAND LUMBER
BLDG	BUILDING	* FTG	FACE OF	* PT	POINT
* BLK	BLOCK	FD	FLOOR DRAIN	P.T.	PRESSURE TREATED - OR - POST-TENSION
* BLKG	BLOCKING	FRT	FIRE RETARDANT TIMBER	PEMB	PRE-ENGINEERED METAL BUILDING
* BLW	BELOW	FV	FIELD VERIFY	PJF	PREFORMED JOINT FILLER
BM	BEAM	* G & N	GLUE AND NAIL	PLF	POUNDS PER LINEAL FOOT
* B.N.	BOUNDARY NAILING	GA.	GAGE, GAUGE	PPHCC	PRESTRESSED PRECAST HOLLOW CORE CONCRETE
* B.O.	BY OTHERS - OR - BOTTOM OF	GALV.	GALVANIZED	PREFAB	PRE-FABRICATED
* B.O.C.	BOTTOM OF CONCRETE	* G.B.	GENERAL	QTY	QUANTITY
* B.O.F.	BOTTOM OF FOOTING	* GLB	GLUED-LAMINATED BEAM	RAD	RADIUS
BRG	BEARING	* GR.	GRADE	* RECOMM	RECOMMEND(ATION)
* B.S.	BOTH SIDES	* G.T.	GIRDER TRUSS	REF.	REFERENCE
* B.T.	BANDED TENDONS	* G.W.B.	GYPSON WALL BOARD	REINF.	REINFORCED - OR - REINFORCEMENT
BOT	BOTTOM	GC	GENERAL CONTRACTOR	REQD	REQUIRED
BETW	BETWEEN	GDR	GIRDER	* RET.	RETAINING
BD	BOARD	* HD	HOLDOWN	* R.J.	ROOF JOIST
BP	BASE PLATE	* H.D.G.	HOT-DIP GALVANIZED	* R.O.	ROUGH OPENING
BRDG	BRIDGING	HDR	HEADER	* R.R.	ROOF RATER
* CALCS	CALCULATIONS	HGR	HANGER	* R/S	RESAWN (ROUGH-SAWN)
* CANT.	CANTILEVER	* H.H.N.	HEAVY HEX NUT	* R.W.	RETAINING WALL
* C.B.C.	CALIFORNIA BUILDING CODE	* H.N.	HEX NUT	* RWD	REDWOOD
C/C	CENTER TO CENTER	HORIZ.	HORIZONTAL	RD	ROOF DRAIN
* C.C.J.	CRACK CONTROL JOINT	* H.S.B.	HIGH STRENGTH BOLT	REV	REVISION
* C.F.	CUBIC FOOT	H.T.	HEAVY TIMBER	RTU	ROOF TOP UNIT
* C.J.	CEILING JOIST CENTERLINE	HCA	HEADED CONCRETE ANCHOR	* S.A.D.	SEE ARCHITECTURAL DRAWINGS
* CLG	CLEAR	HKD	HOKED	* S.B.	SOLID BLOCK
CLR	CLEAR	HSS	HOLLOW STRUCTURAL SECTION	* S.B.T.	SET-BACK TRUSS
* C.M.U.	CONCRETE MASONRY UNIT	ID.	INSIDE DIAMETER	SCHED.	SCHEDULE
* COLL.	COLLECTOR	* INFO.	INFORMATION	* SEP.	SEPARATION
* CONC.	CONCRETE	INT.	INTERIOR	* S.G.T.	SUB-GIRDER TRUSS
* COND.	CONDITION	* INV.	INVERT(ED)	* SHT	SHEET
* CONN.	CONNECTION	IE	INVERT ELEVATION	SIM.	SIMILAR
* CONSTR.	CONSTRUCTION	INSUL	INSULATION OR INSULATING	* S.M.S.	SHEET METAL SCREW
* CONT.	CONTINUOUS	IT	JOIST	* S.J.	SOFFIT JOIST
* CONTR.	CONTRACTOR	JST	JOIST	SPEC.	SPECIFICATION
* C.P.	COMPLETE PENETRATION WELD	* K	KIPS (KILOPOUNDS)	* SQ.	SQUARE
* C.S.	COUNTERSUNK	* K.D.	KILN-DRIED	S.S.	STAINLESS STEEL
* C.T.	COLLECTOR TRUSS	* KLF	KIPS PER LINEAL FOOT	* S4S	SURFACED 4 SIDES
CTR	CENTER	* K.P.	KING POST	* STAGG.	STAGGER - OR - STAGGERED
* CTRD	CENTERED	* KSI	KIPS PER SQUIRE INCH	STD	STANDARD
* C.Y.	CUBIC YARD	KSF	KIPS PER SQUIRE FOOT	STIFF.	STIFFENER
CFSF	COLD FORMED STEEL FRAMING	* lbs	POUNDS	STL	STEEL
CL	CENTERLINE	* L.B.	LINEAL FOOT	* STRUCT.	STRUCTURAL
DBL	DOUBLE	* LF	LONGITUDINAL	SW	SHORT WAY
* DET.	DETAIL	LG	LONG	SYM.	SYMMETRICAL
* D.F.	DOUGLAS FIR	L.L.	LIVE LOAD	STRUCTURAL ENGINEER OF RECORD	SQUIRE FOOT
DIA.	DIAMETER	* LSL	LAMINATED STRAND LUMBER	SF	SHEATHING
DIAG.	DIAGONAL	LT	LIGHT	SLH	SHORT LEG HORIZONTAL
* DIM.	DIMENSION	* LTWT	LIGHTWEIGHT LAMINATED VENEER LUMBER	SLV	SHORT LEG VERTICAL
D.L.	DEAD LOAD	L	LENGTH	SPA	SPACES
* D.J.	DECK JOIST	LFH	LONG FACE HORIZONTAL	* T + B	TOP AND BOTTOM
* D.T.	DRAW TRUSS	LFV	LONG FACE VERTICAL	* T + G	TONGUE AND GROOVE
DEEP	DEEP	LLH	LONG LEG HORIZONTAL	* T.C.	TOP CHORD
* DTL	DETAIL	LLV	LONG LEG VERTICAL	THK.	THICK
DWG	DRAWING	LO	LOW	THKND	THICKENED
D&E	DRILL & EPOXY	LOCs	LOCATIONS	* T.N.	TOE NAIL
DBA	DEFORMED BAR ANCHOR	LRFD	LOAD RESISTANCE FACTORED DESIGN	* T.O.B.	TOP OF BLOCK
DEP	DEPRESSED	LSH	LONG SIDE HORIZONTAL	* T.O.C.	TOP OF CONCRETE
DWL	DOWEL	LSV	LONG SIDE VERTICAL	* T.O.P.	TOP OF PLATE
DN	DOWN	LW	LONG WAY	* T.O.S.	TOP OF STEEL - OR - TOP OF SHEATHING
EXIST	EXISTING	LWC	LIGHT WEIGHT CONCRETE	* T.O.W.	TOP OF WALL
* E.A.	EXPANSION BOLT	* MATL	MATERIAL	T/	TOP OF
E.F.	EACH FACE	MAX.	MAXIMUM	* T/P	TOP PLATE
E.J.	EXPANSION JOINT	* M.B.	MACHINE BOLT	* TRANSV.	TRANSVERSE
ELEV.	ELEVATION	* M.C.H.	MECHANICAL	* TS	STRUCTURAL TUBE
* EMB.	EMBEDMENT	* MEMB.	MEMBRANE	TYP.	TYPICAL
* EMBED.	EDGE NAIL	* MID.	MIDDLE	T & B	TOP & BOTTOM
* EQUIP.	EQUIPMENT	* MIN.	MINIMUM	T & G	TONGUE & GROOVE
* E.S.	EACH SIDE	* M.L.W.	MALLEABLE IRON WASHER	TEMP	TEMPORARY
E.W.	EACH WAY	* M.O.	MASONRY OPENING	THRU	THROUGH
ENG	ENGINEER OR ENGINEERING	* MOIST.	MOISTURE	U.N.O.	UNLESS NOTED OTHERWISE
EOS	EDGE OF SLAB	MFR	MANUFACTURER	VERT.	VERTICAL
EQ	EQUAL	* MFRD	MANUFACTURED	* V.I.F.	VERIFY IN FIELD
		MTL	METAL	W/	WITH
		* MEP	MECHANICAL, ELECTRICAL AND PLUMBING	WD	WOOD
		MEZZ	MEZZANINE	W.P.	WORK POINT - OR - WATERPROOF(ING)
		MISC	MISCELLANEOUS	* WT	WEIGHT
		* (N)	NOT APPLICABLE	* W.W.F.	WELDED WIRE FABRIC
		* N.A.	NON-DESTRUCTIVE TESTING	* W.W.M.	WELDED WIRE MESH
		* N.D.T.	NOT IN CONTRACT	W	WIDE
		* N.L.C.	NUMBER	W/O	WITHOUT
		* NLG	NEAR SIDE	WWR	WELDED WIRE REINFORCEMENT
		* No.	NON-SHRINK GROUT	#	NUMBER
		* N.S.	NOT TO SCALE		
		* N.T.S.	OVER		
		* O/	ON CENTER		
		* O.C.	OUTSIDE DIAMETER		
		* O.D.	OUTSIDE FACE OF STUD		
		* O.F.O.S.			

CONCRETE MASONRY UNIT LINTEL & JAMB SCHEDULE

SPAN	LINTEL DEPTH 'D'	LINTEL REINFORCING 8" TO 12" WALL	JAMB REINFORCING (SEE NOTE 5)	
<4'-0"	8"	(1)#5	(1)#5	
<4'-0" TO < 6'-0"	8"	(1)#5	(1)#5	
<6'-0" TO < 8'-0"	16"	(2)#5	(2)#5	

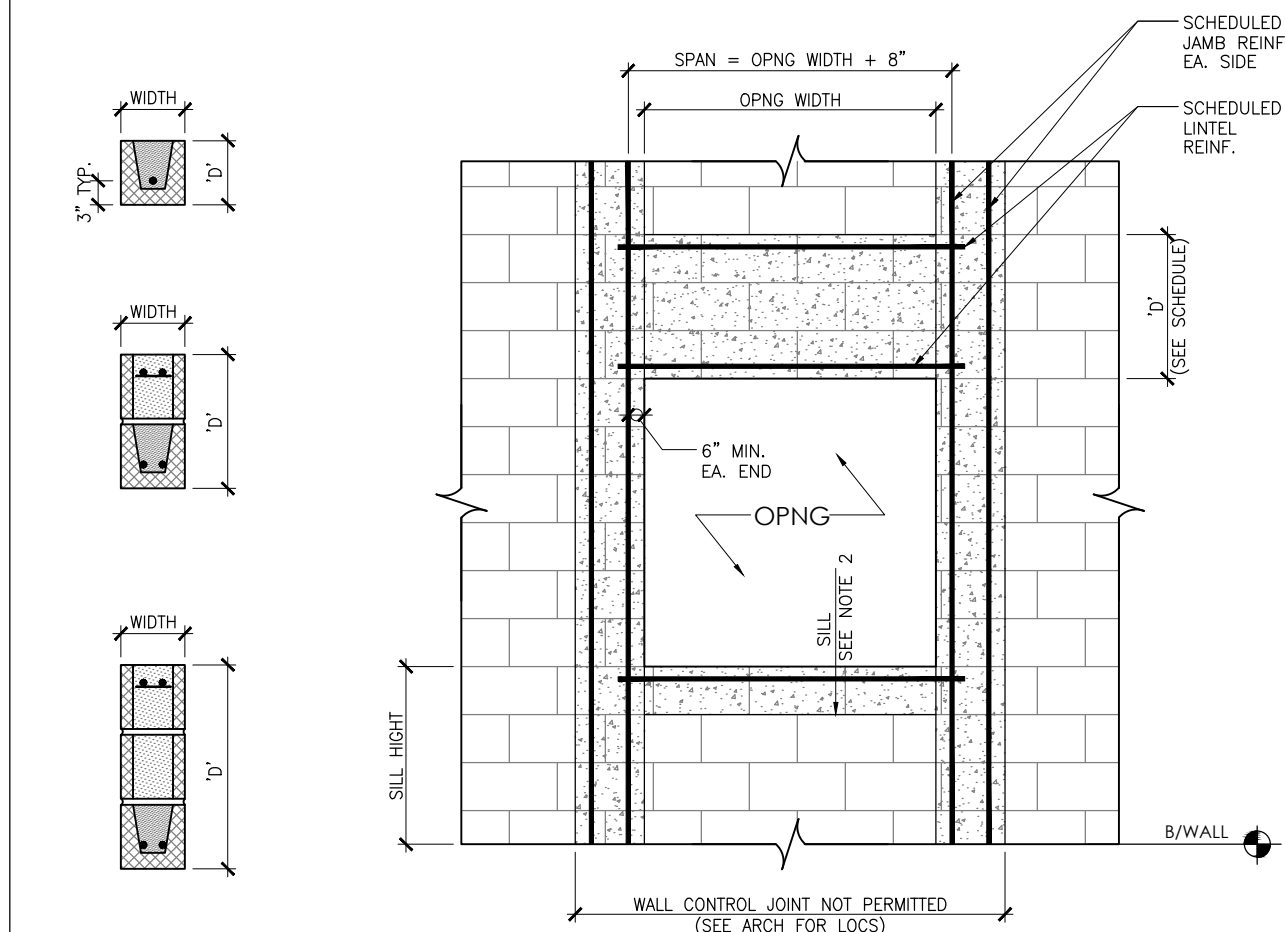

SECTIONS

ELEVATION

NOTES

- LINTELS SHALL BE CONSTRUCTED WITH U-BLOCKS AT THE BOTTOM AND DEPRESSED WEB BLOCKS ABOVE AND SHALL BE FULLY GROUTED.
- SILL REINFORCING REQUIREMENTS:
 - OPENING WIDTH < 6'-0" AND SILL HEIGHT < 3'-0" SILL REINFORCING NOT REQUIRED.
 - OPENING WIDTH < 6'-0" OR SILL HEIGHT > 3'-0" PROVIDE REINFORCED LINTEL ACCORDING SCHEDULE.
- NOTIFY ENGINEER IF OPENING WIDTH EXCEEDS SCHEDULED WIDTHS.
- SEE CONCRETE MASONRY NOTES, WALL REINFORCING SCHEDULE AND KEYED SECTIONS AND DETAILS FOR ADDITIONAL REINFORCING NOT SHOWN ON THIS SCHEDULE.
- PROVIDE (1) BAR PER CELL IN JAMBS, TYPICAL. WHERE SCHEDULED JAMB REINFORCING EXCEEDS THE NUMBER OF CELLS, PROVIDE (2) BARS PER CELL LOCATED 3/4" CLEAR FROM EACH FACE SHELL.

FOOTING SCHEDULE


ALLOWABLE SOIL BEARING PRESSURE OF 2500 PSF			
FOOTING ID.	FOOTING SIZE	REINFORCING	REMARKS
W-36	36" WIDE x 12" DEEP x CONT.	4#5 BOTTOM CONT. & #5@10"O.C. BOTTOM TRANSVERSE	
TE-1	8" x 8" x CONT.	1#5 CONT.	THICKENED EDGE
TE-2	12" x 8" x CONT.	2#5 CONT.	THICKENED EDGE

NOTE: TOP OF FOOTING SHALL BE 16" BELOW SLAB.

COLUMN SCHEDULE

COLUMN ID. NO.	COLUMN SIZE	VERT. REINFORCING OR BASE PLATE	TIES OR CAP PLATE	REMARKS
①	8" x 25"	10#5	#3@8"O.C.	
②	8" x 16"	6#5	#3@8"O.C.	

- INDICATES COLUMN TERMINATES
- INDICATES COLUMN CONTINUES
- INDICATES COLUMN STARTS

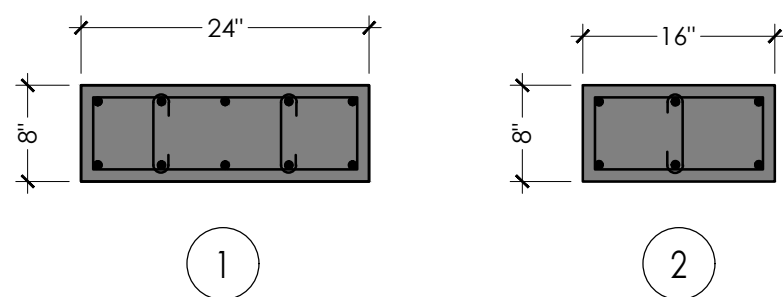

CLASS 'B' TENSION LAP SPLICE LENGTH (IN)
(ACI 318 25.4.2 & 25.5.2.1)

BAR SIZE	3000 PSI	4000 PSI	5000 PSI	6000 PSI	7000 PSI
#3	21"	19"	17"	16"	16"
#4	29"	25"	22"	20"	19"
#5	36"	31"	28"	25"	23"
#6	43"	37"	33"	30"	28"
#7	62"	54"	48"	44"	41"
#8	71"	62"	55"	50"	47"
#9	80"	70"	62"	57"	53"
#10	89"	78"	70"	64"	60"
#11	100"	87"	78"	71"	66"
#14	NOT PERMITTED (25.5.1.1)				
#18	NOT PERMITTED (25.5.1.1)				

COMPRESSION LAP SPLICE LENGTH (IN)
(ACI 318 25.5.5.1)

BAR SIZE	3000 PSI
#3	12"
#4	15"
#5	19"
#6	23"
#7	26"
#8	30"
#9	34"
#10	38"
#11	42"
#14	NOT PERMITTED (25.5.1.1)
#18	NOT PERMITTED (25.5.1.1)

FOR BUILDING DEPARTMENT USE ONLY

STRUCTURES INTERNATIONAL, INC.
CONSULTING STRUCTURAL ENGINEERS
7501 Wiles Road, Suite 106-B
Coral Springs, FL 33067
TEL: (954) 227-1512
www.silengineers.com
C.A. #9446

MONZER I. FARAMAWI
FLORIDA P.E. #57439

TO THE BEST OF MY KNOWLEDGE AND ABILITY, THE COMPLETED STRUCTURE DEPICTED ON THESE PLANS COMPLIES WITH THE APPLICABLE MINIMUM BUILDING CODES.

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED & SEALED BY MONZER I. FARAMAWI, P.E., S.I. ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED & SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

BROKEN SOUND RETAIL SHELL
6600 NORTH MILITARY TRAIL
BOCA RATON, FL 33496

REVISIONS


DRAWING TITLE:
SCHEDULES
TRASH ENCLOSURE

JOB No: 25-035
DATE: 10/15/2025
STATUS: PERMIT SET
DRAWN: A.F.
CHECKED: M.I.F.


S-0.1

1. UNLESS INDICATED OTHERWISE, THE GROUND FLOOR SHALL BE A MINIMUM OF 6" THICK CONCRETE SLABS-ON-GRADE REINFORCED WITH ONE LAYER OF 6X6-W14X14 WWF AT MID-DEPTH. ALL CONCRETE SLABS SHALL BE CAST ON A VAPOR BARRIER OVER WELL-COMPACTED, CLEAN FILL.
2. SEE SHEET S-0.1 FOR SCHEDULES.
3. SLAB CURING IS REQUIRED. SEE STRUCTURAL NOTES ON SHEET S-0.
4. CENTERLINES OF WALLS AND COLUMNS SHALL COINCIDE WITH THE FOUNDATION CENTERLINE, UNLESS SPECIFICALLY SHOWN OTHERWISE.
5. ELEVATIONS SHOWN ON THESE PLANS ARE RELATIVE TO THE TOP OF THE EXISTING GROUND FLOOR AT "+/- 0'-0".
6. SEE STRUCTURAL NOTES FOR PERFORMANCE SPECIFICATIONS.
7. VERIFY ALL DIMENSIONS, ELEVATIONS, SLAB STEPS, SLAB SLOPES AND FINISHED WITH THE ARCHITECTURAL DRAWINGS PRIOR TO CONSTRUCTION. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL DIMENSIONAL INFORMATION NOT SPECIFIED ON THE STRUCTURAL PLANS.
8. SIDE FORMS SHALL BE USED FOR ALL FOOTINGS, UNLESS IT CAN BE DEMONSTRATED THAT SOILS CAN MAINTAIN "VERTICAL" POSITION DURING CONSTRUCTION. INSPECTOR SHALL VERIFY AND ADVISE.

9.  INDICATES #8 REINFORCED LOAD BEARING MASONRY WALLS. CONTRACTOR SHALL REINFORCE WALLS WITH #5 VERTICAL REINFORCING BARS IN GROUTED CELLS AT ENDS, CORNERS, AND INTERSECTIONS AND AT 24" MAX. SPACING. NOTE THAT LOCATIONS OF REINFORCED CELLS AT ENDS, CORNERS AND ADJACENT TO OPENINGS (ONLY) IS SHOWN ON THE PLAN. CONTRACTOR TO SHOW "ADDITIONAL" REINFORCEMENT ON SHOP DRAWINGS FOR APPROVAL.
10. SEE STRUCTURAL NOTES ON SHEET S-0 FOR ADDITIONAL INFORMATION AND REQUIREMENTS NOT SHOWN HERE.
11. SOIL TREATMENT PER FBC, SECTION 1816 & 2326.5, R4409.13.5. SEE ARCHITECTURAL PLANS FOR DETAIL.
12. SPECIAL INSPECTION: ALL UNIT MASONRY REQUIRE INSPECTION PER FBC 2023.
13. CONTROL JOINTS SHALL BE SPACED AT 20'-0" MAX ON EACH DIRECTION. SEE DETAIL ON THE "TYPICAL DETAILS" SHEET ON THE STRUCTURAL PLANS.



FOR BUILDING DEPARTMENT USE ONLY

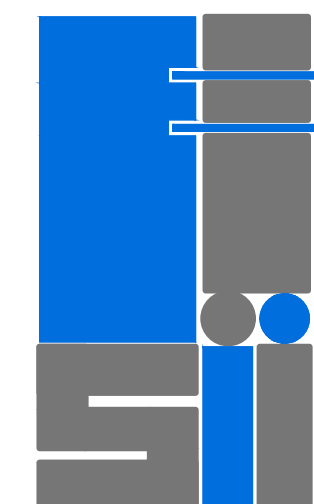

**STRUCTURES
INTERNATIONAL, INC.**
CONSULTING STRUCTURAL
ENGINEERS
7501 Wiles Road, Suite 106-B
Coral Springs, FL 33067
TEL: (954) 227-1512
www.siiengineers.com
C.A. #9446

MONZER I. FARAMAWI
FLORIDA P.E. #57439

TO THE BEST OF MY KNOWLEDGE AND
ABILITY, THE COMPLETED STRUCTURE
DEPICTED ON THESE PLANS COMPLIES WITH
THE APPLICABLE MINIMUM BUILDING CODES

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED
& SEALED BY MONZER I. FARAMAWI, P.E., S.I.
ON THE DATE ADJECENT TO THE SEAL.
PRINTED COPIES OF THIS DOCUMENT ARE
NOT CONSIDERED SIGNED & SEALED AND
THE SIGNATURE MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.


**BROKEN SOUND
RETAIL SHELL**
6600 NORTH MILITARY TRAIL
BOCA RATON, FL 33496





	BLDG DEPT COMMENTS GENERAL COORDINATION 1/09/2026
	BLDG DEPT COMMENT 04/10/2026

DRAWING TITLE:
FOUNDATION FLOOR
PLAN & SECTION
TRASH ENCLOSURE

JOB No:	25-035
DATE:	10/15/2025
STATUS:	PERMIT SET
DRAWN:	A.F.
CHECKED:	M.I.F

S-1

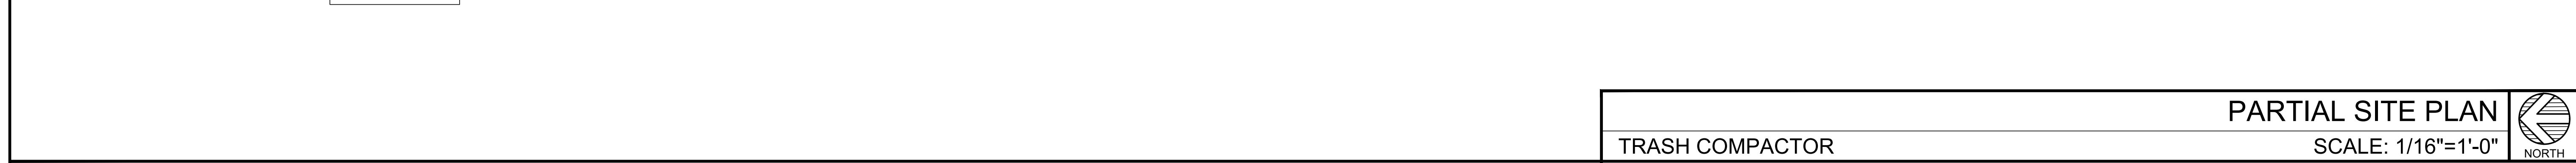

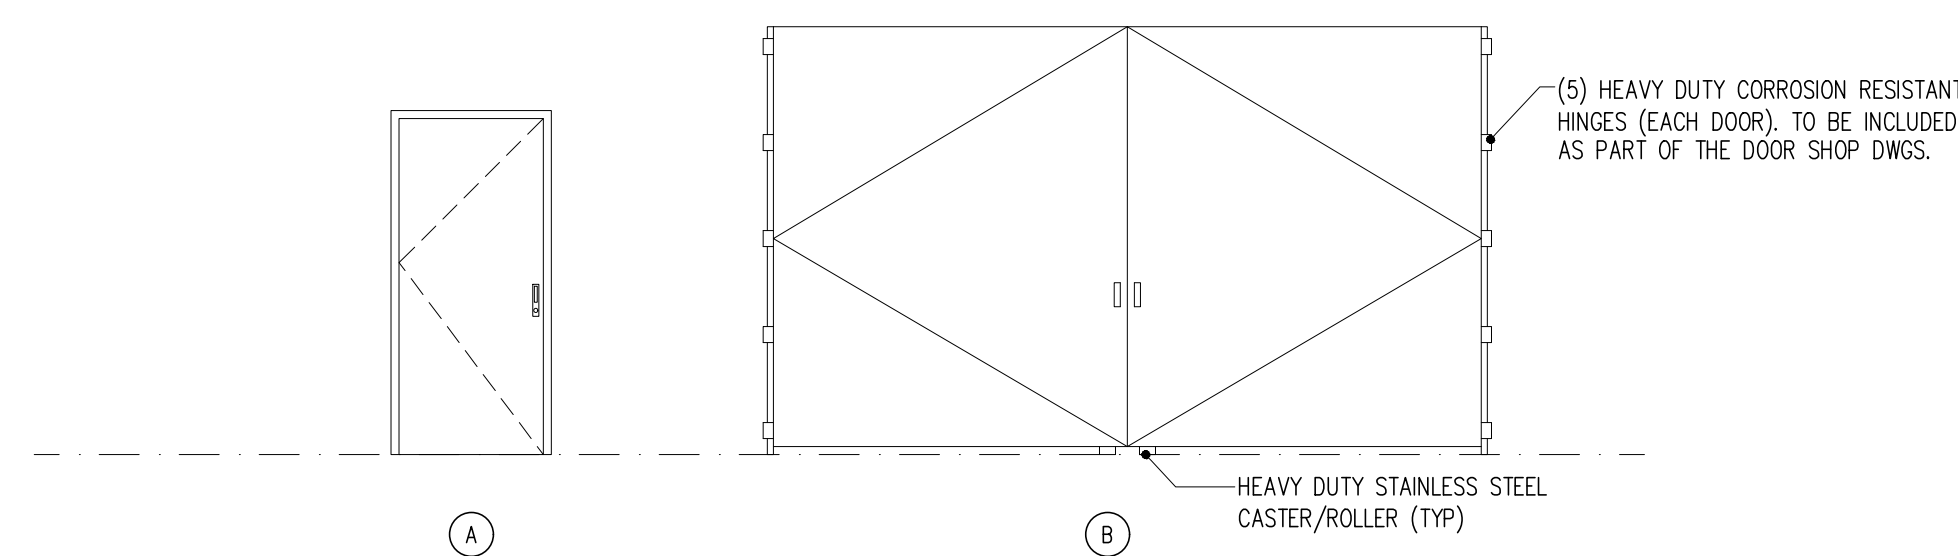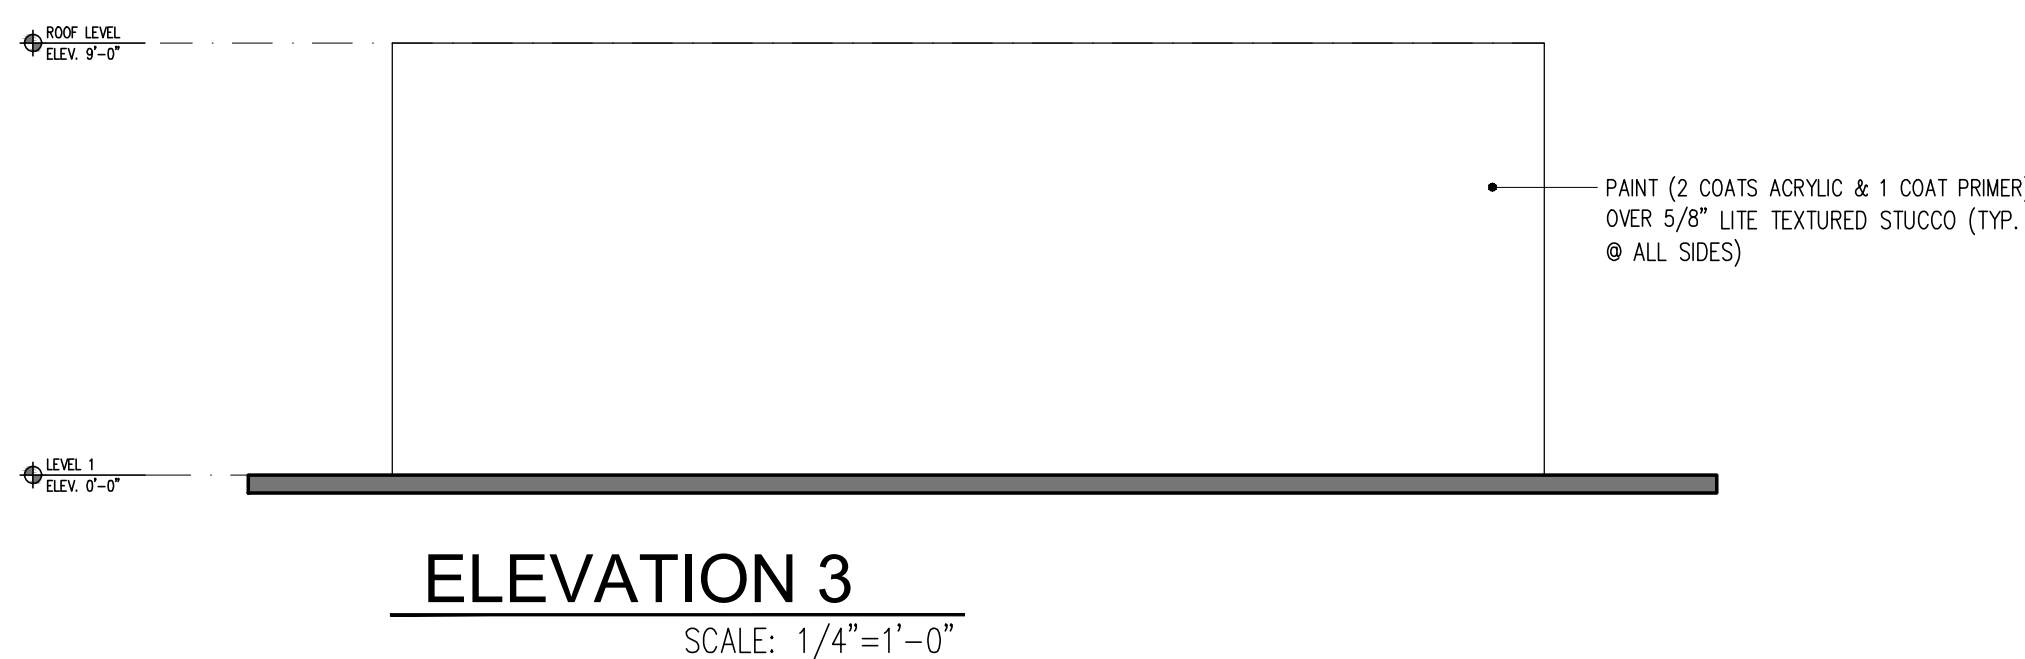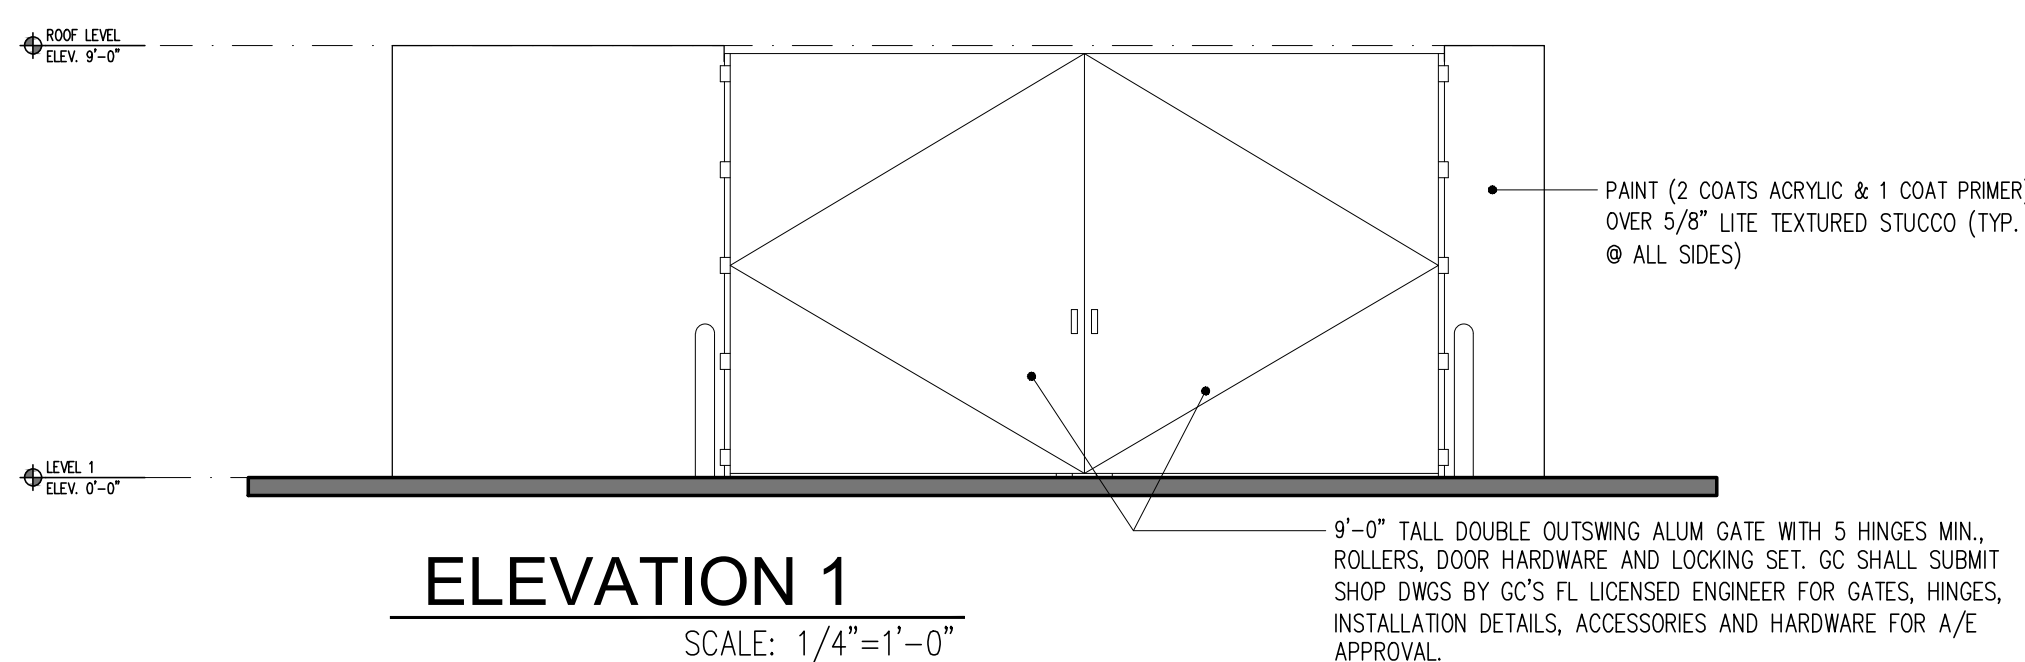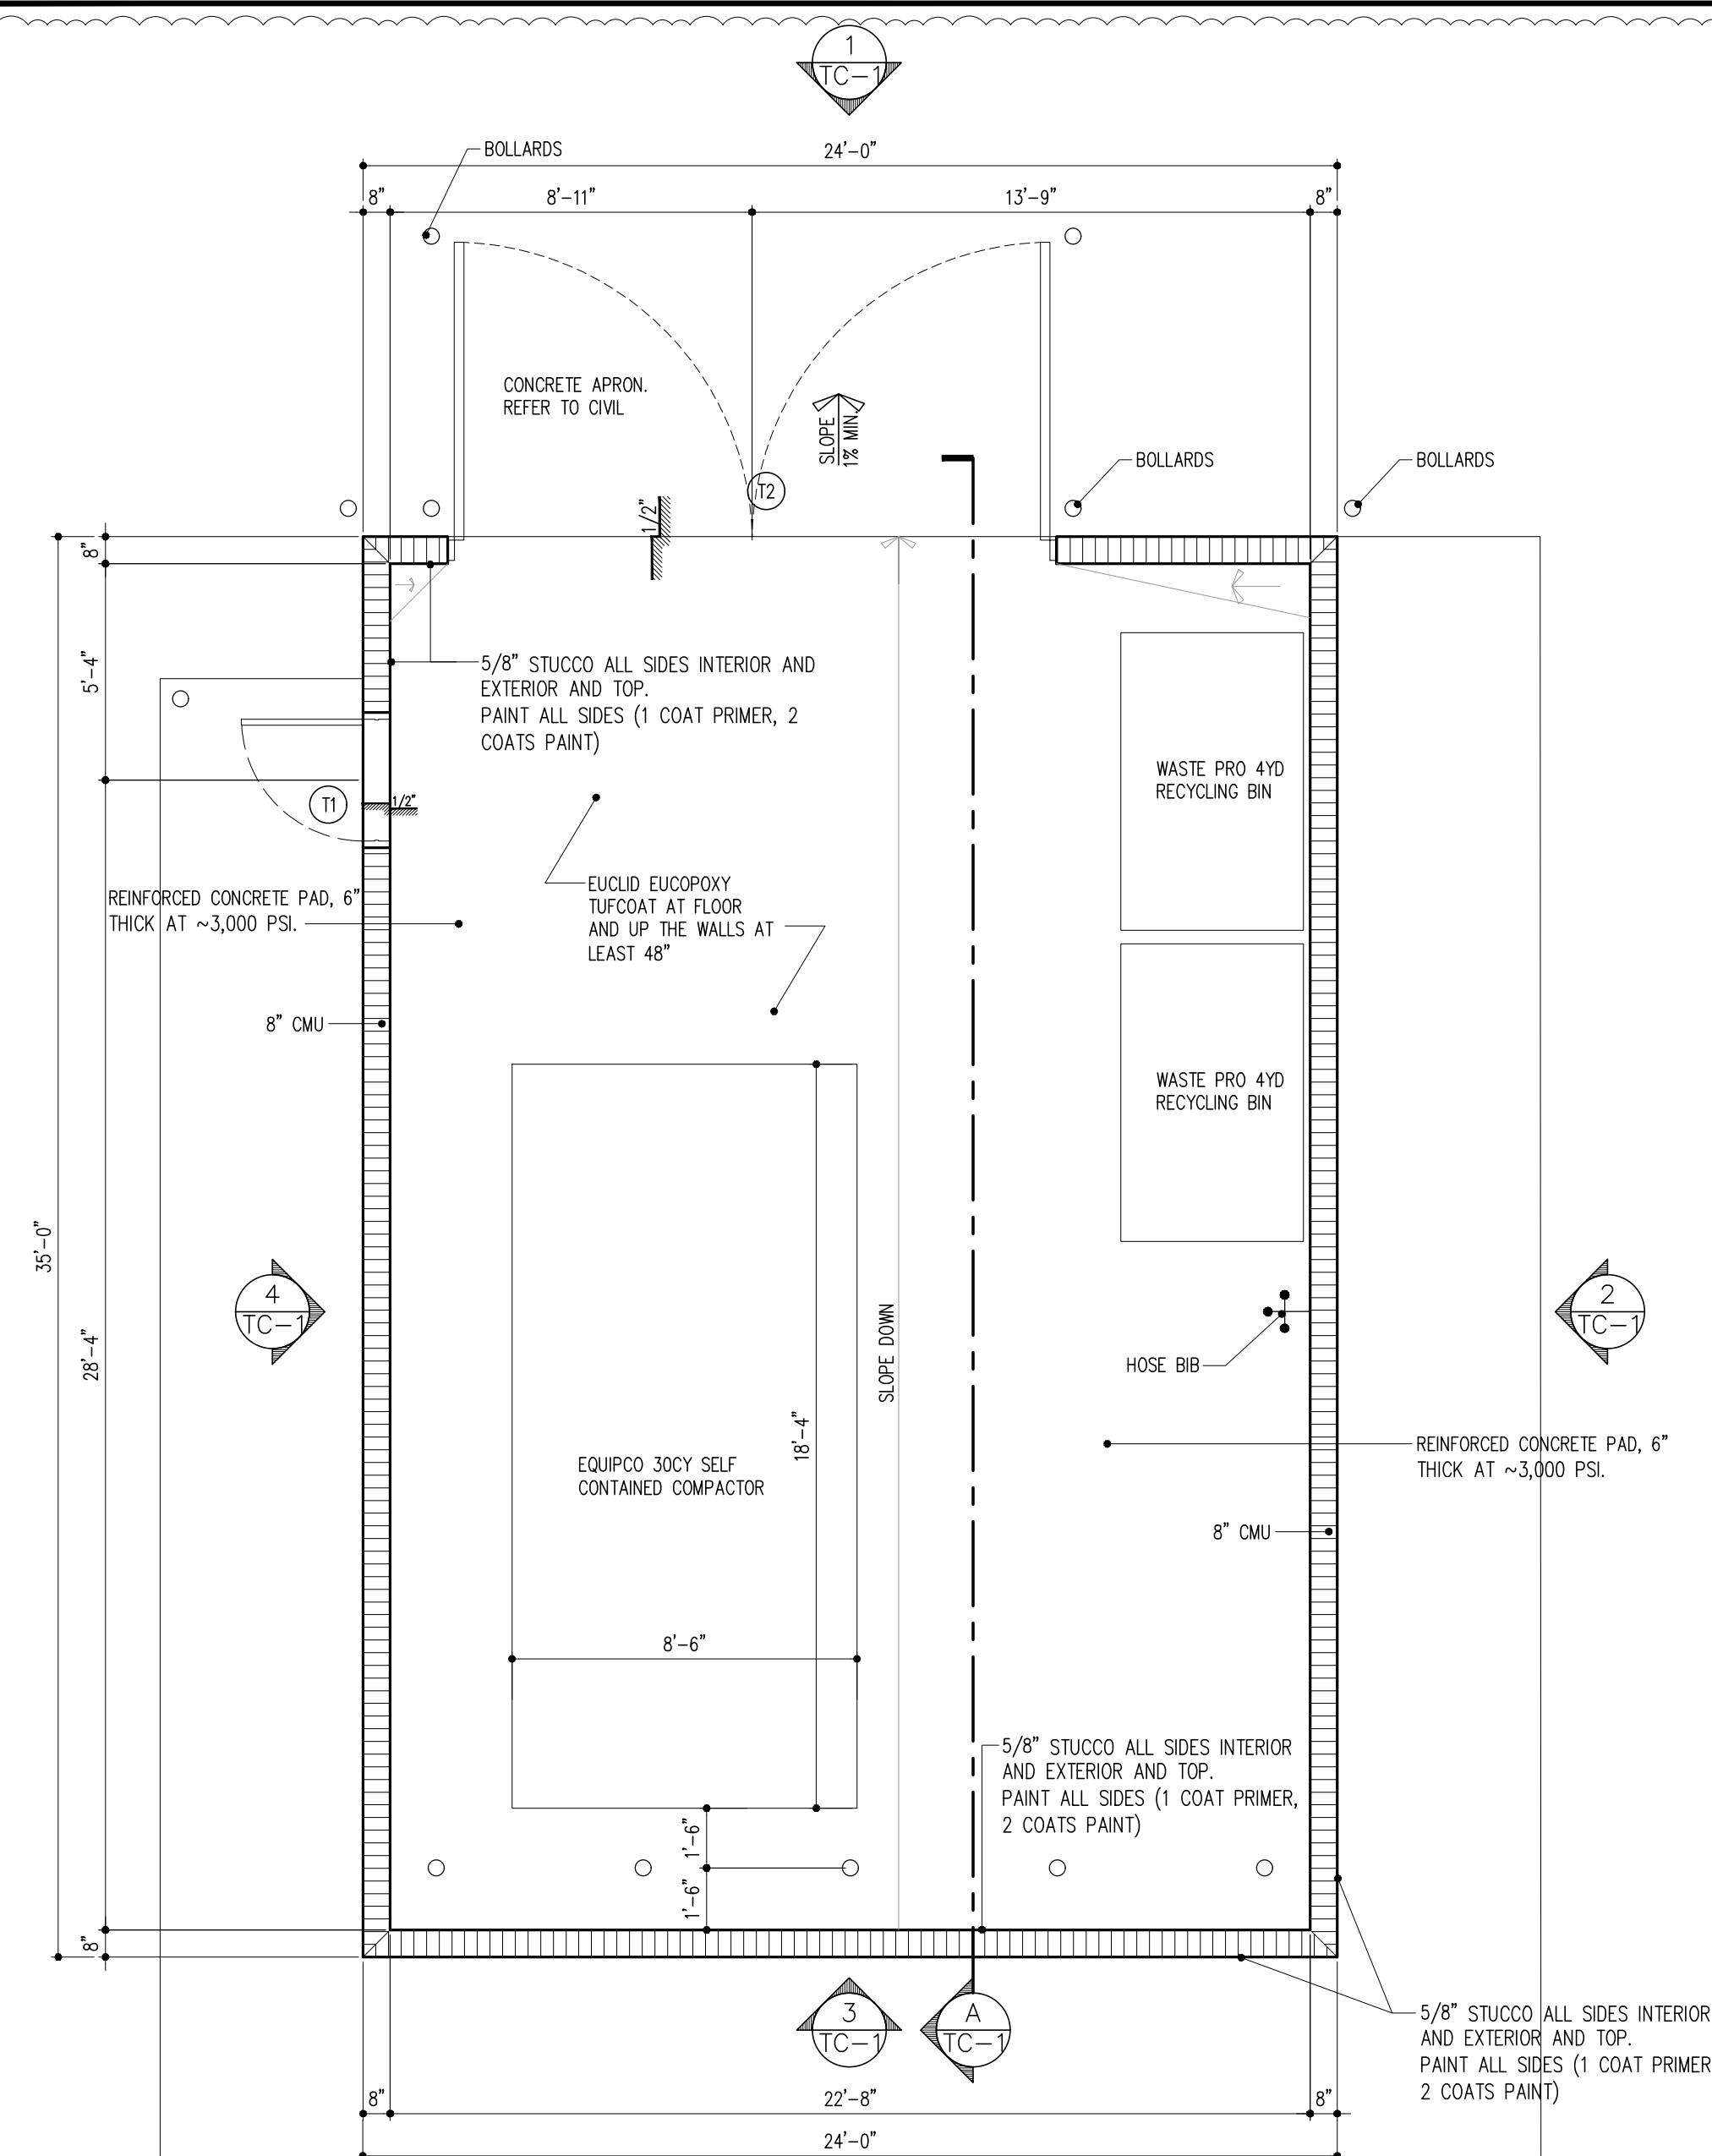

DOOR SCHEDULE													
ROOM NAME	SIZE				LABEL	DOOR		FRAME				REF. DWG No.	REMARKS
	DOOR TAG	WIDTH	HEIGHT	THICK		TYPE	M.A.T.	M.A.T.	HD.	JAMB	SILL		
GROUND LEVEL													
TRASH ENCLOSURE	T1	3'-0"	7'-0"			A	ALUM	ALUM					EXTERIOR GRADE METAL DOOR, IMPACT RATED, PAINTED.
TRASH ENCLOSURE	T2	(2)7'-4"	9'-0"			B	ALUM	ALUM					HEAVY GAUGE ALUM. IMPACT-RATE SLIGHT SWIP DINGS FOR APPROVAL PAINT TO MATCH

